

# Service manual

## MIV V5 Heat Recovery

### DC INVERTER R410A

MVUR252B-VA3

MVUR280B-VA3

MVUR335B-VA3

MVUR400B-VA3

MVUR450B-VA3



# Contents

<b>Part 1 General Information .....</b>	<b>1</b>
<b>Part 2 Selection Procedure .....</b>	<b>16</b>
<b>Part 3 Part 3 Outdoor Unit Specifications &amp; Performance .....</b>	<b>24</b>
<b>Part 4 Outdoor Unit Installation .....</b>	<b>100</b>
<b>Part 5 MS Unit Installation .....</b>	<b>132</b>
<b>Part 6 Troubleshooting .....</b>	<b>147</b>

# Part 1 General Information


<b>1. Features .....</b>	<b>2</b>
<b>2. Outdoor units line-up.....</b>	<b>8</b>
<b>3. MS units lineup .....</b>	<b>10</b>
<b>4. Indoor units lineup.....</b>	<b>11</b>
<b>5. Nomenclature .....</b>	<b>13</b>

# 1. Features


## 1.1 Energy saving

### 1.1.1 All DC inverter compressors

All DC inverter compressors make the capacity output better distributed, and always work at 60-140Hz which is the most efficient range. It makes the efficiency more than 30% higher than the normal.

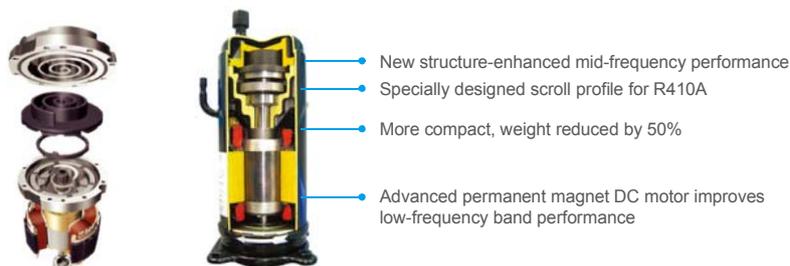


### 1.1.2 All DC fan motors

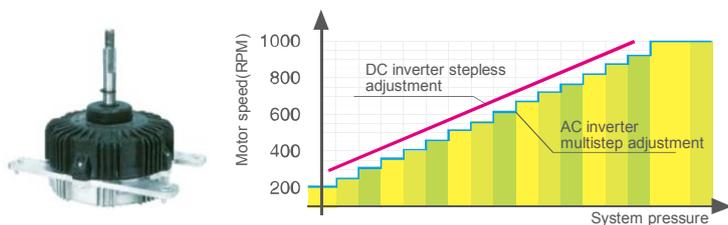

According to the running load and system pressure, the system controls the speed of DC fan to achieve the minimum energy consumption and best performance.


### 1.1.3 High efficiency heat exchanger

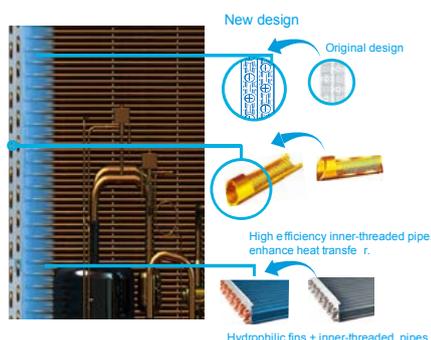

The new designed window fins enlarge the heat-exchanging area, decrease the air resistance, save more power and enhance heat exchange performance. Hydrophilic film fins and inner-threaded copper pipes optimize heat exchange efficiency.


### 1.1.4 Heat recovery, more efficiency

Simultaneous heating and cooling in different zones, more energy saving by heat recovery from one space to another which saves up to 50% in costs compared with a conventional heat pump system.

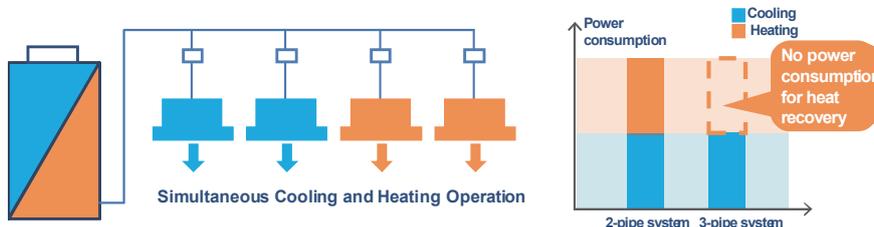

### 1.1.5 Heating capacity automatic adjustment

Two parts condenser individual design, the unit can distribute a part of evaporator to be as condensing area according to the heating load requirement to improve the utilization rate of the condenser.

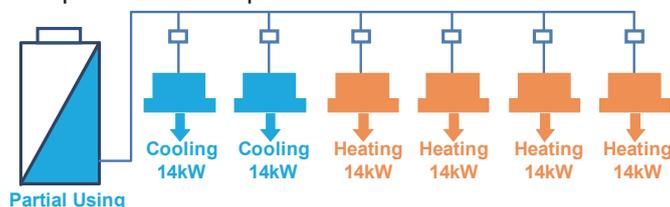


## 1.2 Flexible design

### 1.2.1 Wide capacity range


The outdoor units' capacity range from 8HP to 64HP in 2HP increment. Maximum 64 indoor units with capacity up to 130% of total outdoor units can be connected in one refrigeration system.

### 1.2.2 Wide operation range

The V4 Plus R series system operates stably at extreme temperatures ranging from  $-20^{\circ}\text{C}(-4^{\circ}\text{F})$  to  $48^{\circ}\text{C}(118.4^{\circ}\text{F})$ .

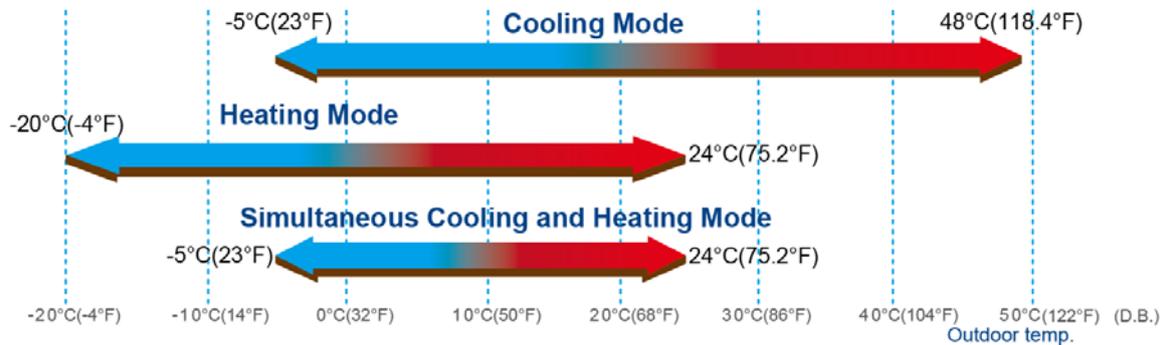

### 1.2.3 Flexible piping design

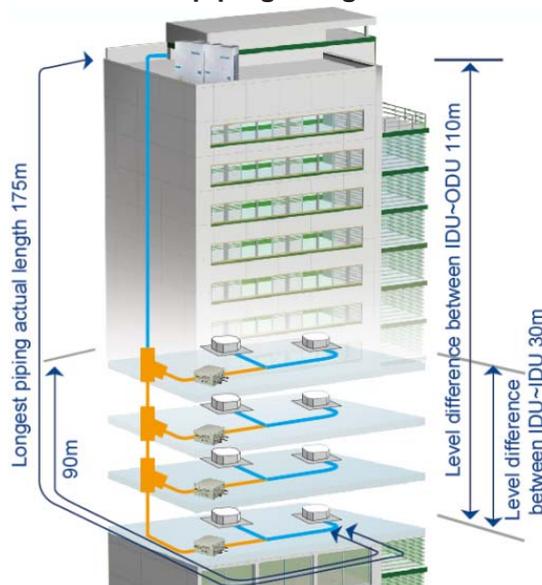


Piping length	Permitted value
Total pipe length	3280ft(1000m)
Max. actual pipe length	574ft(175m)
Max. equivalent pipe length	656ft(200m)
Equivalent piping length from the farthest IDU to the first indoor branch joint	131/295*ft(40/90*m)
Equivalent piping length from MS to its farthest downstream indoor unit	131ft(40m)
Level difference between outdoor unit and indoor unit	Outdoor unit is down: 361ft(110m) Outdoor unit is up: 230ft(70m)
Level difference between indoor units	98ft(30m)

\* When the length is more than 40m, it needs to meet the specific conditions according to the installation technical manual.

### 1.2.4 High external static pressure

High static pressure propeller and optimized fan guard can adapt to various installation environments.


Midea now offers up to  $60\text{Pa}(0.24\text{in.WG})$  external static pressure for customized applications ( $60\text{Pa}(0.24\text{in.WG})$  is available customized for the 8-12HP model;  $40\text{Pa}(0.16\text{in.WG})$  is available customized for 14-16HP). A standard  $0-20\text{Pa}(0-0.08\text{in.WG})$  function is equipped by default.

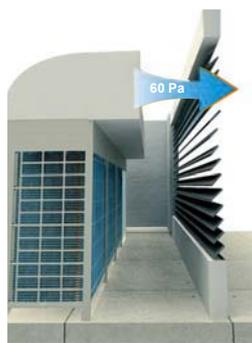

## 1.3 High reliability

### 1.3.1 Cycle duty operation

In one combination, any of the outdoor unit can run as the master unit and master unit can cycle in a period, to realize the equal lifespan among the outdoor units. As a result extend the system lifespan significantly.

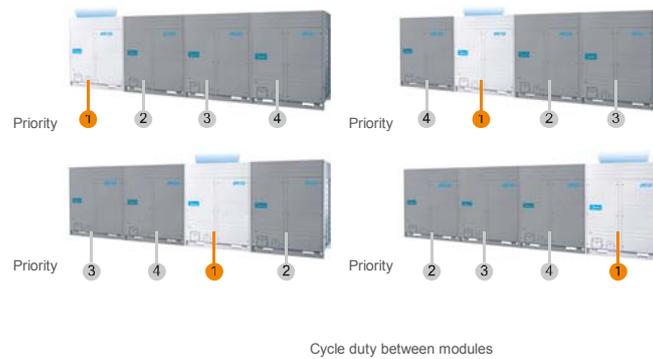

### 1.3.2 Backup operation

In a multiple system, if one module is failed, other modules can be backup instead of the failed one for continuing operation.

### 1.3.3 Precise oil control technology

5 stage oil control technology ensures every outdoor unit & compressor's oil always keep in the safe level, completely solve the compressor oil lack problem.


1st stage: compressor internal oil separate

2nd stage: high efficiency oil separator (separation efficiency up to 99%)


3rd stage: oil balance technology between compressors

4th stage: oil balance technology between modules

5th stage: intelligent system oil return program

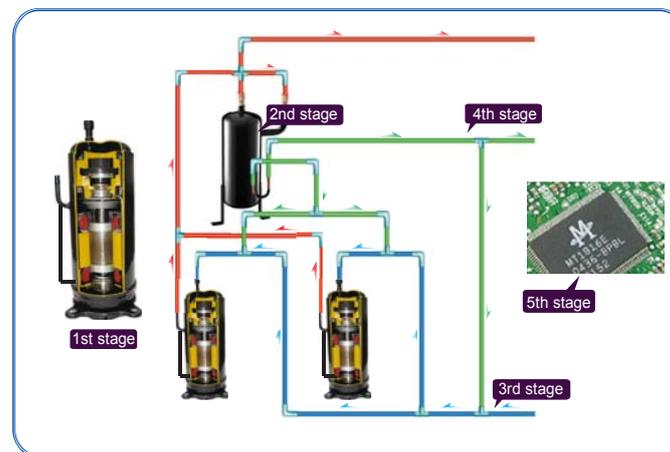

### 1.3.4 Intelligent soft start technology

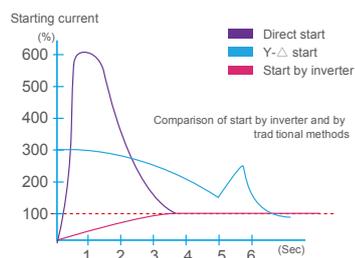


All the DC inverter compressors start with a very low current which will obviously reduce the strike to the electric network and make the system more reliable and stable.

## 1.4 Enhanced comfort

### 1.4.1 Cooling and heating simultaneous for new designed MS (Mode Switch) equipment


The outdoor unit individual controls the operation mode of each group indoor unit to achieve simultaneous heating and cooling in one system under the MS unit which adopts solenoid valve to precise control refrigerant flow rate.

The indoor units connect to one MS can realize simultaneous cooling and heating operation.

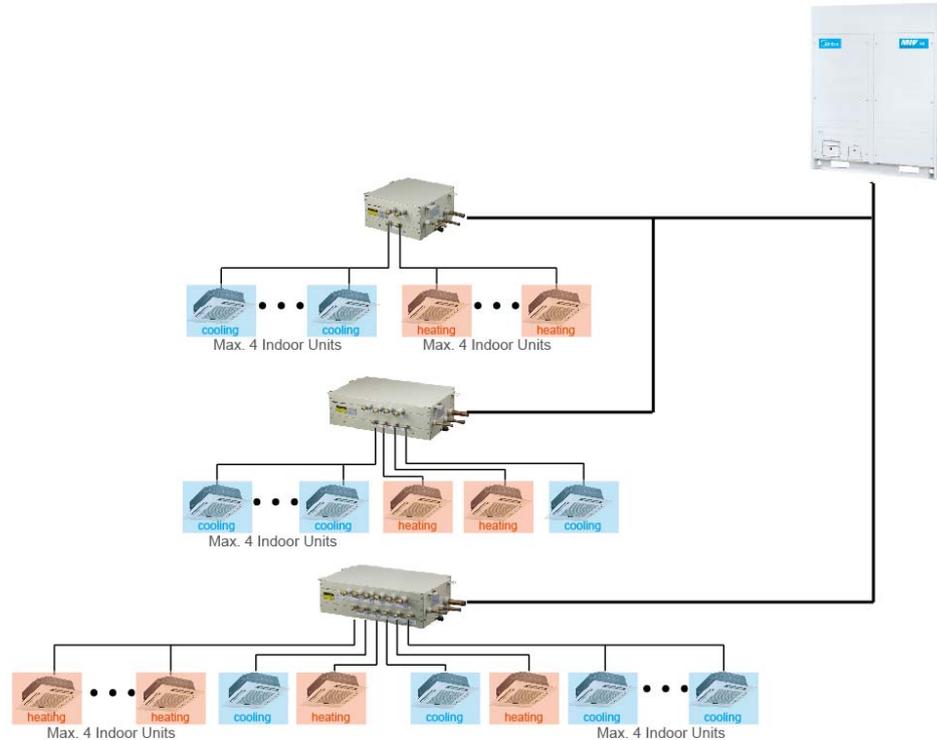


### 1.4.2 Night silent operation mode

Midea's Night Silent Mode feature which is easily set on the PCB board allows the unit to be set to vary time options during Non-Peak and Peak operation time optimizing the units noise output.

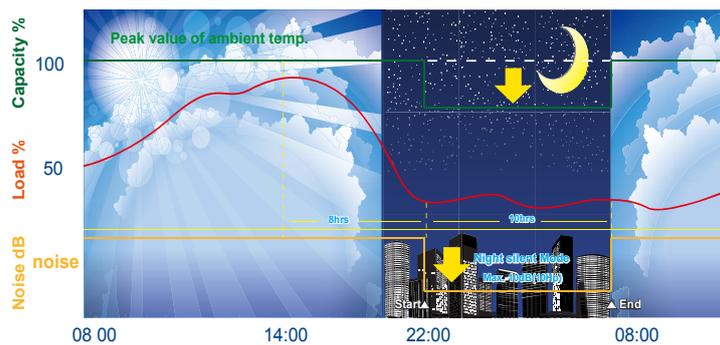

### 1.4.3 Continuous heating during defrost operation

Each heat exchanger is defrosted by using heat transferred from one heat exchanger to the other in the outdoor unit.

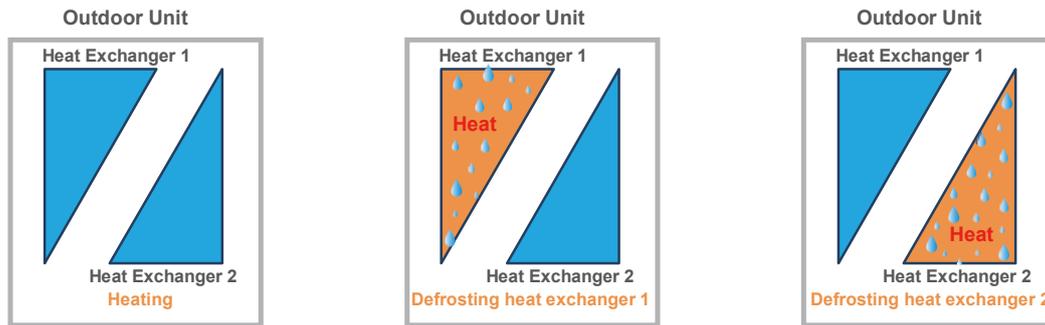

## 1.5 Convenient installation & maintenance

### 1.5.1 Remote addressing


Addressing indoor units are able to be done just by pressing the button of the controller.

No need to set the address by the DIP switch one by one.



### 1.5.2 Simple communication wiring

Centralized controller (CCM03) can connect from indoor side or outdoor side (XYE terminals) at will. Only one group of communication wire of PQE, achieved both of communication for indoor & outdoor unit and network. It's more convenient for communication wiring.

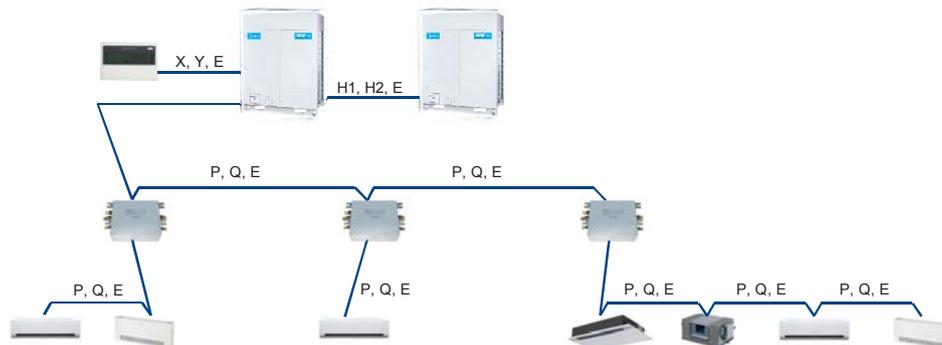

### 1.5.3 Convenient inspection window & 4 bits LED digital tube display

The check window reserved on electric control box provides a convenient spot checking and status enquiry. With the 4 bits digital tube LED display, it is very convenient to show the data of the system, such as pressure, compressor frequency, error code, discharge temperature etc., which can make the maintenance, installation and commissioning easier.




#### 1.5.4 Professional structure design

Compressor is near the outside, and there is simple pipe system for convenient maintenance.

The newly designed rotating control box is so excellent that it can rotate in a wide angle.

It is convenient for the inspection and maintenance of the pipeline system and greatly reduced the time of dismount the electric control box.

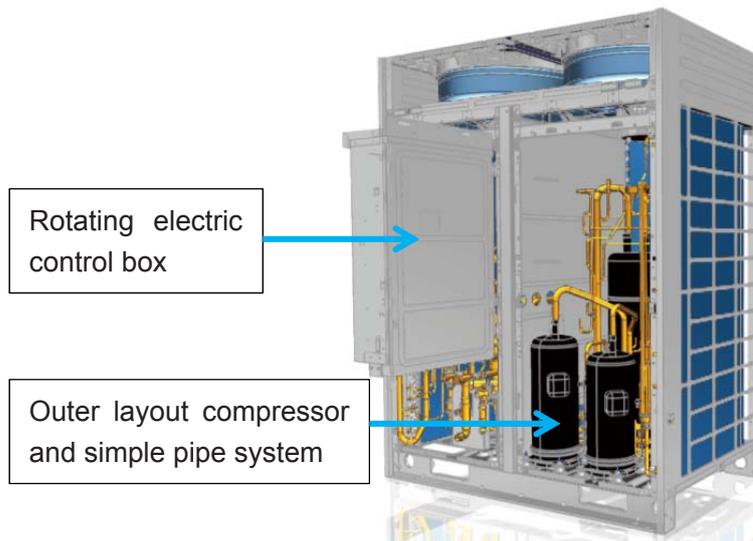

## 2. Outdoor units lineup

### ● Outdoor units lineup

The capacity range of outdoor units is from 8HP up to 64HP in 2HP increment. Maximum 64 indoor units with capacity up to 130% of total outdoor units can be connected as one refrigeration system.

8, 10, 12, 14, 16HP



18-32HP



34-48HP



50-64HP



### ● Combination table

Capacity (HP)	Standard combination		High efficiency combination		Max. N° of connectable indoor units
	Model	Combination type	Model	Combination type	
8	MVUR252B-VA3	8HP×1	MVUR252B-VA3	8HP×1	13
10	MVUR280B-VA3	10HP×1	MVUR280B-VA3	10HP×1	16
12	MVUR335B-VA3	12HP×1	MVUR335B-VA3	12HP×1	20
14	MVUR400B-VA3	14HP×1	MVUR400B-VA3	14HP×1	23
16	MVUR450B-VA3	16HP×1	MVUR450B-VA3	8HP+8HP	26
18	MVUR532B-VA3	8HP+10HP	MVUR532B-VA3	8HP+10HP	29
20	MVUR560B-VA3	10HP+10HP	MVUR560B-VA3	8HP+12HP	33
22	MVUR615B-VA3	10HP+12HP	MVUR615B-VA3	10HP+12HP	36
24	MVUR680B-VA3	10HP+14HP	MVUR680B-VA3	8HP×3	39
26	MVUR730B-VA3	10HP+16HP	MVUR730B-VA3	8HP×2+10HP	43
28	MVUR800B-VA3	14HP×2	MVUR800B-VA3	8HP×2+12HP	46
30	MVUR850B-VA3	14HP+16HP	MVUR850B-VA3	8HP+10HP+12HP	50
32	MVUR900B-VA3	16HP×2	MVUR900B-VA3	8HP×4	53
34	MVUR960B-VA3	10HP×2+14HP	MVUR960B-VA3	8HP×3+10HP	56
36	MVUR1010B-VA3	10HP×2+16HP	MVUR1010B-VA3	8HP×3+12HP	59
38	MVUR1065B-VA3	10HP+12HP+16HP	MVUR1065B-VA3	8HP×2+10HP+12HP	63
40	MVUR1130B-VA3	10HP+14HP+16HP	MVUR1130B-VA3	8HP×2+12HP×2	64
42	MVUR1200B-VA3	14HP×3	MVUR1200B-VA3	8HP+10HP+12HP×2	64
44	MVUR1250B-VA3	14HP×2+16HP	MVUR1250B-VA3	8HP+12HP×3	64
46	MVUR1300B-VA3	14HP+16HP×2	MVUR1300B-VA3	10HP+12HP×3	64
48	MVUR1350B-VA3	16HP×3	MVUR1350B-VA3	12HP×4	64
50	MVUR1432B-VA3	8HP+10HP+16HP×2	MVUR1432B-VA3	12HP×3+14HP	64
52	MVUR1460B-VA3	10HP×2+16HP×2	MVUR1460B-VA3	12HP×3+16HP	64
54	MVUR1515B-VA3	10HP+12HP+16HP×2	MVUR1515B-VA3	12HP×2+14HP+16HP	64
56	MVUR1580B-VA3	10HP+14HP+16HP×2	MVUR1580B-VA3	12HP×2+16HP×2	64
58	MVUR1650B-VA3	14HP×3+16HP	MVUR1650B-VA3	12HP+14HP+16HP×2	64
60	MVUR1700B-VA3	14HP×2+16HP×2	MVUR1700B-VA3	12HP+16HP×3	64
62	MVUR1750B-VA3	14HP+16HP×3	MVUR1750B-VA3	14HP+16HP×3	64
64	MVUR1800B-VA3	16HP×4	MVUR1800B-VA3	16HP×4	64

### 3. MS units lineup

#### 3.1 MS units which can be connected multiple indoor units

Model name	External appearance
MS02/N1-C	
MS04/N1-C	
MS06/N1-C	

#### Specifications

MS Model	Max. number of all downstream indoor units
MS02/N1-C	8
MS04/N1-C	16
MS06/N1-C	24

#### 3.2 MS units which can be connected only one indoor unit

Model name	External appearance
MS02E/N1-C	
MS04E/N1-C	

#### Specifications

MS Model	Max. number of all downstream indoor units
MS02E/N1-C	1
MS04E/N1-C	1

#### 4. Indoor units lineup

Capacity (×100W)	Cassette type				
	One-way cassette		Two-way cassette	Compact four-way cassette	Four-way cassette
					
18	•			•	
22	•		•	•	
28	•		•	•	•
36	•		•	•	•
45		•	•	•	•
56		•	•	•	•
71			•		•
80					•
90					•
100					•
112					•
140					•

Capacity (×100W)	Duct type					
	Low static pressure duct	Medium static pressure duct	High static pressure duct			
						
18	•					
22	•	•				
28	•	•				
36	•	•				
45		•				
56		•				
71		•	•			
80		•	•			
90		•	•			
100						
112		•	•			
140		•		•		
160				•		
200					•	
250					•	
280					•	
400						•
450						•
560						•

**Indoor units lineup**

Capacity (×100W)	Floor-standing/Ceiling & Floor/Console		
	Cased floor-standing	Ceiling & floor	console
			
22	•		•
28	•		•
36	•	•	•
45	•	•	•
56	•	•	
71	•	•	
80	•	•	
90		•	
112		•	
140		•	
160		•	

Capacity (×100W)	Wall mounted	
	Wall mounted	Wall mounted
		
22	•	•
28	•	•
36	•	•
45	•	•
56	•	•
71	•	•
80		
90		
125		
140		
200		
250		
280		


Note:

Due to continuous improvement, specifications are subject to change without prior notice.

## 5. Nomenclature

### 5.1 Outdoor unit

# MVUH252B - VA3

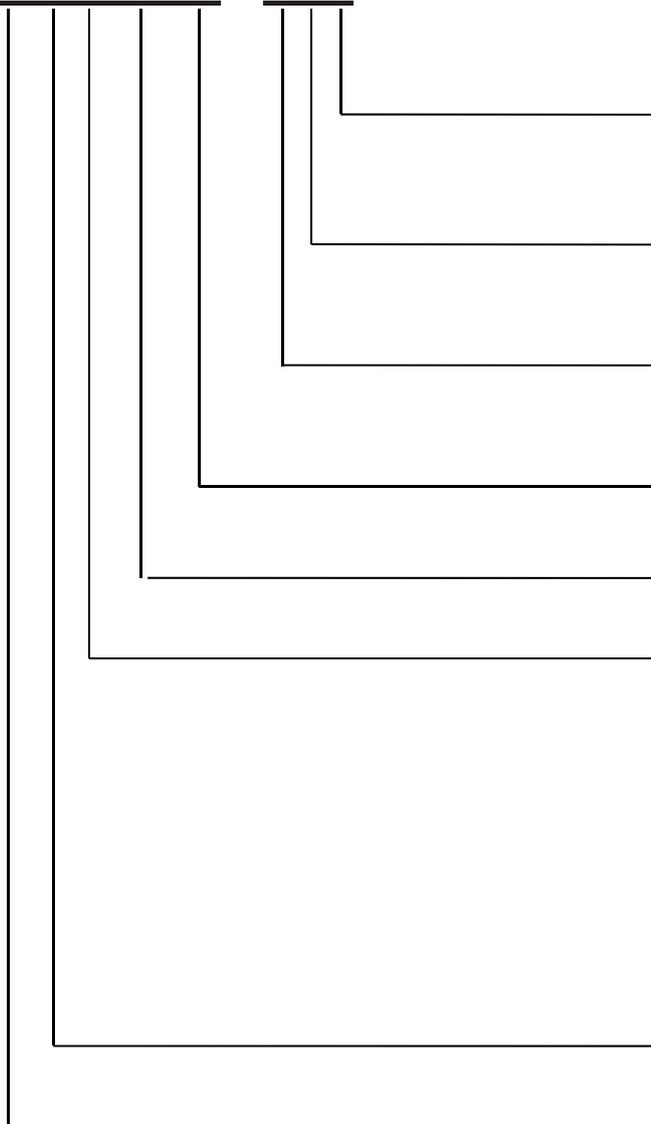

#### Power

**1** - 1 phase, 50 Hz

**3** - 3 phases, 50 Hz

#### Refrigerant

**A** - R410A

**B** - R22

#### Inverter

(in)**V**(erter) - inverter

**S**(tandard) – on/off

#### Model, Modification

**A...Z, AA...ZZ**

#### Capacity index

**kW\*10**

#### The main feature of the system

##### air cooled:

**C**(ooling) – cooling only

**H**(eat pump) – cooling and heating

**R**(ecovery) – heat recovery, 3-pipe

##### water cooled:

**Q**(ooling) – cooling only

**W**(ater) – cooling and heating

(reco)**V**(ery) – heat recovery, 3-pipe


#### Identifier of the outdoor unit

(o)**U**(tdoor)


#### Manufacturer's brand and class of the system **M**(idea) **V**(RF)

## 5.2 MS unit

**MS 02 E / N1 - C**

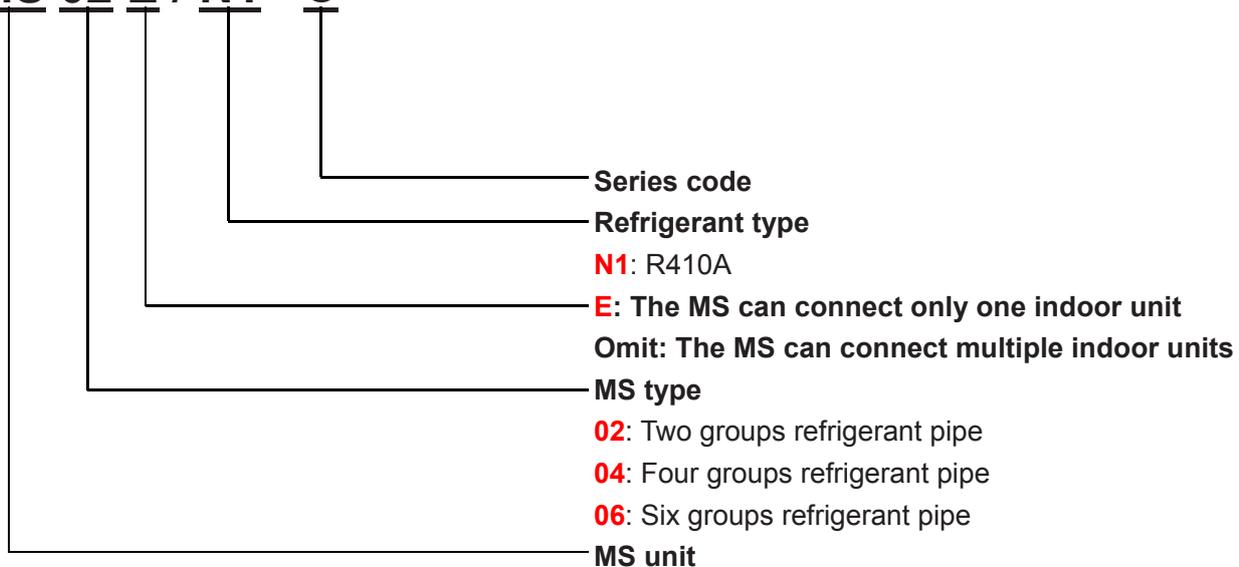

## 5.3 Indoor unit

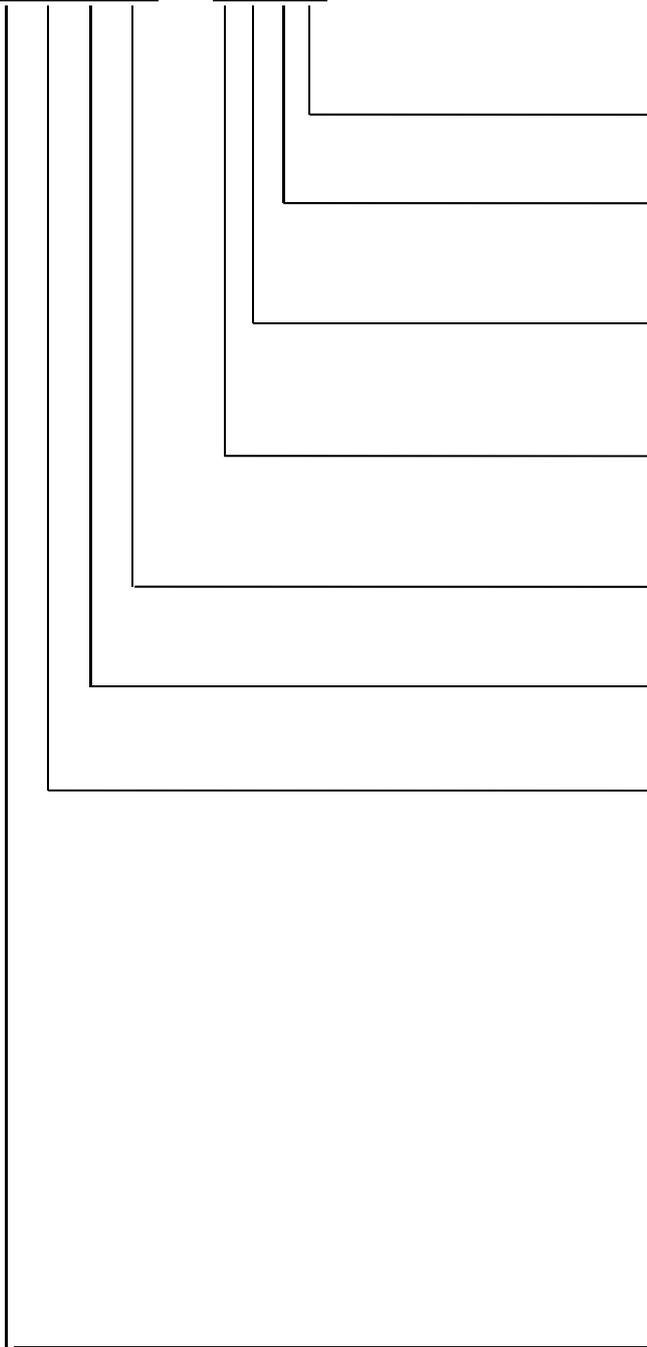**MVC28A – VA1****Design features (may be absent)**

For example: **G**(rey), **W** (hite) - color

**Power**

**1** - 1 phase, 50 Hz

**3** - 3 phases, 50 Hz

**Refrigerant**

**A** - R410A

**B** - R22

**Inverter**

(in)**V**(erter) - inverter

**S**(tandard) - on/off

**Model, Modification**

**A...Z, AA...ZZ**

**Capacity index**

**kW\*10**

**Type of the indoor unit**

**W**(all) - wall

(ca)**S**(ette) – cassette 600x600

**C**(assette) - cassette

(o)**N**(e way) – 1-way cassette

**T**(wo way) – 2-way cassette

**L**(ow) – low static pressure duct

**M**(edium) – medium static pressure duct

**H**(igh) - high static pressure duct

(fle)**X** – ceiling & floor

**F**(loor standing) – floor standing (колонный)

**E**(floor-standing **e**xposed) – floor standing  
exposed

**D** – console

**Manufacturer's brand and class of the system** **M**(idea) **V**(RF)

# Part 2 Selection Procedure

1. Introduction .....	17
2. Unit selection (based on cooling load) .....	22

## 1. Introduction

### 1.1 Model selection procedure

Select the model and calculate the capacity for each refrigerant system according to the procedure shown below.

- Calculation of the indoor air-conditioning load, Calculate the maximum air-conditioning load for each room or zone.

Selection of an air conditioning system

- Select the ideal air conditioning system for air conditioning of each room or zone

Design of the control system

- Design a suitable control system for the selected air conditioning system

Preliminary selection of indoor and outdoor units

- Make preliminary selections that are within the allowable range for the system

Check of the tubing length and elevation difference

- Check that the length of refrigerant tubing and the elevation difference are within the allowable ranges

Calculation of the corrected outdoor unit capacity

- Capacity correction coefficient for model, outdoor temperature conditions, tubing length and elevation difference.

Calculation of the actual capacity for each indoor unit

- Calculate the corrected indoor/outdoor capacity ratio, based on the corrected outdoor unit capacity and the total corrected capacity of all indoor units in the same system.

Recheck of the actual capacity for each indoor unit

- If the capacity is inadequate, reexamine the unit combinations.

### 1.2 Indoor unit selection

Enter INDOOR UNIT CAPACITY TABLES at given indoor and outdoor temperature. Select the unit that the capacity is the nearest to and greater than given load.

Note:

Individual indoor unit capacity is subject to change by the combination. Actual capacity has to be calculated according to the combination by using outdoor unit capacity table.

#### Calculation of actual capacity of indoor unit

Because the capacity of a multi air-conditioner changes according to the temperature conditions, tubing length, elevation difference and other factors, select the correct model after taking into account the various correction values. When selecting the model, calculate the corrected capacities of the outdoor unit and each indoor unit. Use the corrected outdoor unit capacity and the total corrected capacity of all the indoor units to calculate the actual final capacity of each indoor unit.

#### Find the indoor unit capacity correction coefficient for the following items:

- Capacity correction for the indoor unit temperature conditions

From the graph of capacity characteristics, use the indoor temperature to find the capacity correction coefficient.

- Capacity distribution ratio based on the indoor unit tubing length and elevation difference.

First, in the same way as for the outdoor unit, use the tubing length and elevation difference for each indoor unit to find the correction coefficient from the graph of capacity change characteristics

**Capacity distribution ratio for each indoor unit=Correction coefficient for that indoor unit / Correction coefficient for the outdoor unit**

### 1.3 Outdoor unit selection

Allowable combinations are indicated in INDOOR UNIT COMBINATION TOTAL CAPACITY INDEX TABLE.

In general, outdoor unit can be selected as follows though the location of the unit, zoning and usage of the rooms may be considered.

The indoor and outdoor unit combination is determined that the sum of indoor unit capacity index is nearest to and smaller than the capacity index at 100% combination ratio of each outdoor unit. Up to 8~16 indoor units can be connected to one outdoor unit. It is recommended to choose a larger outdoor unit if the installation space is large enough.

If the combination ratio is greater than 100%, the indoor unit selection shall be reviewed by using actual capacity of each indoor unit.

### INDOOR UNIT COMBINATION TOTAL CAPACITY INDEX TABLE

Outdoor Unit HP(Btu/h)	Indoor Unit Combination Ratio kW(Btu/h)								
	130%	120%	110%	100%	90%	80%	70%	60%	50%
8(86000)	32.8 (111900)	30.2 (103000)	27.7 (94500)	25.2 (86000)	22.7 (77500)	20.1 (68600)	17.6 (60100)	15.1 (51500)	12.6 (43000)
10(95500)	36.4 (124200)	33.6 (114600)	30.8 (105100)	28.0 (95500)	25.2 (86000)	22.4 (76400)	19.6 (66900)	16.8 (57300)	14.0 (47800)
12(114300)	43.6 (148800)	40.2 (137200)	36.9 (125900)	33.5 (114300)	30.2 (103000)	26.8 (91400)	23.5 (80200)	20.2 (68900)	16.8 (57300)
14(136500)	52.0 (177400)	48.0 (163800)	44.0 (150100)	40.0 (136500)	36.0 (122800)	32.0 (109200)	28.0 (95500)	24.0 (81900)	20.0 (68200)
16(153500)	58.5 (199600)	54.0 (184200)	49.5 (168900)	45.0 (153500)	40.5 (138200)	36.0 (122800)	31.5 (107500)	27.0 (92100)	22.5 (76800)
18(181500)	69.2 (236100)	63.8 (217700)	58.5 (199600)	53.2 (181500)	47.9 (163400)	42.6 (145400)	37.2 (126900)	31.9 (108800)	26.6 (90800)
20(191000)	72.8 (248400)	67.2 (229300)	61.6 (210200)	56.0 (191100)	50.4 (172000)	44.8 (152900)	39.2 (133800)	33.6 (114600)	28.0 (95500)
22(209800)	80.0 (273000)	73.8 (251800)	67.7 (231000)	61.5 (209800)	55.4 (189000)	49.2 (167900)	43.1 (147100)	36.9 (125900)	30.8 (105100)
24(232000)	88.4 (301600)	81.6 (278400)	74.8 (255200)	68.0 (232000)	61.2 (208800)	54.4 (185600)	47.6 (162400)	40.8 (139200)	34.0 (116000)
26(249100)	94.9 (323800)	87.6 (298900)	80.3 (274000)	73.0 (249100)	65.7 (224200)	58.4 (199300)	51.1 (174400)	43.8 (149400)	36.5 (124500)
28(273000)	104.0 (354900)	96.0 (327600)	88.0 (300300)	80.0 (273000)	72.0 (245700)	64.0 (218400)	56.0 (191100)	48.0 (163800)	40.0 (136500)
30(290000)	110.5 (377000)	102.0 (348000)	93.5 (319000)	85.0 (290000)	76.5 (261000)	68.0 (232000)	59.5 (203000)	51.0 (174000)	42.5 (145000)
32(307000)	117.0 (399200)	108.0 (368500)	99.0 (337800)	90.0 (307100)	81.0 (276400)	72.0 (245700)	63.0 (215000)	54.0 (184200)	45.0 (153500)
34(327500)	124.8 (425800)	115.2 (393100)	105.6 (360300)	96.0 (327600)	86.4 (294800)	76.8 (262000)	67.2 (229300)	57.6 (196500)	48.0 (163800)
36(344600)	131.3 (448000)	121.2 (413500)	111.1 (379100)	101.0 (344600)	90.9 (310200)	80.8 (275700)	70.7 (241200)	60.6 (206800)	50.5 (172300)
38(363300)	138.5 (472600)	127.8 (436100)	117.2 (399900)	106.5 (363400)	95.9 (327200)	85.2 (290700)	74.6 (254500)	63.9 (218000)	53.3 (181900)

**INDOOR UNIT COMBINATION TOTAL CAPACITY INDEX TABLE**

Outdoor Unit	Indoor Unit Combination Ratio kW(Btu/h)								
	130%	120%	110%	100%	90%	80%	70%	60%	50%
40(385600)	146.9 (501200)	135.6 (462700)	124.3 (424100)	113.0 (385600)	101.7 (347000)	90.4 (308400)	79.1 (269900)	67.8 (231300)	56.5 (192800)
42(409500)	156.0 (532350)	144.0 (491400)	132.0 (450450)	120.0 (409500)	108.0 (368550)	96.0 (327600)	84.0 (286650)	72.0 (245700)	60.0 (204750)
44(426500)	162.5 (554450)	150.0 (511800)	137.5 (469150)	125.0 (426500)	112.5 (383850)	100.0 (341200)	87.5 (298550)	75.0 (255900)	62.5 (213250)
46(443600)	169.0 (576600)	156.0 (532300)	143.0 (487900)	130.0 (443600)	117.0 (399200)	104.0 (354800)	91.0 (310500)	78.0 (266100)	65.0 (221800)
48(460600)	175.5 (598800)	162.0 (552700)	148.5 (506700)	135.0 (460600)	121.5 (414600)	108.0 (368500)	94.5 (322400)	81.0 (276400)	67.5 (230300)
50(488600)	186.2 (635300)	171.8 (586200)	157.5 (537400)	143.2 (488600)	128.9 (439800)	114.6 (391000)	100.2 (341900)	85.9 (293100)	71.6 (244300)
52(498100)	189.8 (647600)	175.2 (597800)	160.6 (548000)	146.0 (498200)	131.4 (448300)	116.8 (398500)	102.2 (348700)	87.6 (298900)	73.0 (249100)
54(516900)	197.0 (672200)	181.8 (620300)	166.7 (568800)	151.5 (516900)	136.4 (465400)	121.2 (413500)	106.1 (362000)	90.9 (310200)	75.8 (258600)
56(539100)	205.4 (700800)	189.6 (646900)	173.8 (593000)	158.0 (539100)	142.2 (485200)	126.4 (431300)	110.6 (377400)	94.8 (323500)	79.0 (269500)
58(563000)	214.5 (731900)	198.0 (675600)	181.5 (619300)	165.0 (563000)	148.5 (506700)	132.0 (450400)	115.5 (394100)	99.0 (337800)	82.5 (281500)
60(580000)	221.0 (754000)	204.0 (696000)	187.0 (638000)	170.0 (580000)	153.0 (522000)	136.0 (464000)	119.0 (406000)	102.0 (348000)	85.0 (290000)
62(597100)	227.5 (776200)	210.0 (716500)	192.5 (656800)	175.0 (597100)	157.5 (537400)	140.0 (477700)	122.5 (418000)	105.0 (358300)	87.5 (298600)
64(614000)	234.0 (798200)	216.0 (736800)	198.0 (675400)	180.0 (614000)	162.0 (552600)	144.0 (491200)	126.0 (429800)	108.0 (368400)	90.0 (307000)

**INDOOR UNIT CAPACITY INDEX**

Unit Size	Model 18	Model 22	Model 28	Model 36	Model 45	Model 56	Model 71	Model 80	Model 90	Model 112
Capacity Index kW(Btu/h)	1.8 (6140)	2.2 (7500)	2.8 (9550)	3.6 (12280)	4.5 (15350)	5.6 (19110)	7.1 (24230)	8.0 (27300)	9.0 (30710)	11.2 (38220)
Unit Size	Model 125	Model 140	Model 160	Model 200	Model 250	Model 280	Model 400	Model 450	Model 560	
Capacity Index kW(Btu/h)	12.5 (42650)	14.0 (47770)	16 (54590)	20 (68240)	25 (85300)	28 (95540)	40 (136500)	45 (153500)	56 (191070)	

## 1.4 Actual performance date

Use OUTDOOR UNIT CAPACITY TABLES.

Determine correct table according to the outdoor unit model and combination ratio.

Enter the table at given indoor and outdoor temperature and find the outdoor unit capacity and power input.

The individual indoor unit capacity (power input) can be calculated as follows.

$$IUC = OUC \times INX / TNX$$

Where,

**IUC:** Each indoor unit capacity

**OUC:** Outdoors unit capacity

**INX:** Each indoor unit capacity index

**TNX:** Total capacity index


Then, correct the indoor unit capacity according to the piping length.

If the corrected capacity is smaller than the load, the size of indoor unit has to be increased and repeat the same selection procedure.

## 1.5 Cooling capacity modification in accordance with the length of refrigerant pipe

Modification coefficient of the length and high difference of refrigerant pipe:


### 1.5.1 Cooling capacity modification

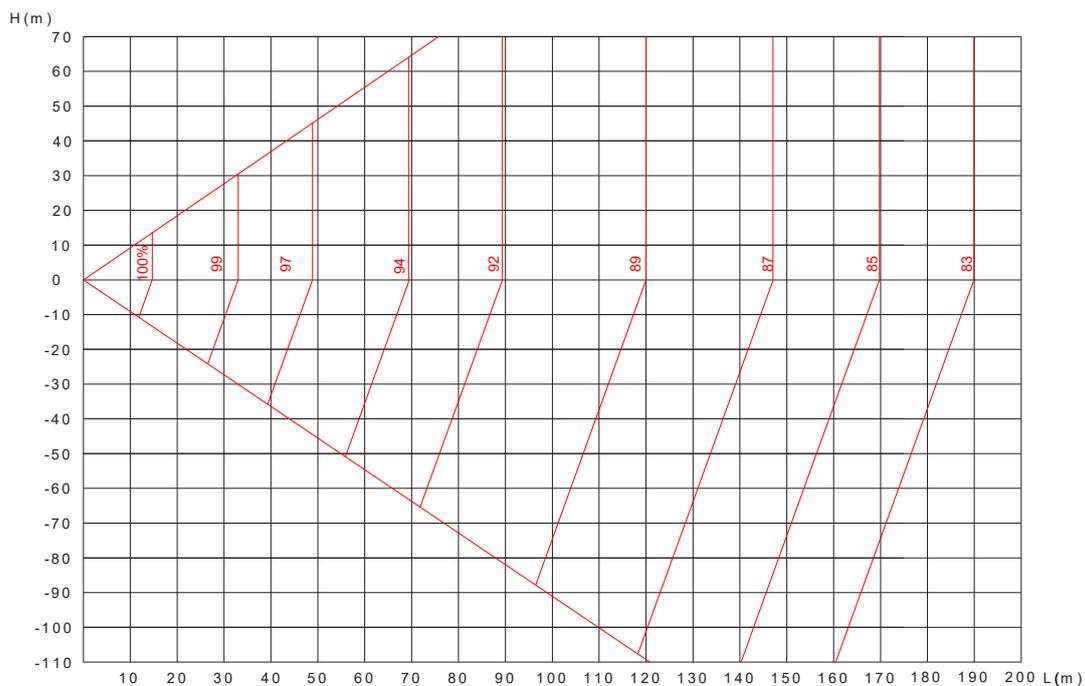

L: Refrigerant pipe equivalent length

H: Height difference between outdoor and indoor unit. Positive data means outdoor unit is top. Negative data means outdoor unit is down.

## 1.5.2 Heating capacity modification

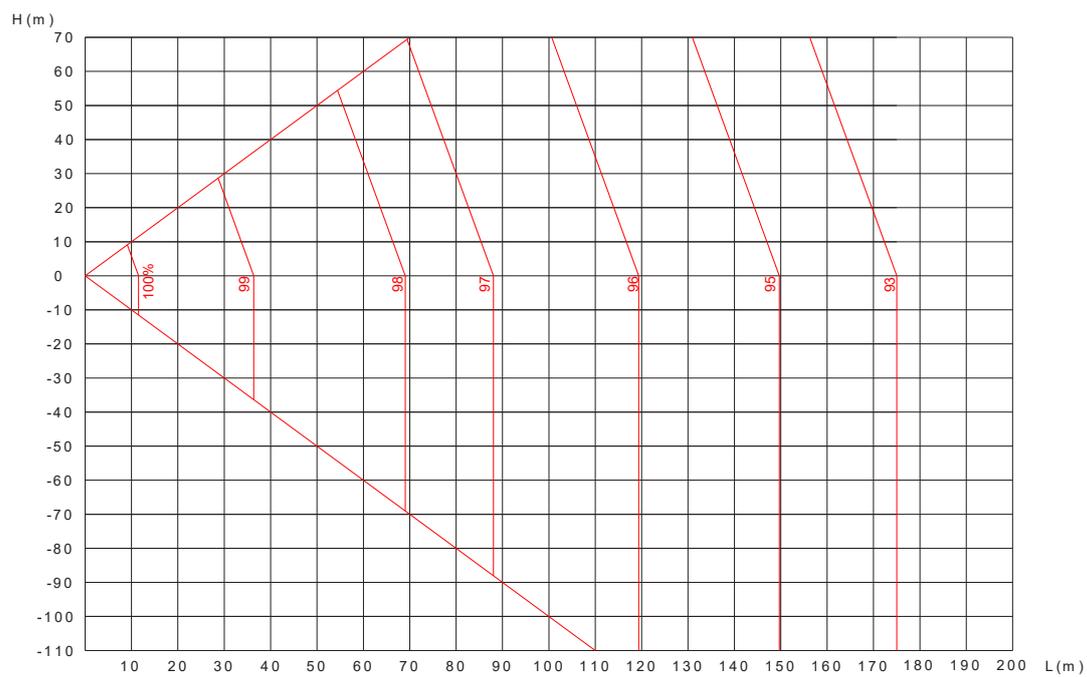

## 2. Unit selection (based on cooling load)

### 2.1 Given condition

Condition:

Cooling: indoor temperature 20°CWB, outdoor temperature 35°CDB;

Cooling load

Location	Room A	Room B	Room C	Room D	Room E	Room F
Load kW(Btu/h)	2.1(7170)	2.8(9559)	3.5(11900)	4.6(15700)	5.8(19790)	7.2(24570)

Power supply: outdoor 380~415V-3Ph-50Hz, indoor 220~240V-1Ph-50Hz.

Piping length: 50m; Height difference between indoor unit and outdoor unit: 30m

### 2.2 Indoor unit selection

Select the suitable capacity for condition of 'Indoor 20°C WB, Outdoor 35°C DB' using indoor unit capacity table. The selected result is as follows. (Assuming the indoor unit type is duct)

Location	Room A	Room B	Room C	Room D	Room E	Room F
Load kW(Btu/h)	2.1(7170)	2.8(9559)	3.5(11900)	4.6(15700)	5.8(19790)	7.2(24570)
Model	22	28	36	45	56	71
Capacity kW(Btu/h)	2.3(7850)	2.9(9900)	3.7(12600)	4.8(16400)	6.0(20500)	7.5(25600)

### 2.3 Outdoor unit selection

1) Assume the indoor unit and outdoor unit combination as follows

- ◆ Calculate the total nominal capacity of indoor units in the combination according to the above table:  
 $2.2 \times 1 + 2.8 \times 1 + 3.6 \times 1 + 4.5 \times 1 + 5.6 \times 1 + 7.1 \times 1 = 25.8\text{kW}(88000\text{Btu/h})$
- ◆ Select outdoor unit: MVUR280B-VA3 which has nominal cooling capacity: 28kW (95500Btu/h).  
 Calculate the proportion:  $25.8/28 = 92\%$

2) Result: Because the proportion is within 50~130%, it is a right selection.

Real function data with indoor unit combination

- ◆ For the 92% combination, calculate the cooling capacity of outdoor unit (MVUR280B-VA3).  
 $26.8\text{kW}(91440\text{Btu/h}) \leftarrow 90\%$  (Indoor temperature: WB 20°C, Outdoor temperature: DB 35°C)  
 $28.3\text{kW}(96560\text{Btu/h}) \leftarrow 100\%$  (Indoor temperature: WB 20°C, Outdoor temperature: DB 35°C)  
 Then calculate the outdoor capacity in 92% combination index:  
 Therefore:  $26.8 + \{(28.3 - 26.8) / 10\} \times 2 = 27.1\text{kW}(92470\text{Btu/h})$ ;

- ◆ Outdoor unit (MVUR280B-VA3) cooling temperature: DB 35°C
- ◆ Capacity modification coefficient with pipe length 50m and height difference 30m: 0.958
- ◆ Each indoor unit cooling capacity

**Room A:** MVM22A-VA1 ( $27.1 \times 22 / 258 \times 0.958 = 2.21\text{kW}$ ) ( $92470 \times 7510 / 88000 \times 0.958 = 7540\text{Btu/h}$ )

**Room B:** MVM28A-VA1 ( $27.1 \times 28 / 258 \times 0.958 = 2.82\text{kW}$ ) ( $92470 \times 9550 / 88000 \times 0.958 = 9620\text{Btu/h}$ )

**Room C:** MVM36A-VA1 ( $27.1 \times 36 / 258 \times 0.958 = 3.62\text{kW}$ ) ( $92470 \times 12300 / 88000 \times 0.958 = 12350\text{Btu/h}$ )

**Room D:** MVM45A-VA1 ( $27.1 \times 45 / 258 \times 0.958 = 4.53\text{kW}$ ) ( $92470 \times 15400 / 88000 \times 0.958 = 15460\text{Btu/h}$ )

**Room E:** MVM56A-VA1 ( $27.1 \times 56 / 258 \times 0.958 = 5.64\text{kW}$ ) ( $92470 \times 19110 / 88000 \times 0.958 = 19250\text{Btu/h}$ )

**Room F:** MVM71A-VA1 ( $27.1 \times 71 / 258 \times 0.958 = 7.14\text{kW}$ ) ( $92470 \times 24200 / 88000 \times 0.958 = 24360\text{Btu/h}$ )

Location	Room A	Room B	Room C	Room D	Room E	Room F
Load kW(Btu/h)	2.1(7170)	2.8(9559)	3.5(11900)	4.6(15700)	5.8(19790)	7.2(24570)
Model	22	28	36	45	56	71
Capacity kW(Btu/h)	2.21(7540)	2.82(9620)	3.62(12350)	4.53(15460)	5.64(19250)	7.14(24360)

## 2.4 Conclusion

Generally, we think this result is acceptable, so we can think we have accomplished the calculation. But if you think this result is not acceptable, you can repeat the above process.

Remark: In this sample, the other capacity modification indexes don't be considered and are assumed as 1.0. For more details about the effect factor such as outside ambient/inside ambient DB/WD, please refer to the performance table of indoor and outdoor units.

# Part 3 Specifications & Performances

<b>1. Specifications .....</b>	<b>25</b>
<b>2. Dimensions .....</b>	<b>46</b>
<b>3. Service space .....</b>	<b>49</b>
<b>4. Piping diagrams .....</b>	<b>51</b>
<b>5. Wiring diagram and field wiring .....</b>	<b>53</b>
<b>6. Electric characteristics .....</b>	<b>56</b>
<b>7. Capacity tables .....</b>	<b>57</b>
<b>8. Operation limits .....</b>	<b>97</b>
<b>9. Sound levels .....</b>	<b>98</b>
<b>10. Accessories .....</b>	<b>99</b>

## 1. Specifications

### 1.1 Outdoor unit specifications

#### Independent unit specifications

Model			MVUR252B-VA3	MVUR280B-VA3	MVUR335B-VA3	
Power supply		V/Ph/Hz	380-415/3/50	380-415/3/50	380-415/3/50	
			380-415/3/60	380-415/3/60	380-415/3/60	
Cooling	Capacity	kW	25.2	28.0	33.5	
		Btu/h	86,000	95,500	114,300	
	Power input	kW	5.73	6.67	8.07	
	EER	kW/kW	4.40	4.20	4.15	
Heating	Capacity	kW	27.0	31.5	37.5	
		Btu/h	92,100	107,500	128,000	
	Power input	kW	6.00	7.33	8.72	
	COP	kW/kW	4.50	4.30	4.30	
DC inverter compressor	Model		E655DHD-65D2YG	E655DHD-65D2YG	E655DHD-65D2YG	
	Type		DC inverter	DC inverter	DC inverter	
	Brand		Hitachi	Hitachi	Hitachi	
	Quantity		1	1	1	
	Capacity	kW	31.59	31.59	31.59	
		Btu/h	107,800	107,800	107,800	
	Crankcase heater		W	30×2	30×2	30×2
	Refrigerant oil type			FVC68D	FVC68D	FVC68D
Refrigerant oil charge		ml	500	500	500	
Outdoor fan motor	Model		WZDK750-38G-4	WZDK750-38G-4	WZDK750-38G-4	
	Type		DC motor	DC motor	DC motor	
	Quantity		2	2	2	
	Brand		Panasonic/Nidec	Panasonic/Nidec	Panasonic/Nidec	
	Insulation class			E	E	E
	Safe class			IP23	IP23	IP23
	Input	W	520	520	520	
	Output	W	420	420	420	
Outdoor fan	Material		Plastic	Plastic	Plastic	
	Type		Axial	Axial	Axial	
	Quantity		2	2	2	
	External static pressure	Pa	0~20 (default)			
		Pa	20~60 (need to customize)			
Outdoor coil	Number of rows		2	2	2	
	Tube pitch(a)×row pitch(b)		in.(mm)	7/8×3/4(22×19)	7/8×3/4(22×19)	7/8×3/4(22×19)
	Fin spacing		in.(mm)	1/16(1.6)	1/16(1.6)	1/16(1.6)
	Fin type			Hydrophilic aluminium	Hydrophilic aluminium	Hydrophilic aluminium
	Tube outside diameter		in.(mm)	Φ5/16(7.94)	Φ5/16(7.94)	Φ5/16(7.94)
	Tube type			inner-groove tube	inner-groove tube	inner-groove tube
	Coil dimension (W×D×H)		in.(mm)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)
	Condenser quantity			2	2	2

	Number of circuits		12	12	12
Outdoor air flow		m <sup>3</sup> /h	12,000	12,000	13,000
		CFM	7,060	7,060	7,650
Sound pressure level		dB(A)	57	57	58
Connectable indoor unit	Total capacity	%	50-130	50-130	50-130
	Max. quantity		13	16	20
Outdoor unit	Net dimension (W×H×D)	mm	1250×1615×765		
	Packing (W×H×D)	mm	1305×1790×820		
	Net weight	kg	255	255	255
	Gross weight	kg	273	273	273
Refrigerant	Type		R410A	R410A	R410A
	Factory charged	kg	10	10	10
Additional refrigerant oil	Oil type		FVC68D	FVC68D	FVC68D
	Oil charge	L	5	5	5
Throttle type			EXV	EXV	EXV
Design pressure (Hi/Lo)		MPa	4.4/2.6	4.4/2.6	4.4/2.6
		PSI	640/380	640/380	640/380
Refrigerant piping	Liquid Pipe	in.(mm)	Φ3/8(9.53)	Φ1/2(12.7)	Φ1/2(12.7)
	Low Pressure Gas Pipe	in.(mm)	Φ7/8(22.2)	Φ7/8(22.2)	Φ1(25.4)
	High Pressure Gas Pipe	in.(mm)	Φ3/4(19.1)	Φ3/4(19.1)	Φ3/4(19.1)
	High Pressure Gas Balance Pipe	in.(mm)	Φ3/4(19.1)	Φ3/4(19.1)	Φ3/4(19.1)
	Oil Balance Pipe	in.(mm)	Φ1/4(6)	Φ1/4(6)	Φ1/4(6)
Ambient temp. range	Cooling	°C	-5~48	-5~48	-5~48
	Heating	°C	-20~24	-20~24	-20~24
	Simultaneous Cooling and Heating	°C	-5~24	-5~24	-5~24

## Notes:

Capacities are based on the following conditions:

Cooling: Indoor temperature 27°C DB/19°C WB; Outdoor temperature 35°C DB/24°C WB.

Heating: Indoor temperature 20°C DB/15°C WB; Outdoor temperature 7°C DB/6°C WB.

Piping length: Interconnecting piping length is 7.5m, level difference is zero.

Connection piping diameter is based on the condition that the total equivalent liquid length is less than 90m. When the total equivalent liquid length is more than 90m, please refer to technical manual to choose the connection piping diameter.

Sound values are measured in a semi-anechoic room, at a position 1m in front of the unit and 1.3m above the floor.

## Independent unit specifications

Model			MVUR400B-VA3	MVUR450B-VA3	
Power supply		V/Ph/Hz	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60	
Cooling	Capacity	kW	40.0	45.0	
		Btu/h	136,500	153,500	
	Power input	kW	11.30	13.24	
	EER	kW/kW	3.54	3.40	
Heating	Capacity	kW	45.0	50.0	
		Btu/h	153,500	170,600	
	Power input	kW	11.19	12.79	
	COP	kW/kW	4.02	3.91	
DC inverter compressor	Model		E655DHD-65D2YG+ E405DHD-36D2YG	E655DHD-65D2YG+ E405DHD-36D2YG	
	Type		DC inverter	DC inverter	
	Brand		Hitachi	Hitachi	
	Quantity		2	2	
	Capacity	kW	31.59+11.8	31.59+11.8	
		Btu/h	107,800+40,300	107,800+40,300	
	Crankcase heater		W	30×4	30×4
	Refrigerant oil type			FVC68D	FVC68D
	Refrigerant oil charge		ml	500+500	500+500
Outdoor fan motor	Model		WZDK750-38G-4	WZDK750-38G-4	
	Type		DC motor	DC motor	
	Quantity		2	2	
	Brand		Panasonic/Nidec	Panasonic/Nidec	
	Insulation class		E	E	
	Safe class		IP23	IP23	
	Input	W	890	890	
	Output	W	710	710	
Outdoor fan	Material		Plastic	Plastic	
	Type		Axial	Axial	
	Quantity		2	2	
	External static pressure	Pa	0~20 (default)		
Pa		20~40 (need to customize)			
Outdoor coil	Number of rows		2	2	
	Tube pitch(a)×row pitch(b)	in.(mm)	7/8×3/4(22×19)	7/8×3/4(22×19)	
	Fin spacing	in.(mm)	1/16(1.6)	1/16(1.6)	
	Fin type		Hydrophilic aluminium	Hydrophilic aluminium	
	Tube outside diameter	in.(mm)	Φ5/16(7.94)	Φ5/16(7.94)	
	Tube type		inner-groove tube	inner-groove tube	
	Coil dimension (W×D×H)	in.(mm)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)	
	Condenser quantity		2	2	
	Number of circuits		12	12	
Outdoor air flow		m <sup>3</sup> /h	15,000	15,000	

		CFM	8,830	8,830
Sound pressure level		dB(A)	60	60
Connectable indoor unit	Total capacity	%	50-130	50-130
	Max. quantity		23	26
Outdoor unit	Net dimension (W×H×D)	mm	1250×1615×765	1250×1615×765
	Packing (W×H×D)	mm	1305×1790×820	1305×1790×820
	Net weight	kg	303	303
	Gross weight	kg	322	322
Refrigerant	Type		R410A	R410A
	Factory charged	kg	13	13
Additional refrigerant oil	Oil type		FVC68D	FVC68D
	Oil charge	L	7	7
Throttle type			EXV	EXV
Design pressure (Hi/Lo)		MPa	4.4/2.6	4.4/2.6
		PSI	640/380	640/380
Refrigerant piping	Liquid Pipe	in.(mm)	Φ5/8(15.9)	Φ5/8(15.9)
	Low Pressure Gas Pipe	in.(mm)	Φ1-1/8(28.6)	Φ1-1/8(28.6)
	High Pressure Gas Pipe	in.(mm)	Φ7/8(22.2)	Φ7/8(22.2)
	High Pressure Gas Balance Pipe	in.(mm)	Φ3/4(19.1)	Φ3/4(19.1)
	Oil Balance Pipe	in.(mm)	Φ1/4(6)	Φ1/4(6)
Ambient temp. range	Cooling	°C	-5~48	-5~48
	Heating	°C	-20~24	-20~24
	Simultaneous Cooling and Heating	°C	-5~24	-5~24

## Notes:

Capacities are based on the following conditions:

Cooling: Indoor temperature 27°C DB/19°C WB; Outdoor temperature 35°C DB/24°C WB.

Heating: Indoor temperature 20°C DB/15°C WB; Outdoor temperature 7°C DB/6°C WB.

Piping length: Interconnecting piping length is 7.5m, level difference is zero.

Connection piping diameter is based on the condition that the total equivalent liquid length is less than 90m. When the total equivalent liquid length is more than 90m, please refer to technical manual to choose the connection piping diameter.

Sound values are measured in a semi-anechoic room, at a position 1m in front of the unit and 1.3m above the floor.

## Combination unit specifications

Model	Combination unit		MVUR532B-VA3	MVUR560B-VA3	MVUR615B-VA3
	Independent unit		MVUR252B-VA3	MVUR280B-VA3	MVUR280B-VA3
			MVUR280B-VA3	MVUR280B-VA3	MVUR335B-VA3
Power supply		V/Ph/Hz	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60
Cooling	Capacity	kW	53.2	56.0	61.5
		Btu/h	181,500	191,000	209,800
	Power input	kW	12.40	13.34	14.74
	EER	kW/kW	4.29	4.20	4.17
Heating	Capacity	kW	58.5	63.0	69.0
		Btu/h	199,600	215,000	235,500
	Power input	kW	13.33	14.66	16.05
	COP	kW/kW	4.39	4.30	4.30
DC inverter compressor	Model		E655DHD-65D2YG	E655DHD-65D2YG	E655DHD-65D2YG
	Type		DC inverter	DC inverter	DC inverter
	Brand		Hitachi	Hitachi	Hitachi
	Quantity		2	2	2
	Capacity	kW	31.59×2	31.59×2	31.59×2
		Btu/h	107800×2	107800×2	107800×2
	Crankcase heater		W	30×4	30×4
	Refrigerant oil type			FVC68D	FVC68D
Refrigerant oil charge		ml	500×2	500×2	
Outdoor fan motor	Model		WZDK750-38G-4	WZDK750-38G-4	WZDK750-38G-4
	Type		DC motor	DC motor	DC motor
	Quantity		2×2	2×2	2×2
	Brand		Panasonic/Nidec	Panasonic/Nidec	Panasonic/Nidec
	Insulation class		E	E	E
	Safe class		IP23	IP23	IP23
	Input	W	520×2	520×2	520×2
	Output	W	420×2	420×2	420×2
Outdoor fan	Material		Plastic	Plastic	Plastic
	Type		Axial	Axial	Axial
	Quantity		2×2	2×2	2×2
Outdoor coil	Tube pitch(a)×row pitch(b)	in.(mm)	7/8×3/4(22×19)	7/8×3/4(22×19)	7/8×3/4(22×19)
	Fin spacing	in.(mm)	1/16(1.6)	1/16(1.6)	1/16(1.6)
	Fin type		Hydrophilic aluminium		
	Tube outside diameter	in.(mm)	Φ5/16(7.94)	Φ5/16(7.94)	Φ5/16(7.94)
	Tube type		inner-groove tube	inner-groove tube	inner-groove tube
	Coil dimension (W×D×H)	in.(mm)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)
Outdoor air flow		m <sup>3</sup> /h	24,000	24,000	25,000
		CFM	14,120	14,120	14,710
Sound pressure level		dB(A)	61	61	62
Connectable indoor unit	Total capacity		%	50-130	50-130
	Max. quantity			29	33

Outdoor unit	Net dimension (W×H×D)	mm	(1250×1615×765)×2		
	Packing (W×H×D)	mm	(1305×1790×820)×2		
	Net weight	kg	255×2	255×2	255×2
	Gross weight	kg	273×2	273×2	273×2
Refrigerant	Type		R410A	R410A	R410A
	Factory charged	kg	10×2	10×2	10×2
Additional refrigerant oil	Oil type		FVC68D	FVC68D	FVC68D
	Oil charge	L	10	10	10
Throttle type			EXV	EXV	EXV
Design pressure (Hi/Lo)		MPa	4.4/2.6	4.4/2.6	4.4/2.6
		PSI	640/380	640/380	640/380
Refrigerant piping	Liquid Pipe	in.(mm)	Φ5/8(15.9)	Φ5/8(15.9)	Φ5/8(15.9)
	Low Pressure Gas Pipe	in.(mm)	Φ1-1/4(31.8)	Φ1-1/4(31.8)	Φ1-1/4(31.8)
	High Pressure Gas Pipe	in.(mm)	Φ1-1/8(28.6)	Φ1-1/8(28.6)	Φ1-1/8(28.6)
	High Pressure Gas Balance Pipe	in.(mm)	Φ3/4(19.1)	Φ3/4(19.1)	Φ3/4(19.1)
	Oil Balance Pipe	in.(mm)	Φ1/4(6)	Φ1/4(6)	Φ1/4(6)
Ambient temp. range	Cooling	°C	-5~48	-5~48	-5~48
	Heating	°C	-20~24	-20~24	-20~24
	Simultaneous Cooling and Heating	°C	-5~24	-5~24	-5~24

## Notes:

Capacities are based on the following conditions:

Cooling: Indoor temperature 27°C DB/19°C WB; Outdoor temperature 35°C DB/24°C WB.

Heating: Indoor temperature 20°C DB/15°C WB; Outdoor temperature 7°C DB/6°C WB.

Piping length: Interconnecting piping length is 7.5m, level difference is zero.

Connection piping diameter is based on the condition that the total equivalent liquid length is less than 90m. When the total equivalent liquid length is more than 90m, please refer to technical manual to choose the connection piping diameter.

Sound values are measured in a semi-anechoic room, at a position 1m in front of the unit and 1.3m above the floor.

## Combination unit specifications

Model	Combination unit		MVUR680B-VA3	MVUR730B-VA3	MVUR800B-VA3
	Independent unit		MVUR280B-VA3	MVUR280B-VA3	MVUR400B-VA3
			MVUR400B-VA3	MVUR450B-VA3	MVUR400B-VA3
Power supply		V/Ph/Hz	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60
Cooling	Capacity	kW	68.0	73.0	80.0
		Btu/h	232,000	249,000	273,000
	Power input	kW	17.97	19.9	22.6
	EER	kW/kW	3.78	3.67	3.54
Heating	Capacity	kW	76.5	81.5	90.0
		Btu/h	261,000	278,100	307,000
	Power input	kW	18.52	20.1	22.4
	COP	kW/kW	4.13	4.05	4.02
DC inverter compressor	Model		E655DHD-65D2YG×2+ E405DHD-36D2YG	E655DHD-65D2YG×2+ E405DHD-36D2YG	(E655DHD-65D2YG+ E405DHD-36D2YG)×2
	Type		DC inverter	DC inverter	DC inverter
	Brand		Hitachi	Hitachi	Hitachi
	Quantity		3	3	4
	Capacity	kW	31.59+(31.59+11.8)	31.59+(31.59+11.8)	(31.59+11.8)×2
		Btu/h	107800+(107800+40300)		(107800+40300)×2
	Crankcase heater	W	30×4	30×6	30×8
	Refrigerant oil type		FVC68D	FVC68D	FVC68D
Refrigerant oil charge		ml	500×3	500×3	500×4
Outdoor fan motor	Model		WZDK750-38G-4	WZDK750-38G-4	WZDK750-38G-4
	Type		DC motor	DC motor	DC motor
	Quantity		2×2	2×2	2×2
	Brand		Panasonic/Nidec	Panasonic/Nidec	Panasonic/Nidec
	Insulation class		E	E	E
	Safe class		IP23	IP23	IP23
	Input	W	520+890	520+890	890×2
	Output	W	420+710	420+710	710×2
Outdoor fan	Material		Plastic	Plastic	Plastic
	Type		Axial	Axial	Axial
	Quantity		2×2	2×2	2×2
Outdoor coil	Tube pitch(a)×row pitch(b)	in.(mm)	7/8×3/4(22×19)	7/8×3/4(22×19)	7/8×3/4(22×19)
	Fin spacing	in.(mm)	1/16(1.6)	1/16(1.6)	1/16(1.6)
	Fin type		Hydrophilic aluminium		
	Tube outside diameter	in.(mm)	Φ5/16(7.94)	Φ5/16(7.94)	Φ5/16(7.94)
	Tube type		inner-groove tube	inner-groove tube	inner-groove tube
	Coil dimension (W×D×H)	in.(mm)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)
Outdoor air flow		m <sup>3</sup> /h	27,000	27,000	30,000
		CFM	15,890	15,890	17,660
Sound pressure level		dB(A)	63	63	64
Connectable	Total capacity	%	50-130	50-130	50-130

indoor unit	Max. quantity		39	43	46
Outdoor unit	Net dimension (W×H×D)	mm	(1250×1615×765)×2		
	Packing (W×H×D)	mm	(1305×1790×820)×2		
	Net weight	kg	255+303	255+303	303×2
	Gross weight	kg	273+322	273+322	322×2
Refrigerant	Type		R410A	R410A	R410A
	Factory charged	kg	10+13	10+13	13×2
Additional refrigerant oil	Oil type		FVC68D	FVC68D	FVC68D
	Oil charge	L	12	12	14
Throttle type			EXV	EXV	EXV
Design pressure (Hi/Lo)		MPa	4.4/2.6	4.4/2.6	4.4/2.6
		PSI	640/380	640/380	640/380
Refrigerant piping	Liquid Pipe	in.(mm)	Φ5/8(15.9)	Φ3/4(19.1)	Φ3/4(19.1)
	Low Pressure Gas Pipe	in.(mm)	Φ1-3/8(34.9)	Φ1-3/8(34.9)	Φ1-3/8(34.9)
	High Pressure Gas Pipe	in.(mm)	Φ1-1/8(28.6)	Φ1-1/8(28.6)	Φ1-1/8(28.6)
	High Pressure Gas Balance Pipe	in.(mm)	Φ3/4(19.1)	Φ3/4(19.1)	Φ3/4(19.1)
	Oil Balance Pipe	in.(mm)	Φ1/4(6)	Φ1/4(6)	Φ1/4(6)
Ambient temp. range	Cooling	°C	-5~48	-5~48	-5~48
	Heating	°C	-20~24	-20~24	-20~24
	Simultaneous Cooling and Heating	°C	-5~24	-5~24	-5~24

## Notes:

Capacities are based on the following conditions:

Cooling: Indoor temperature 27°C DB/19°C WB; Outdoor temperature 35°C DB/24°C WB.

Heating: Indoor temperature 20°C DB/15°C WB; Outdoor temperature 7°C DB/6°C WB.

Piping length: Interconnecting piping length is 7.5m, level difference is zero.

Connection piping diameter is based on the condition that the total equivalent liquid length is less than 90m. When the total equivalent liquid length is more than 90m, please refer to technical manual to choose the connection piping diameter.

Sound values are measured in a semi-anechoic room, at a position 1m in front of the unit and 1.3m above the floor.

## Combination unit specifications

Model	Combination unit		MVUR 850B-VA3	MVUR900B-VA3	MVUR960B-VA3	
	Independent unit		MVUR400B-VA3	MVUR450B-VA3	MVUR280B-VA3	
			MVUR450B-VA3	MVUR450B-VA3	MVUR280B-VA3	
			-	-	MVUR400B-VA3	
Power supply		V/Ph/Hz	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60	
Cooling	Capacity	kW	85.0	90.0	96.0	
		Btu/h	290,000	307,000	327,500	
	Power input	kW	24.54	26.48	24.64	
	EER	kW/kW	3.46	3.40	3.90	
Heating	Capacity	kW	95	100.0	108.0	
		Btu/h	324,100	341,200	368,500	
	Power input	kW	23.98	25.58	25.85	
	COP	kW/kW	3.96	3.91	4.18	
DC inverter compressor	Model		(E655DHD-65D2YG+ E405DHD-36D2YG)×2		E655DHD-65D2YG×3+ E405DHD-36D2YG	
	Type		DC inverter	DC inverter	DC inverter	
	Brand		Hitachi	Hitachi	Hitachi	
	Quantity		4	4	4	
	Capacity	kW	(31.59+11.8)×2	(31.59+11.8)×2	31.59×2+(31.59+11.8)	
		Btu/h	(107800+40300)×2	(107800+40300)×2	107800×2+ (107800+40300)	
	Crankcase heater		W	30×8	30×8	30×8
	Refrigerant oil type			FVC68D	FVC68D	FVC68D
Refrigerant oil charge		ml	500×4	500×4	500×4	
Outdoor fan motor	Model		WZDK750-38G-4	WZDK750-38G-4	WZDK750-38G-4	
	Type		DC motor	DC motor	DC motor	
	Quantity		2×2	2×2	2×3	
	Brand		Panasonic/Nidec	Panasonic/Nidec	Panasonic/Nidec	
	Insulation class		E	E	E	
	Safe class		IP23	IP23	IP23	
	Input	W	890×2	890×2	520×2+890	
	Output	W	710×2	710×2	420×2+710	
Outdoor fan	Material		Plastic	Plastic	Plastic	
	Type		Axial	Axial	Axial	
	Quantity		2×2	2×2	2×3	
Outdoor coil	Tube pitch(a)×row pitch(b)		in.(mm)	7/8×3/4(22×19)	7/8×3/4(22×19)	7/8×3/4(22×19)
	Fin spacing		in.(mm)	1/16(1.6)	1/16(1.6)	1/16(1.6)
	Fin type		Hydrophilic aluminium			
	Tube outside diameter		in.(mm)	Φ5/16(7.94)	Φ5/16(7.94)	Φ5/16(7.94)
	Tube type		inner-groove tube			
	Coil dimension (W×D×H)		in.(mm)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)
Outdoor air flow		m <sup>3</sup> /h	30,000	30,000	39,000	
		CFM	17,660	17,660	22,950	

Sound pressure level		dB(A)	64	64	65
Connectable indoor unit	Total capacity	%	50-130	50-130	50-130
	Max. quantity		50	53	56
Outdoor unit	Net dimension (W×H×D)	mm	(1250×1615×765)×2		(1250×1615×765)×3
	Packing (W×H×D)	mm	(1305×1790×820)×2		(1305×1790×820)×3
	Net weight	kg	303×2	303×2	255×2+303
	Gross weight	kg	322×2	322×2	273×2+322
Refrigerant	Type		R410A	R410A	R410A
	Factory charged	kg	13×2	13×2	10×2+13
Additional refrigerant oil	Oil type		FVC68D	FVC68D	FVC68D
	Oil charge	L	14	14	17
Throttle type			EXV	EXV	EXV
Design pressure (Hi/Lo)		MPa	4.4/2.6	4.4/2.6	4.4/2.6
		PSI	640/380	640/380	640/380
Refrigerant piping	Liquid Pipe	in.(mm)	Φ3/4(19.1)	Φ3/4(19.1)	Φ3/4(19.1)
	Low Pressure Gas Pipe	in.(mm)	Φ1-3/8(34.9)	Φ1-3/8(34.9)	Φ1-5/8(41.3)
	High Pressure Gas Pipe	in.(mm)	Φ1-1/8(28.6)	Φ1-1/8(28.6)	Φ1-3/8(34.9)
	High Pressure Gas Balance Pipe	in.(mm)	Φ3/4(19.1)	Φ3/4(19.1)	Φ3/4(19.1)
	Oil Balance Pipe	in.(mm)	Φ1/4(6)	Φ1/4(6)	Φ1/4(6)
Ambient temp. range	Cooling	°C	-5~48	-5~48	-5~48
	Heating	°C	-20~24	-20~24	-20~24
	Simultaneous Cooling and Heating	°C	-5~24	-5~24	-5~24

## Notes:

Capacities are based on the following conditions:

Cooling: Indoor temperature 27°C DB/19°C WB; Outdoor temperature 35°C DB/24°C WB.

Heating: Indoor temperature 20°C DB/15°C WB; Outdoor temperature 7°C DB/6°C WB.

Piping length: Interconnecting piping length is 7.5m, level difference is zero.

Connection piping diameter is based on the condition that the total equivalent liquid length is less than 90m. When the total equivalent liquid length is more than 90m), please refer to technical manual to choose the connection piping diameter.

Sound values are measured in a semi-anechoic room, at a position 1m in front of the unit and 1.3m above the floor.

## Combination unit specifications

Model	Combination unit		MVUR1010B-VA3	MVUR1065B-VA3	MVUR1130B-VA3
	Independent unit		MVUR280B-VA3	MVUR280B-VA3	MVUR280B-VA3
			MVUR280B-VA3	MVUR335B-VA3	MVUR400B-VA3
			MVUR450B-VA3	MVUR450B-VA3	MVUR450B-VA3
Power supply		V/Ph/Hz	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60
Cooling	Capacity	kW	101.0	106.5	113.0
		Btu/h	344,500	363,300	385,500
	Power input	kW	26.58	27.98	31.21
	EER	kW/kW	3.80	3.81	3.62
Heating	Capacity	kW	113	119	126.5
		Btu/h	385,600	406,100	431,600
	Power input	kW	27.45	28.84	31.31
	COP	kW/kW	4.12	4.13	4.04
DC inverter compressor	Model		E655DHD-65D2YG×3+ E405DHD-36D2YG		E655DHD-65D2YG×3+ E405DHD-36D2YG×2
	Type		DC inverter	DC inverter	DC inverter
	Brand		Hitachi	Hitachi	Hitachi
	Quantity		4	4	5
	Capacity	kW	31.59×2+(31.59+11.8)		31.59+(31.59+11.8)×2
		Btu/h	107800×2+(107800+40300)		107800+ (107800+40300)×2
	Crankcase heater	W	30×8	30×8	30×10
	Refrigerant oil type		FVC68D	FVC68D	FVC68D
	Refrigerant oil charge	ml	500×4	500×4	500×5
Outdoor fan motor	Model		WZDK750-38G-4	WZDK750-38G-4	WZDK750-38G-4
	Type		DC motor	DC motor	DC motor
	Quantity		2×3	2×3	2×3
	Brand		Panasonic/Nidec	Panasonic/Nidec	Panasonic/Nidec
	Insulation class		E	E	E
	Safe class		IP23	IP23	IP23
	Input	W	520×2+890	520×2+890	520+890×2
	Output	W	420×2+710	420×2+710	420+710×2
Outdoor fan	Material		Plastic	Plastic	Plastic
	Type		Axial	Axial	Axial
	Quantity		2×3	2×3	2×3
Outdoor coil	Tube pitch(a)×row pitch(b)	in.(mm)	7/8×3/4(22×19)	7/8×3/4(22×19)	7/8×3/4(22×19)
	Fin spacing	in.(mm)	1/16(1.6)	1/16(1.6)	1/16(1.6)
	Fin type		Hydrophilic aluminium		
	Tube outside diameter	in.(mm)	Φ5/16(7.94)	Φ5/16(7.94)	Φ5/16(7.94)
	Tube type		inner-groove tube	inner-groove tube	inner-groove tube
	Coil dimension (W×D×H)	in.(mm)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)
	Outdoor air flow		m <sup>3</sup> /h	39,000	40,000

		CFM	22,950	23,540	24,720
Sound pressure level		dB(A)	65	65	66
Connectable indoor unit	Total capacity	%	50-130	50-130	50-130
	Max. quantity		59	63	64
Outdoor unit	Net dimension (W×H×D)	mm	(1250×1615×765)×3		
	Packing (W×H×D)	mm	(1305×1790×820)×3		
	Net weight	kg	255×2+303		255+303×2
	Gross weight	kg	273×2+322		273+322×2
Refrigerant	Type		R410A	R410A	R410A
	Factory charged	kg	10×2+13	10×2+13	10+13×2
Additional refrigerant oil	Oil type		FVC68D	FVC68D	FVC68D
	Oil charge	L	17	17	19
Throttle type			EXV	EXV	EXV
Design pressure (Hi/Lo)		MPa	4.4/2.6	4.4/2.6	4.4/2.6
		PSI	640/380	640/380	640/380
Refrigerant piping	Liquid Pipe	in.(mm)	Φ3/4(19.1)	Φ3/4(19.1)	Φ3/4(19.1)
	Low Pressure Gas Pipe	in.(mm)	Φ1-5/8(41.3)	Φ1-5/8(41.3)	Φ1-5/8(41.3)
	High Pressure Gas Pipe	in.(mm)	Φ1-3/8(34.9)	Φ1-3/8(34.9)	Φ1-3/8(34.9)
	High Pressure Gas Balance Pipe	in.(mm)	Φ3/4(19.1)	Φ3/4(19.1)	Φ3/4(19.1)
	Oil Balance Pipe	in.(mm)	Φ1/4(6)	Φ1/4(6)	Φ1/4(6)
Ambient temp. range	Cooling	°C	-5~48	-5~48	-5~48
	Heating	°C	-20~24	-20~24	-20~24
	Simultaneous Cooling and Heating	°C	-5~24	-5~24	-5~24

## Notes:

Capacities are based on the following conditions:

Cooling: Indoor temperature 27°C DB/19°C WB; Outdoor temperature 35°C DB/24°C WB.

Heating: Indoor temperature 20°C DB/15°C WB; Outdoor temperature 7°C DB/6°C WB.

Piping length: Interconnecting piping length is 7.5m, level difference is zero.

Connection piping diameter is based on the condition that the total equivalent liquid length is less than 90m. When the total equivalent liquid length is more than 90m, please refer to technical manual to choose the connection piping diameter.

Sound values are measured in a semi-anechoic room, at a position 1m in front of the unit and 1.3m above the floor.

## Combination unit specifications

Model	Combination unit		MVUR1200B-VA3	MVUR1250B-VA3	MVUR1300B-VA3	
	Independent unit		MVUR400B-VA3	MVUR400B-VA3	MVUR400B-VA3	
			MVUR400B-VA3	MVUR400B-VA3	MVUR450B-VA3	
			MVUR400B-VA3	MVUR450B-VA3	MVUR450B-VA3	
Power supply		V/Ph/Hz	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60	
Cooling	Capacity	kW	120.0	125.0	130.0	
		Btu/h	409,500	426,500	443,500	
	Power input	kW	33.90	35.84	37.78	
	EER	kW/kW	3.54	3.49	3.44	
Heating	Capacity	kW	135.0	140.0	145.0	
		Btu/h	460,500	477,600	494,700	
	Power input	kW	33.57	35.17	36.77	
	COP	kW/kW	4.02	3.98	3.94	
DC inverter compressor	Model		E655DHD-65D2YG×3+ E405DHD-36D2YG×3	E655DHD-65D2YG×3+ E405DHD-36D2YG×3	E655DHD-65D2YG×3+ E405DHD-36D2YG×3	
	Type		DC inverter	DC inverter	DC inverter	
	Brand		Hitachi	Hitachi	Hitachi	
	Quantity		6	6	6	
	Capacity	kW	(31.59+11.8)×3	(31.59+11.8)×3	(31.59+11.8)×3	
		Btu/h	(107800+40300)×3	(107800+40300)×3	(107800+40300)×3	
	Crankcase heater		W	30×12	30×12	30×12
	Refrigerant oil type			FVC68D	FVC68D	FVC68D
Refrigerant oil charge		ml	500×6	500×6	500×6	
Outdoor fan motor	Model		WZDK750-38G-4	WZDK750-38G-4	WZDK750-38G-4	
	Type		DC motor	DC motor	DC motor	
	Quantity		2×3	2×3	2×3	
	Brand		Panasonic/Nidec	Panasonic/Nidec	Panasonic/Nidec	
	Insulation class		E	E	E	
	Safe class		IP23	IP23	IP23	
	Input	W	890×3	890×3	890×3	
	Output	W	710×3	710×3	710×3	
Outdoor fan	Material		Plastic	Plastic	Plastic	
	Type		Axial	Axial	Axial	
	Quantity		2×3	2×3	2×3	
Outdoor coil	Tube pitch(a)×row pitch(b)		in.(mm)	7/8×3/4(22×19)	7/8×3/4(22×19)	7/8×3/4(22×19)
	Fin spacing		in.(mm)	1/16(1.6)	1/16(1.6)	1/16(1.6)
	Fin type			Hydrophilic aluminium	Hydrophilic aluminium	Hydrophilic aluminium
	Tube outside diameter		in.(mm)	Φ5/16(7.94)	Φ5/16(7.94)	Φ5/16(7.94)
	Tube type			inner-groove tube	inner-groove tube	inner-groove tube
	Coil dimension (W×D×H)		in.(mm)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)
Outdoor air flow		m <sup>3</sup> /h	45,000	45,000	45,000	
		CFM	26,490	26,490	26,490	
Sound pressure level		dB(A)	67	67	67	

Connectable indoor unit	Total capacity	%	50-130	50-130	50-130
	Max. quantity		64	64	64
Outdoor unit	Net dimension (W×H×D)	mm	(1250×1615×765)×3		
	Packing (W×H×D)	mm	(1305×1790×820)×3		
	Net weight	kg	303×3	303×3	303×3
	Gross weight	kg	322×3	322×3	322×3
Refrigerant	Type		R410A	R410A	R410A
	Factory charged	kg	13×3	13×3	13×3
Additional refrigerant oil	Oil type		FVC68D	FVC68D	FVC68D
	Oil charge	L	21	21	21
Throttle type			EXV	EXV	EXV
Design pressure (Hi/Lo)		MPa	4.4/2.6	4.4/2.6	4.4/2.6
		PSI	640/380	640/380	640/380
Refrigerant piping	Liquid Pipe	in.(mm)	Φ3/4(19.1)	Φ3/4(19.1)	Φ3/4(19.1)
	Low Pressure Gas Pipe	in.(mm)	Φ1-5/8(41.3)	Φ1-5/8(41.3)	Φ1-5/8(41.3)
	High Pressure Gas Pipe	in.(mm)	Φ1-3/8(34.9)	Φ1-3/8(34.9)	Φ1-3/8(34.9)
	High Pressure Gas Balance Pipe	in.(mm)	Φ3/4(19.1)	Φ3/4(19.1)	Φ3/4(19.1)
	Oil Balance Pipe	in.(mm)	Φ1/4(6)	Φ1/4(6)	Φ1/4(6)
Ambient temp. range	Cooling	°C	-5~48	-5~48	-5~48
	Heating	°C	-20~24	-20~24	-20~24
	Simultaneous Cooling and Heating	°C	-5~24	-5~24	-5~24

## Notes:

Capacities are based on the following conditions:

Cooling: Indoor temperature 27°C DB/19°C WB; Outdoor temperature 35°C DB/24°C WB.

Heating: Indoor temperature 20°C DB/15°C WB; Outdoor temperature 7°C DB/6°C WB.

Piping length: Interconnecting piping length is 7.5m, level difference is zero.

Connection piping diameter is based on the condition that the total equivalent liquid length is less than 90m. When the total equivalent liquid length is more than 90m, please refer to technical manual to choose the connection piping diameter.

Sound values are measured in a semi-anechoic room, at a position 1m in front of the unit and 1.3m above the floor.

## Combination unit specifications

Model	Combination unit		MVUR1350B-VA3	MVUR1432B-VA3	MVUR1460B-VA3
	Independent unit		MVUR450B-VA3	MVUR252B-VA3	MVUR280B-VA3
			MVUR450B-VA3	MVUR280B-VA3	MVUR280B-VA3
			MVUR450B-VA3	MVUR450B-VA3	MVUR450B-VA3
		-	MVUR450B-VA3	MVUR450B-VA3	
Power supply		V/Ph/Hz	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60
Cooling	Capacity	kW	135.0	143.2	146.0
		Btu/h	460,500	488,500	498,000
	Power input	kW	39.72	38.88	39.82
	EER	kW/kW	3.40	3.68	3.67
Heating	Capacity	kW	150	158.5	163.0
		Btu/h	511,800	540,800	556,200
	Power input	kW	38.37	38.91	40.24
COP	kW/kW	3.91	4.07	4.05	
DC inverter compressor	Model		E655DHD-65D2YG×3+ E405DHD-36D2YG×3	E655DHD-65D2YG×4+ E405DHD-36D2YG×2	
	Type		DC inverter	DC inverter	DC inverter
	Brand		Hitachi	Hitachi	Hitachi
	Quantity		6	6	6
	Capacity	kW	(31.59+11.8)×3	31.59×2+(31.59+11.8)×2	
		Btu/h	(107800+40300)×3	107800×2+(107800+40300)×2	
	Crankcase heater	W	30×12	30×12	30×12
	Refrigerant oil type		FVC68D	FVC68D	FVC68D
Refrigerant oil charge	ml	500×6	500×6	500×6	
Outdoor fan motor	Model		WZDK750-38G-4	WZDK750-38G-4	WZDK750-38G-4
	Type		DC motor	DC motor	DC motor
	Quantity		2×3	2×4	2×4
	Brand		Panasonic/Nidec	Panasonic/Nidec	Panasonic/Nidec
	Insulation class		E	E	E
	Safe class		IP23	IP23	IP23
	Input	W	890×3	520×2+890×2	520×2+890×2
	Output	W	710×3	420×2+710×2	420×2+710×2
Outdoor fan	Material		Plastic	Plastic	Plastic
	Type		Axial	Axial	Axial
	Quantity		2×3	2×4	2×4
Outdoor coil	Tube pitch(a)×row pitch(b)	in.(mm)	7/8×3/4(22×19)	7/8×3/4(22×19)	7/8×3/4(22×19)
	Fin spacing	in.(mm)	1/16(1.6)	1/16(1.6)	1/16(1.6)
	Fin type		Hydrophilic aluminium	Hydrophilic aluminium	Hydrophilic aluminium
	Tube outside diameter	in.(mm)	φ5/16(7.94)	φ5/16(7.94)	φ5/16(7.94)
	Tube type		inner-groove tube	inner-groove tube	inner-groove tube
	Coil dimension (W×D×H)	in.(mm)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)
Outdoor air flow		m <sup>3</sup> /h	45,000	54,000	54,000

		CFM	26,490	31,780	31,780
Sound pressure level		dB(A)	67	68	68
Connectable indoor unit	Total capacity	%	50-130	50-130	50-130
	Max. quantity		64	64	64
Outdoor unit	Net dimension (W×H×D)	mm	(1250×1615×765)×3	(1250×1615×765)×4	
	Packing (W×H×D)	mm	(1305×1790×820)×3	(1305×1790×820)×4	
	Net weight	kg	303×3	255×2+303×2	
	Gross weight	kg	322×3	273×2+322×2	
Refrigerant	Type		R410A	R410A	
	Factory charged	kg	13×3	10×2+13×2	
Additional refrigerant oil	Oil type		FVC68D	FVC68D	FVC68D
	Oil charge	L	21	24	24
Throttle type			EXV	EXV	EXV
Design pressure (Hi/Lo)		MPa	4.4/2.6	4.4/2.6	4.4/2.6
		PSI	640/380	640/380	640/380
Refrigerant piping	Liquid Pipe	in.(mm)	Φ3/4(19.1)	Φ7/8(22.2)	Φ7/8(22.2)
	Low Pressure Gas Pipe	in.(mm)	Φ1-5/8(41.3)	Φ1-3/4(44.5)	Φ1-3/4(44.5)
	High Pressure Gas Pipe	in.(mm)	Φ1-3/8(34.9)	Φ1-1/2(38.1)	Φ1-1/2(38.1)
	High Pressure Gas Balance Pipe	in.(mm)	Φ3/4(19.1)	Φ3/4(19.1)	Φ3/4(19.1)
	Oil Balance Pipe	in.(mm)	Φ1/4(6)	Φ1/4(6)	Φ1/4(6)
Ambient temp. range	Cooling	°C	-5~48	-5~48	-5~48
	Heating	°C	-20~24	-20~24	-20~24
	Simultaneous Cooling and Heating	°C	-5~24	-5~24	-5~24

## Notes:

Capacities are based on the following conditions:

Cooling: Indoor temperature 27°C DB/19°C WB; Outdoor temperature 35°C DB/24°C WB.

Heating: Indoor temperature 20°C DB/15°C WB; Outdoor temperature 7°C DB/6°C WB.

Piping length: Interconnecting piping length is 7.5m, level difference is zero.

Connection piping diameter is based on the condition that the total equivalent liquid length is less than 90m. When the total equivalent liquid length is more than 90m, please refer to technical manual to choose the connection piping diameter.

Sound values are measured in a semi-anechoic room, at a position 1m in front of the unit and 1.3m above the floor.

## Combination unit specifications

Model	Combination unit		MVUR1515B-VA3	MVUR1580B-VA3	MVUR1650B-VA3	
	Independent unit		MVUR280B-VA3	MVUR280B-VA3	MVUR400B-VA3	
			MVUR335B-VA3	MVUR400B-VA3	MVUR400B-VA3	
			MVUR450B-VA3	MVUR450B-VA3	MVUR400B-VA3	
			MVUR450B-VA3	MVUR450B-VA3	MVUR450B-VA3	
Power supply		V/Ph/Hz	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60	
Cooling	Capacity	kW	151.5	158.0	165.0	
		Btu/h	516,800	539,000	563,000	
	Power input	kW	41.22	44.45	47.14	
	EER	kW/kW	3.68	3.55	3.50	
Heating	Capacity	kW	169	176.5	185.0	
		Btu/h	576,700	602,200	631,100	
	Power input	kW	41.63	44.10	46.36	
	COP	kW/kW	4.06	4.00	3.99	
DC inverter compressor	Model		E655DHD-65D2YG×4+ E405DHD-36D2YG×2	E655DHD-65D2YG×4+ E405DHD-36D2YG×3	E655DHD-65D2YG×4+ E405DHD-36D2YG×4	
	Type		DC inverter	DC inverter	DC inverter	
	Brand		Hitachi	Hitachi	Hitachi	
	Quantity		6	7	8	
	Capacity	kW	31.59×2+ (31.59+11.8)×2	31.59+(31.59+11.8)×3	(31.59+11.8)×4	
		Btu/h	107800×2+ (107800+40300)×2	107800+ (107800+40300)×3	(107800+40300)×4	
	Crankcase heater		W	30×12	30×14	30×16
	Refrigerant oil type			FVC68D	FVC68D	FVC68D
Refrigerant oil charge		ml	500×6	500×7	500×8	
Outdoor fan motor	Model		WZDK750-38G-4	WZDK750-38G-4	WZDK750-38G-4	
	Type		DC motor	DC motor	DC motor	
	Quantity		2×4	2×4	2×4	
	Brand		Panasonic/Nidec	Panasonic/Nidec	Panasonic/Nidec	
	Insulation class		E	E	E	
	Safe class		IP23	IP23	IP23	
	Input	W	520×2+890×2	520+890×3	890×4	
	Output	W	420×2+710×2	420+710×3	710×4	
Outdoor fan	Material		Plastic	Plastic	Plastic	
	Type		Axial	Axial	Axial	
	Quantity		2×4	2×4	2×4	
Outdoor coil	Tube pitch(a)×row pitch(b)		in.(mm)	7/8×3/4(22×19)	7/8×3/4(22×19)	7/8×3/4(22×19)
	Fin spacing		in.(mm)	1/16(1.6)	1/16(1.6)	1/16(1.6)
	Fin type			Hydrophilic aluminium	Hydrophilic aluminium	Hydrophilic aluminium
	Tube outside diameter		in.(mm)	Φ5/16(7.94)	Φ5/16(7.94)	Φ5/16(7.94)
	Tube type			inner-groove tube	inner-groove tube	inner-groove tube
	Coil dimension (W×D×H)		in.(mm)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)

Outdoor air flow		m <sup>3</sup> /h	55,000	57,000	60,000
		CFM	32,370	33,550	35,320
Sound pressure level		dB(A)	68	68	69
Connectable indoor unit	Total capacity	%	50-130	50-130	50-130
	Max. quantity		64	64	64
Outdoor unit	Net dimension (W×H×D)	inch	(49-7/32×63-9/16×30-1/8)×4		
		mm	(1250×1615×765)×4		
	Packing (W×H×D)	inch	(51-9/16×70-1/2×32-1/2)×4		
		mm	(1305×1790×820)×4		
	Net weight	kg	255×2+303×3	255+303×3	303×4
Gross weight	kg	273×2+322×2	273+322×3	322×4	
Refrigerant	Type		R410A	R410A	R410A
	Factory charged	kg	10×2+13×2	10+13×3	13×4
Additional refrigerant oil	Oil type		FVC68D	FVC68D	FVC68D
	Oil charge	L	24	26	28
Throttle type			EXV	EXV	EXV
Design pressure (Hi/Lo)		MPa	4.4/2.6	4.4/2.6	4.4/2.6
		PSI	640/380	640/380	640/380
Refrigerant piping	Liquid Pipe	in.(mm)	Φ7/8(22.2)	Φ7/8(22.2)	Φ7/8(22.2)
	Low Pressure Gas Pipe	in.(mm)	Φ1-3/4(44.5)	Φ1-3/4(44.5)	Φ1-3/4(44.5)
	High Pressure Gas Pipe	in.(mm)	Φ1-1/2(38.1)	Φ1-1/2(38.1)	Φ1-1/2(38.1)
	High Pressure Gas Balance Pipe	in.(mm)	Φ3/4(19.1)	Φ3/4(19.1)	Φ3/4(19.1)
	Oil Balance Pipe	in.(mm)	Φ1/4(6)	Φ1/4(6)	Φ1/4(6)
Ambient temp. range	Cooling	°C	-5~48	-5~48	-5~48
	Heating	°C	-20~24	-20~24	-20~24
	Simultaneous Cooling and Heating	°C	-5~24	-5~24	-5~24

## Notes:

Capacities are based on the following conditions:

Cooling: Indoor temperature 27°C DB/19°C WB; Outdoor temperature 35°C DB/24°C WB.

Heating: Indoor temperature 20°C DB/15°C WB; Outdoor temperature 7°C DB/6°C WB.

Piping length: Interconnecting piping length is 7.5m, level difference is zero.

Connection piping diameter is based on the condition that the total equivalent liquid length is less than 90m. When the total equivalent liquid length is more than 90m, please refer to technical manual to choose the connection piping diameter.

Sound values are measured in a semi-anechoic room, at a position 1m in front of the unit and 1.3m above the floor.

## Combination unit specifications

Model	Combination unit		MVUR1700B-VA3	MVUR1750B-VA3	MVUR1800B-VA3	
	Independent unit		MVUR400B-VA3	MVUR400B-VA3	MVUR450B-VA3	
			MVUR400B-VA3	MVUR450B-VA3	MVUR450B-VA3	
			MVUR450B-VA3	MVUR450B-VA3	MVUR450B-VA3	
			MVUR450B-VA3	MVUR450B-VA3	MVUR450B-VA3	
Power supply		V/Ph/Hz	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60	380-415/3/50 380-415/3/60	
Cooling	Capacity	kW	170.0	175.0	180.0	
		Btu/h	580,000	597,000	614,000	
	Power input	kW	49.08	51.02	52.96	
	EER	kW/kW	3.46	3.43	3.40	
Heating	Capacity	kW	190.0	195.0	200.0	
		Btu/h	648,200	665,300	682,400	
	Power input	kW	47.96	49.56	51.16	
	COP	kW/kW	3.96	3.93	3.91	
DC inverter compressor	Model		E655DHD-65D2YG×4+ E405DHD-36D2YG×4	E655DHD-65D2YG×4+ E405DHD-36D2YG×4	E655DHD-65D2YG×4+ E405DHD-36D2YG×4	
	Type		DC inverter	DC inverter	DC inverter	
	Brand		Hitachi	Hitachi	Hitachi	
	Quantity		8	8	8	
	Capacity	kW	(31.59+11.8)×4	(31.59+11.8)×4	(31.59+11.8)×4	
		Btu/h	(107800+40300)×4	(107800+40300)×4	(107800+40300)×4	
	Crankcase heater		W	30×16	30×16	30×16
	Refrigerant oil type			FVC68D	FVC68D	FVC68D
Refrigerant oil charge		ml	500×8	500×8	500×8	
Outdoor fan motor	Model		WZDK750-38G-4	WZDK750-38G-4	WZDK750-38G-4	
	Type		DC motor	DC motor	DC motor	
	Quantity		2×4	2×4	2×4	
	Brand		Panasonic/Nidec	Panasonic/Nidec	Panasonic/Nidec	
	Insulation class		E	E	E	
	Safe class		IP23	IP23	IP23	
	Input	W	890×4	890×4	890×4	
	Output	W	710×4	710×4	710×4	
Outdoor fan	Material		Plastic	Plastic	Plastic	
	Type		Axial	Axial	Axial	
	Quantity		2×4	2×4	2×4	
Outdoor coil	Tube pitch(a)×row pitch(b)		in.(mm)	7/8×3/4(22×19)	7/8×3/4(22×19)	
	Fin spacing		in.(mm)	1/16(1.6)	1/16(1.6)	
	Fin type			Hydrophilic aluminium	Hydrophilic aluminium	
	Tube outside diameter		in.(mm)	Φ5/16(7.94)	Φ5/16(7.94)	
	Tube type			inner-groove tube	inner-groove tube	
	Coil dimension (W×D×H)		in.(mm)	42×1-1/2×48-1/2 (1067×38×1232)	42×1-1/2×48-1/2 (1067×38×1232)	
Outdoor air flow		m <sup>3</sup> /h	60,000	60,000	60,000	
		CFM	35,320	35,320	35,320	

Sound pressure level		dB(A)	69	69	69
Connectable indoor unit	Total capacity	%	50-130	50-130	50-130
	Max. quantity		64	64	64
Outdoor unit	Net dimension (W×H×D)	mm	(1250×1615×765)×4		
	Packing (W×H×D)	mm	(1305×1790×820)×4		
	Net weight	kg	303×4	303×4	303×4
	Gross weight	kg	322×4	322×4	322×4
Refrigerant	Type		R410A	R410A	R410A
	Factory charged	kg	13×4	13×4	13×4
Additional refrigerant oil	Oil type		FVC68D	FVC68D	FVC68D
	Oil charge	L	28	28	28
Throttle type			EXV	EXV	EXV
Design pressure (Hi/Lo)		MPa	4.4/2.6	4.4/2.6	4.4/2.6
		PSI	640/380	640/380	640/380
Refrigerant piping	Liquid Pipe	in.(mm)	Φ7/8(22.2)	Φ7/8(22.2)	Φ7/8(22.2)
	Low Pressure Gas Pipe	in.(mm)	Φ1-3/4(44.5)	Φ1-3/4(44.5)	Φ1-3/4(44.5)
	High Pressure Gas Pipe	in.(mm)	Φ1-1/2(38.1)	Φ1-1/2(38.1)	Φ1-1/2(38.1)
	High Pressure Gas Balance Pipe	in.(mm)	Φ3/4(19.1)	Φ3/4(19.1)	Φ3/4(19.1)
	Oil Balance Pipe	in.(mm)	Φ1/4(6)	Φ1/4(6)	Φ1/4(6)
Ambient temp. range	Cooling	°C	-5~48	-5~48	-5~48
	Heating	°C	-20~24	-20~24	-20~24
	Simultaneous Cooling and Heating	°C	-5~24	-5~24	-5~24

## Notes:

Capacities are based on the following conditions:

Cooling: Indoor temperature 27°C DB/19°C WB; Outdoor temperature 35°C DB/24°C WB.

Heating: Indoor temperature 20°C DB/15°C WB; Outdoor temperature 7°C DB/6°C WB.

Piping length: Interconnecting piping length is 7.5m, level difference is zero.

Connection piping diameter is based on the condition that the total equivalent liquid length is less than 90m. When the total equivalent liquid length is more than 90m, please refer to technical manual to choose the connection piping diameter.

Sound values are measured in a semi-anechoic room, at a position 1m in front of the unit and 1.3m above the floor.

## 1.2 MS units specifications

### MS units which can be connected multiple indoor units

Mode			MS02/N1-C	MS04/N1-C	MS06/N1-C
Max. indoor unit groups			2	4	6
Max. number of each group indoor units			4	4	4
Max. number of all downstream indoor units			4×2=8	4×4=16	4×6=24
Max. capacity of each group indoor units			kW	16	16
			kBtu/h	54.6	54.6
Total capacity of all downstream indoor units			kW	≤28	≤45
			kBtu/h	≤95.5	≤153.5
Piping connections	Connect to outdoor unit	Liquid pipe	In.(mm)	Φ1/2(12.7)	Φ5/8(15.9)
		High pressure gas pipe	In.(mm)	Φ3/4(19.1)	Φ7/8(22.2)
		Low pressure gas pipe	In.(mm)	Φ1(25.4)	Φ1-1/4(31.8)
	Connect to indoor unit	Liquid pipe	In.(mm)	Φ3/8(9.53)	Φ3/8(9.53)
		Gas pipe	In.(mm)	Φ5/8(15.9)	Φ5/8(15.9)
Net dimension (W×H×D)			inch	24-3/4×8-7/8×23-5/8	37-13/16×8-7/8×23-5/8
			mm	630×225×600	960×225×600
Packing size (W×H×D)			inch	28-9/16×12-3/4×27	41-1/2×12-3/4×27
			mm	725×325×685	1055×325×685
Net weight			lbs.(kg)	42.9(19.5)	68.2(31)
Gross weight			lbs.(kg)	59.4(27)	88(40)

### MS units which can be connected only one indoor unit


Mode			MS02E/N1-C	MS04E/N1-C
Max. number of all downstream indoor units			1	1
Capacity of indoor unit			kW	20~28
			kBtu/h	68.2~95.5
Piping connections	Connect to outdoor unit	Liquid pipe	In.(mm)	Φ1/2(12.7)
		High pressure gas pipe	In.(mm)	Φ3/4(19.1)
		Low pressure gas pipe	In.(mm)	Φ1(25.4)
	Connect to indoor unit	Liquid pipe	In.(mm)	Φ3/8(9.53)
		Gas pipe	In.(mm)	Φ5/8(15.9)
Net dimension (W×H×D)			inch	24-3/4×8-7/8×23-5/8
			mm	630×225×600
Packing size (W×H×D)			inch	28-9/16×12-3/4×27
			mm	725×325×685
Net weight			lbs.(kg)	42.9(19.5)
Gross weight			lbs.(kg)	59.4(27)

## 2. Dimensions

### 2.1 Overall dimensions


MVUR252B-VA3, MVUR280B-VA3, MVUR335B-VA3, MVUR400B-VA3, MVUR450B-VA3

Unit: in.(mm)

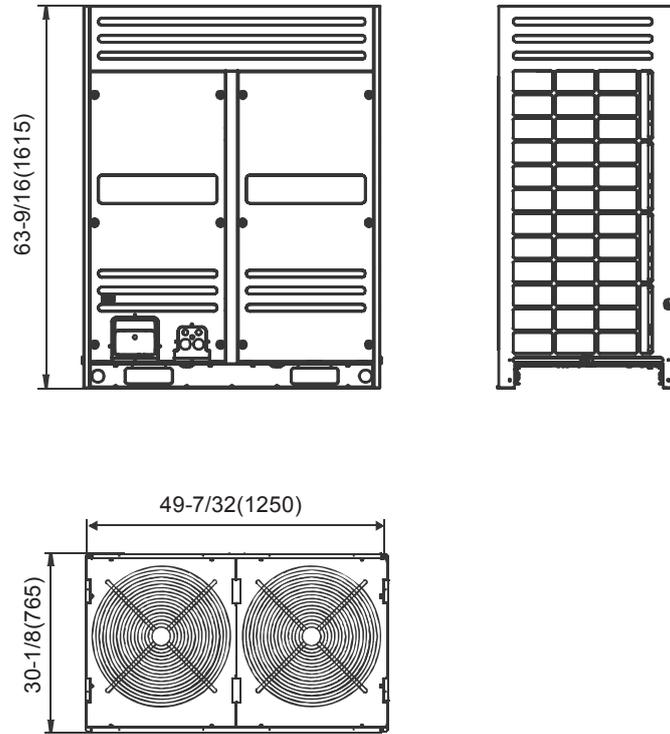


### 2.2 Section dimensions


MVUR252B-VA3, MVUR280B-VA3

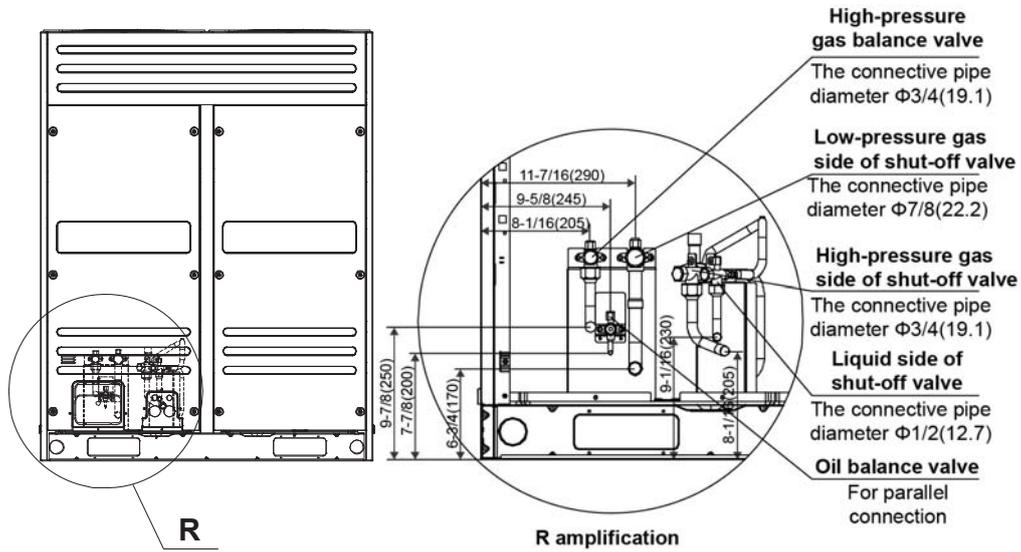

MVUR335B-VA3

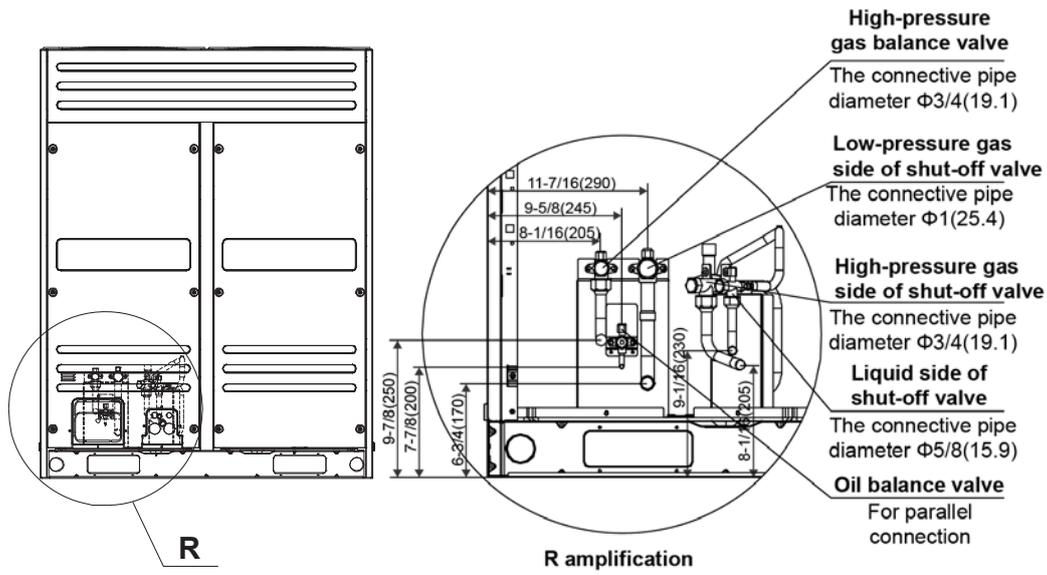


MVUR400B-VA3, MVUR450B-VA3

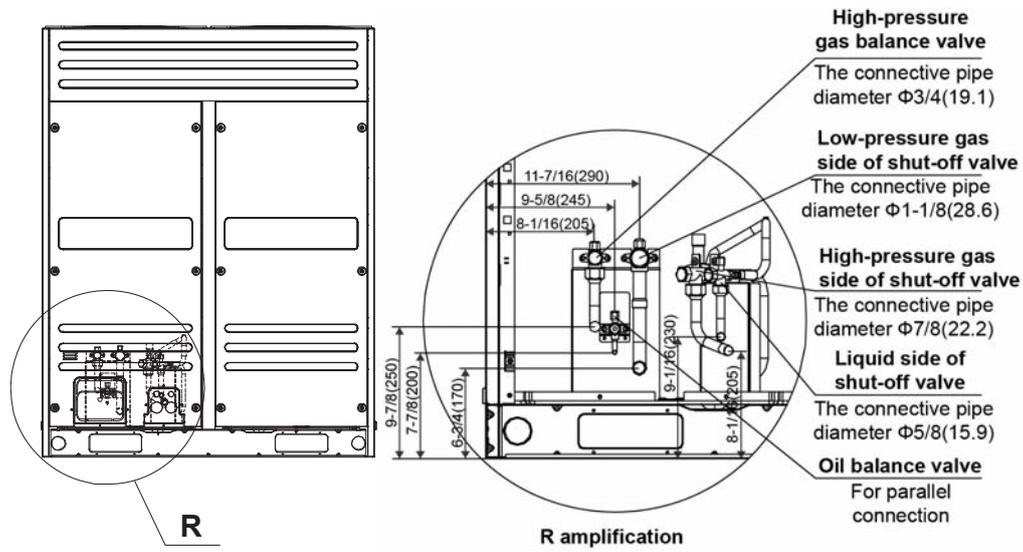

## 2.3 MS dimensions


### 2.3.1 MS body dimensions

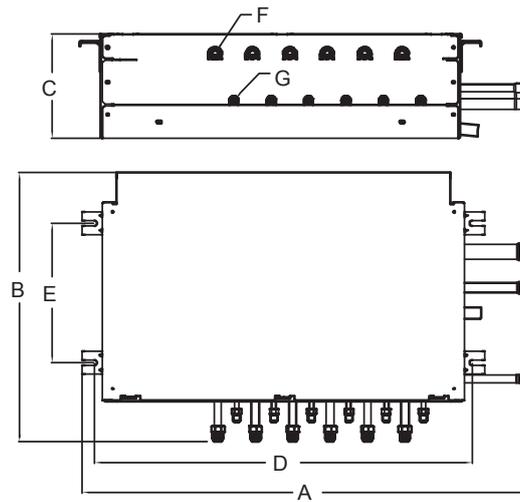

Unit mm

Model	A	B	C	D	E	F	G
MS02/N1-C	630	600	225	490	300	7/8"14UNF-2A	5/8"18UNF-3A
MS04/N1-C	960	600	225	820	300	7/8"14UNF-2A	5/8"18UNF-3A
MS06/N1-C	960	600	225	820	300	7/8"14UNF-2A	5/8"18UNF-3A
MS02E/N1-C	630	600	225	490	300	7/8"14UNF-2A	5/8"18UNF-3A
MS04E/N1-C	960	600	225	820	300	7/8"14UNF-2A	5/8"18UNF-3A

### 2.3.2 MS pipe dimensions

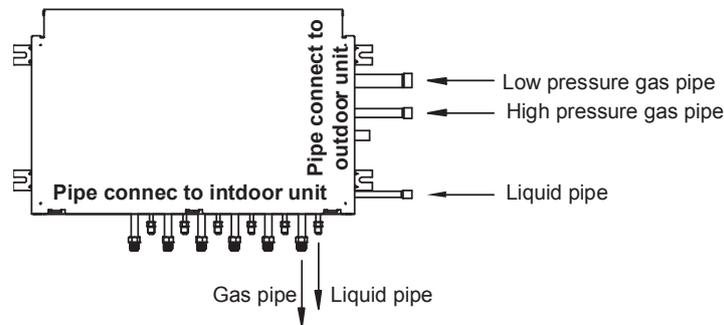

Unit mm


Model	Connect to outdoor unit			Connect to indoor unit	
	Low pressure gas pipe	High pressure pipe	Liquid pipe	Liquid pipe	Gas pipe
MS02/N1-C	Φ25.4	Φ19.1	Φ12.7	Φ9.53	Φ15.9
MS04/N1-C	Φ31.8	Φ22.2	Φ15.9	Φ9.53	Φ15.9
MS06/N1-C	Φ31.8	Φ22.2	Φ15.9	Φ9.53	Φ15.9
MS02E/N1-C	Φ25.4	Φ19.1	Φ12.7	Φ9.53	Φ15.9
MS04E/N1-C	Φ31.8	Φ22.2	Φ15.9	Φ9.53	Φ15.9

### 3. Service space


#### 3.1 Service space for outdoor unit

- Ensure enough space for maintenance. The modules in the same system must be on the same height. When installing the unit, leave enough space for maintenance.

Unit: in.(mm)

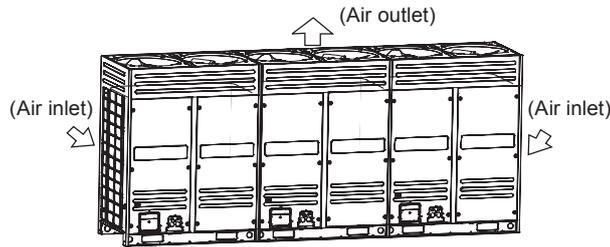

Installation and maintenance surface

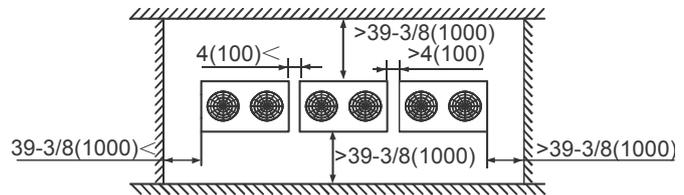


Top view of the outdoor unit


- When the outdoor unit is higher than the surrounding obstacle

Unit: in.(mm)


One row

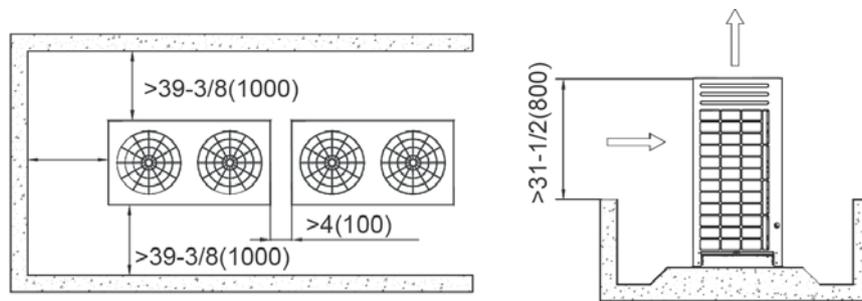

Two rows

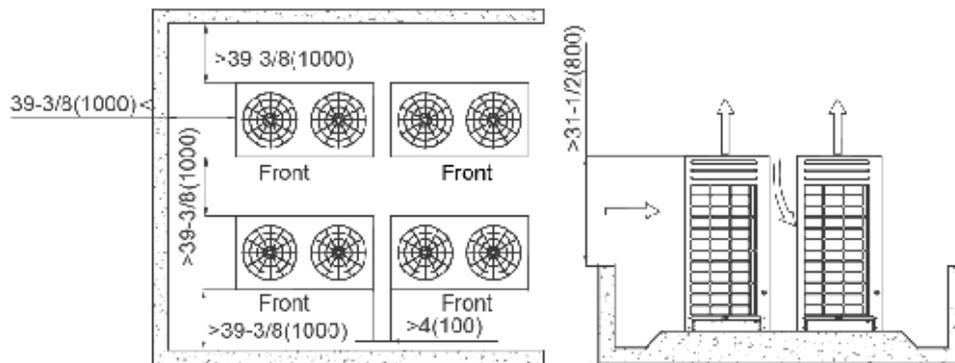


More than two rows

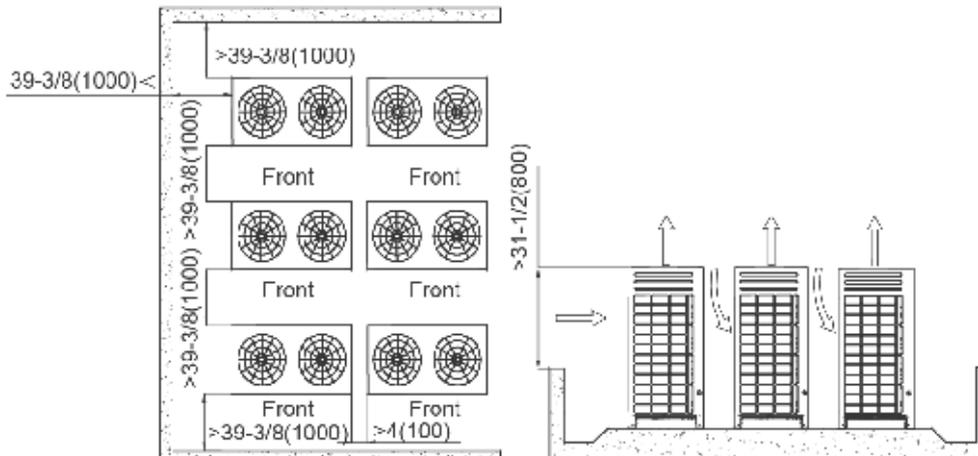


- When the outdoor unit is lower than the surrounding obstacle, to avoid cross connection of the outdoor hot



air from affecting the heat exchange effect, please add an air director onto the exhaust hood of the outdoor unit to facilitate heat dissipation. See the figure below. The height of the air director is HD (namely H-h). Please make the air director on site.

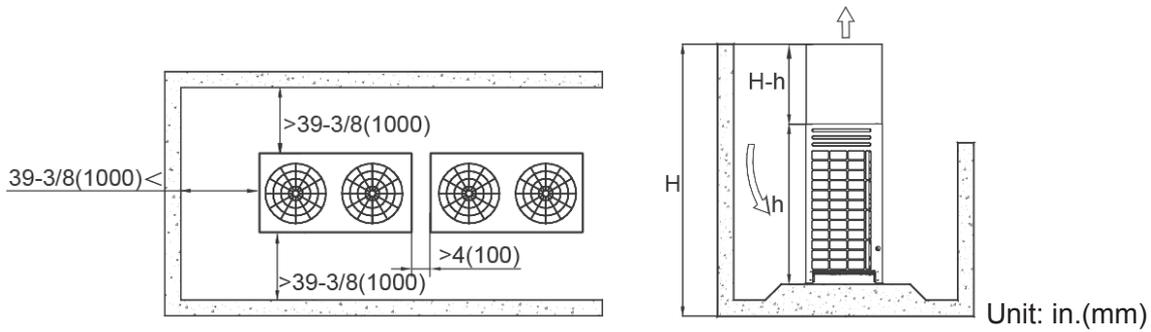

- If miscellaneous articles are piled around the outdoor unit, such articles must be 800mm below the top of the outdoor unit. The articles must be 800m below the top of the outdoor unit. Otherwise, a mechanic exhaust device must be added.

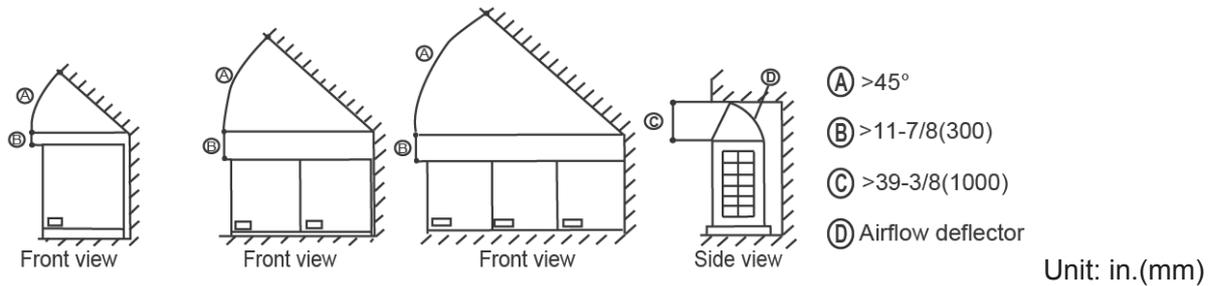


### 3.2 Service space for MS unit

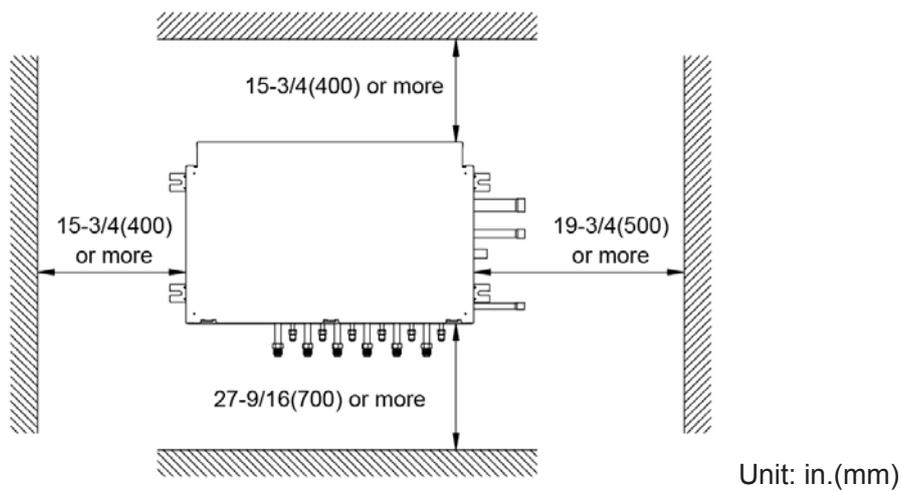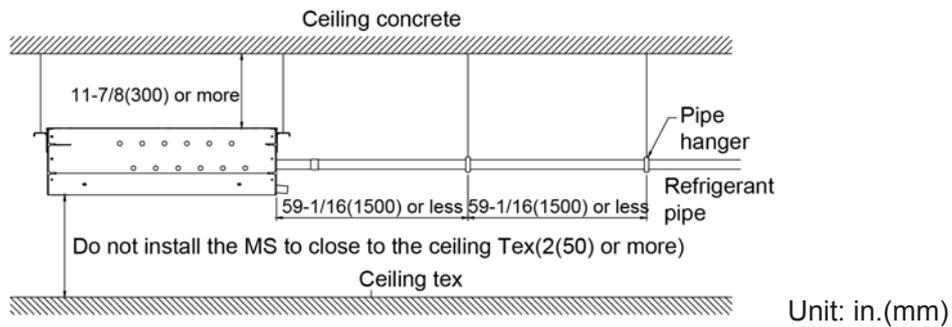


### 4. Piping diagrams

#### MVUR252B-VA3, MVUR280B-VA3, MVUR335B-VA3

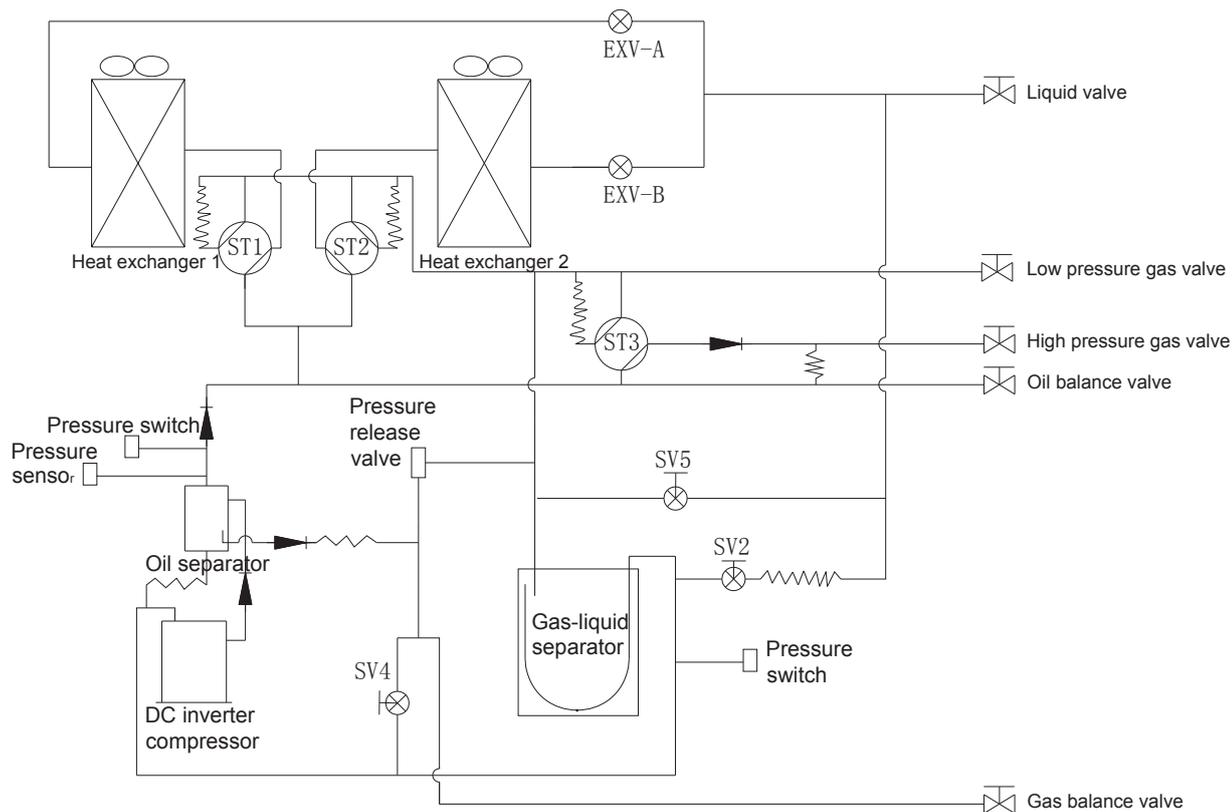

#### MVUR400B-VA3, MVUR450B-VA3

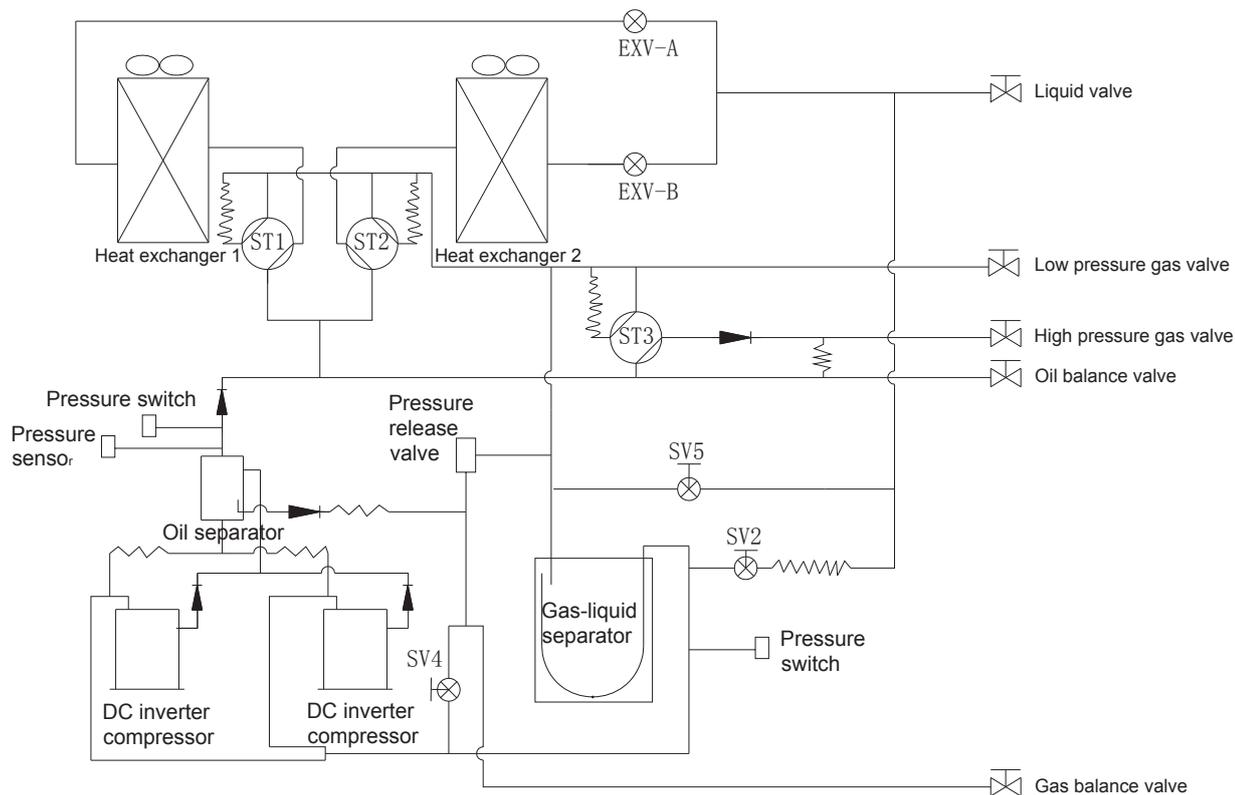

#### Key components:

**Oil separator:** It is used to separate oil from high pressure and high temperature gas refrigerant, which is pumped out from compressor. The separation efficiency is up to 99%, it makes the oil return back to each compressor very soon.

**Gas-liquid separator:** It is used to store the liquid refrigerant and oil; it can protect the compressor from liquid hammer.

**EXV (Electromagnetic Expansion Valve):** It is used to adjust refrigerant volume.

**Four-way valve ST1:** It is used to control the refrigerant flow of the left heat-exchanger. When the ST1 is OFF, the left heat-exchanger is condenser. When the ST1 is ON, the left heat-exchanger is evaporator.

**Four-way valve ST2:** It is used to control the refrigerant flow of the right heat-exchanger. When the ST2 is OFF, the left heat-exchanger is condenser. When the ST1 is ON, the left heat-exchanger is evaporator or closed.

**Four-way valve ST3:** When the system is in total cooling mode, the ST3 is ON. When the system is in total heating mode or mixed mode, the ST3 is OFF.

**SV2:** It is used to protect compressor. When any compressor discharge temperature is higher than 100°C, SV2 will be open to spray a little liquid refrigerant to cooling compressor, and it will be closed when the discharge temperature is lower than 90°C.

**SV4:** It is used to balance the oil between modules.


**SV5:** It is used for quick defrosting. In defrosting mode, the opening of SV5 can cut the refrigerant flowing circle, so the defrosting process will takes less time. In cooling mode, it is always off.

**Pressure switch:** It is used to protect the system pressure. When the system pressure is too high or too low, the pressure switch will open. Once the pressure switch is open, the compressor will stop, and the compressor will restart after ten minutes.


## 5. Wiring diagram and field wiring

### 5.1 Wiring diagram

MVUR252B-VA3, MVUR280B-VA3, MVUR335B-VA3

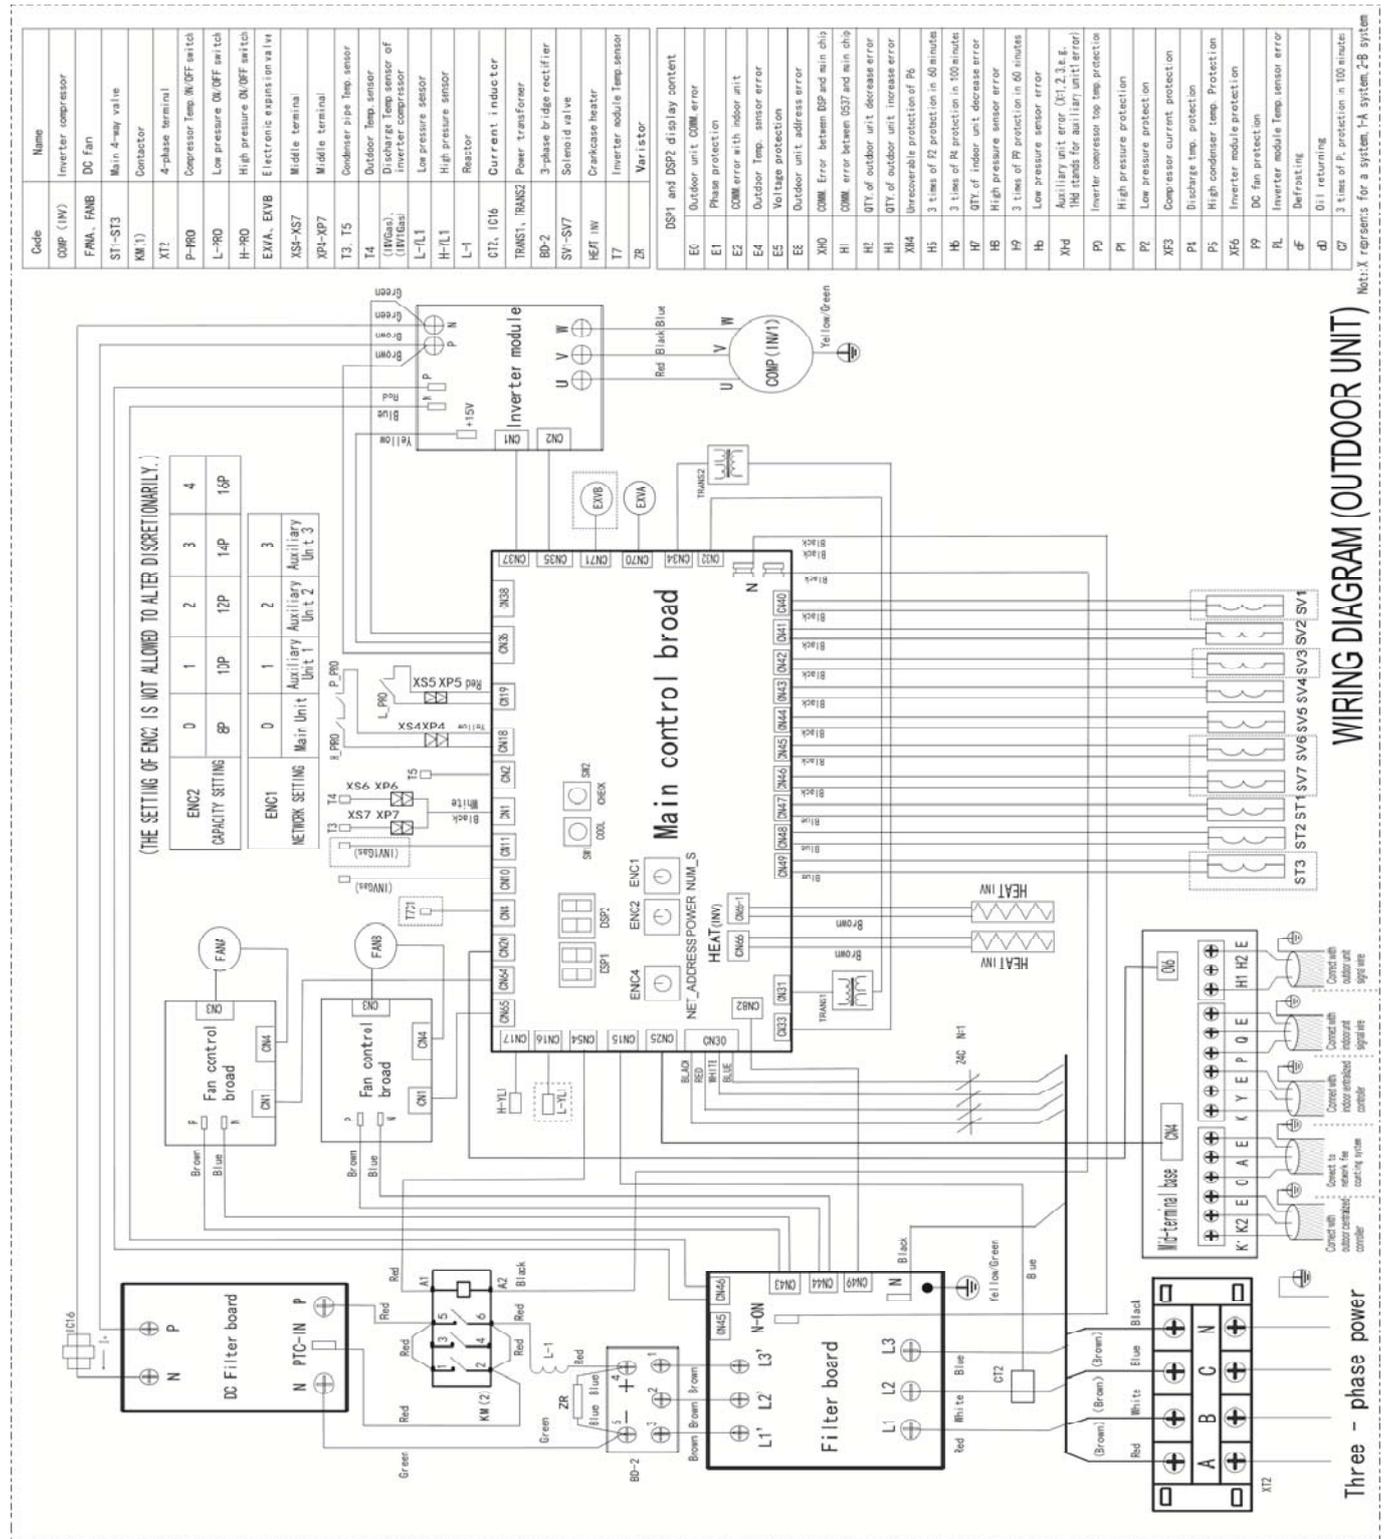


MVUR400B-VA3, MVUR450B-VA3

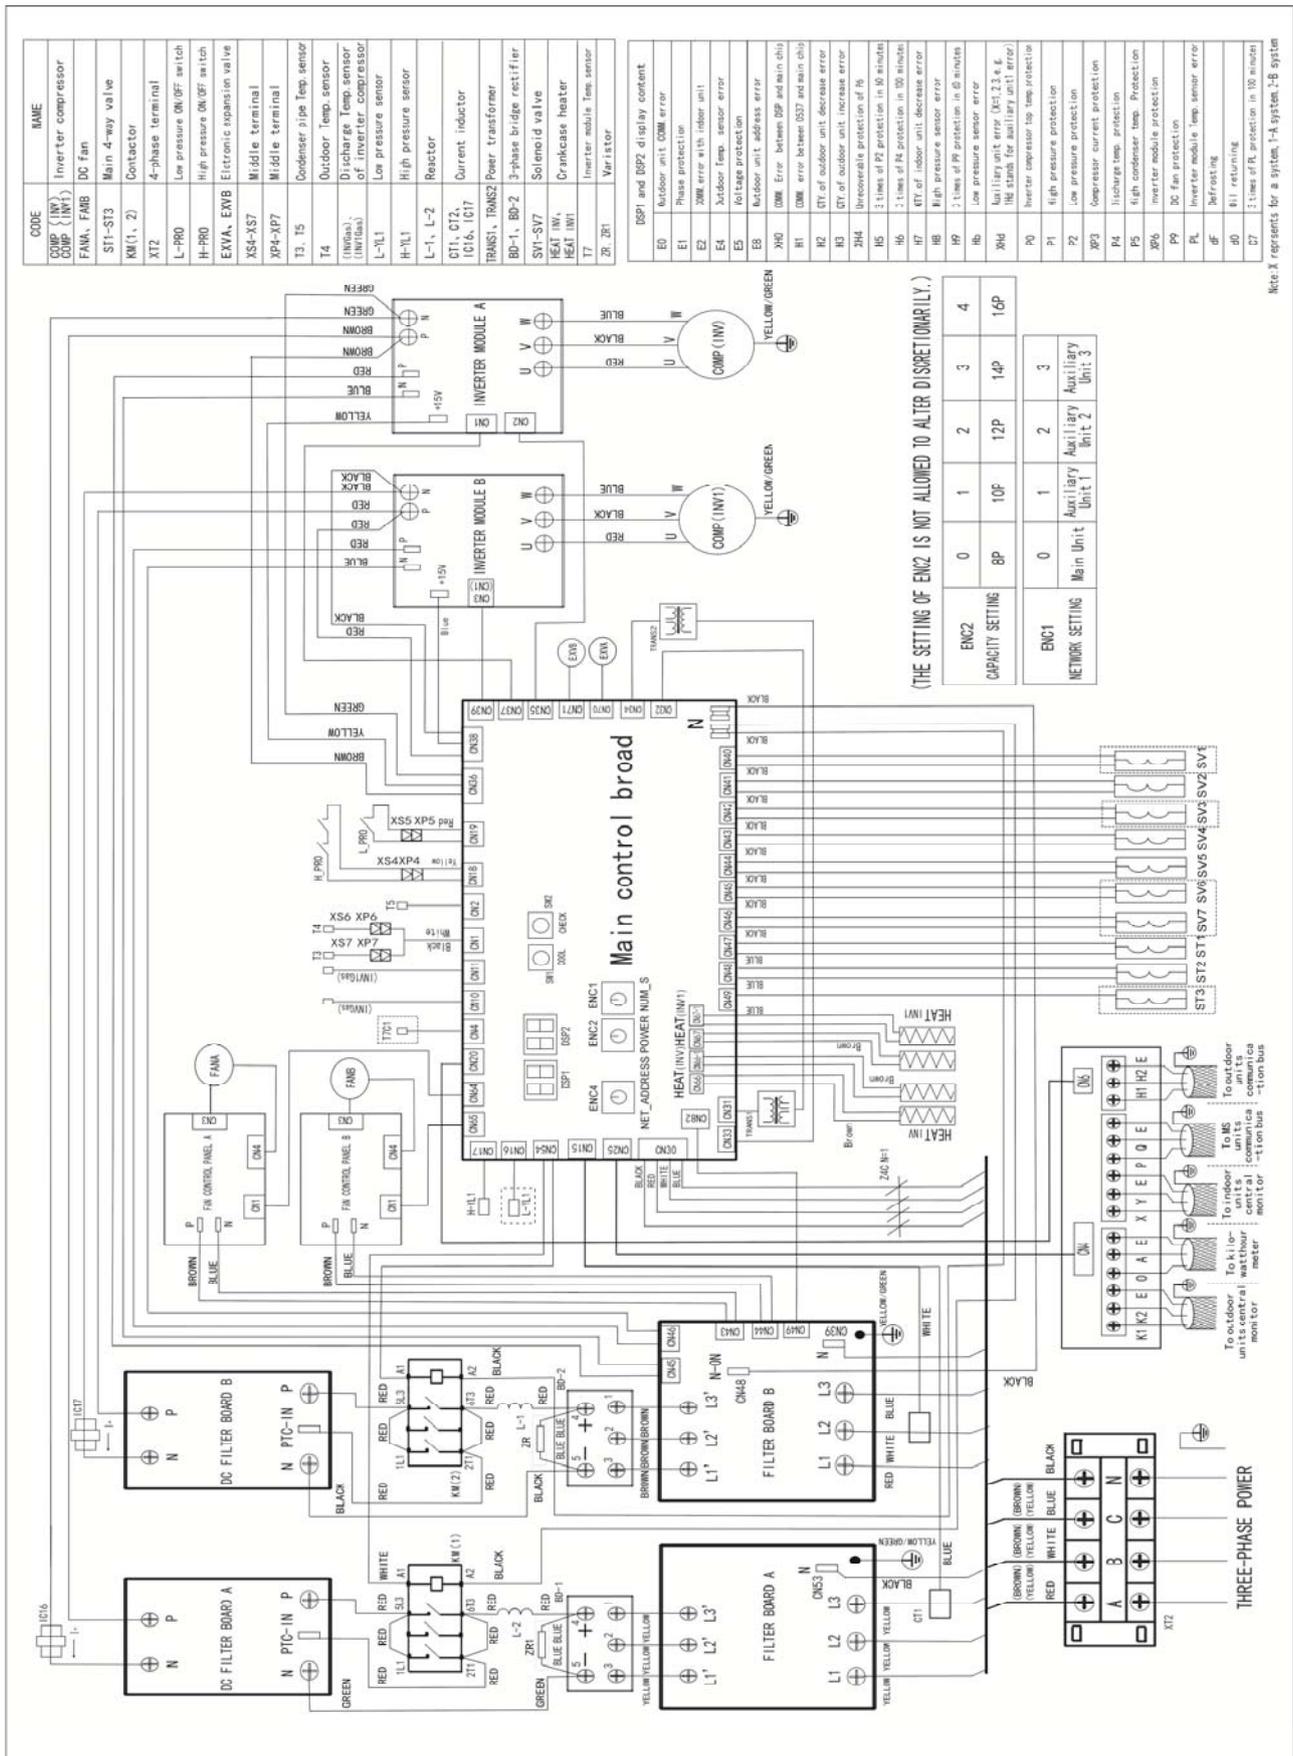


## 5.2 Field wiring

### 5.2.1 Signal wire between outdoor unit and indoor unit

Signal wire of indoor/outdoor unit adopts 3-core shielded wire (0.75mm<sup>2</sup>) which has polarity, please connect it correctly.

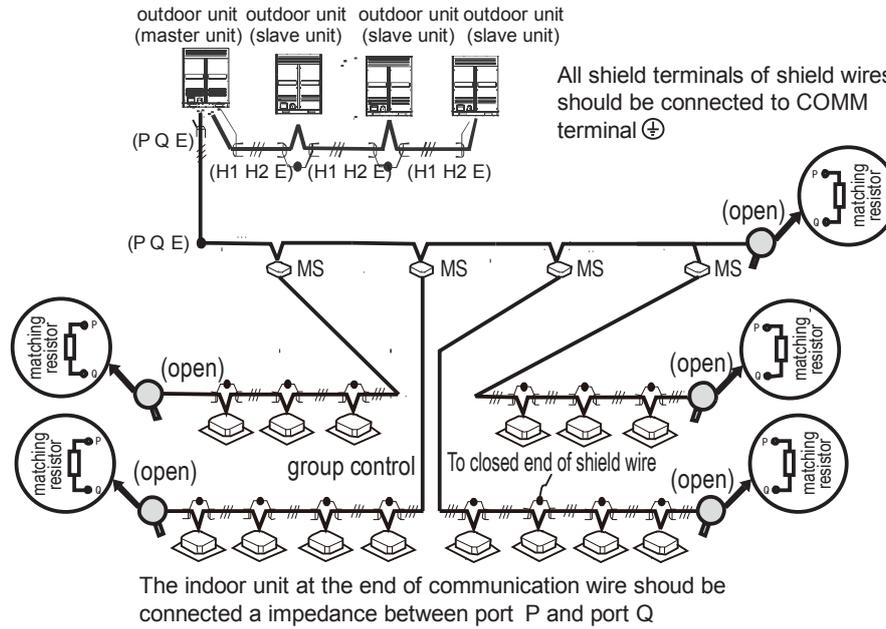

### 5.2.2 Example wiring connection

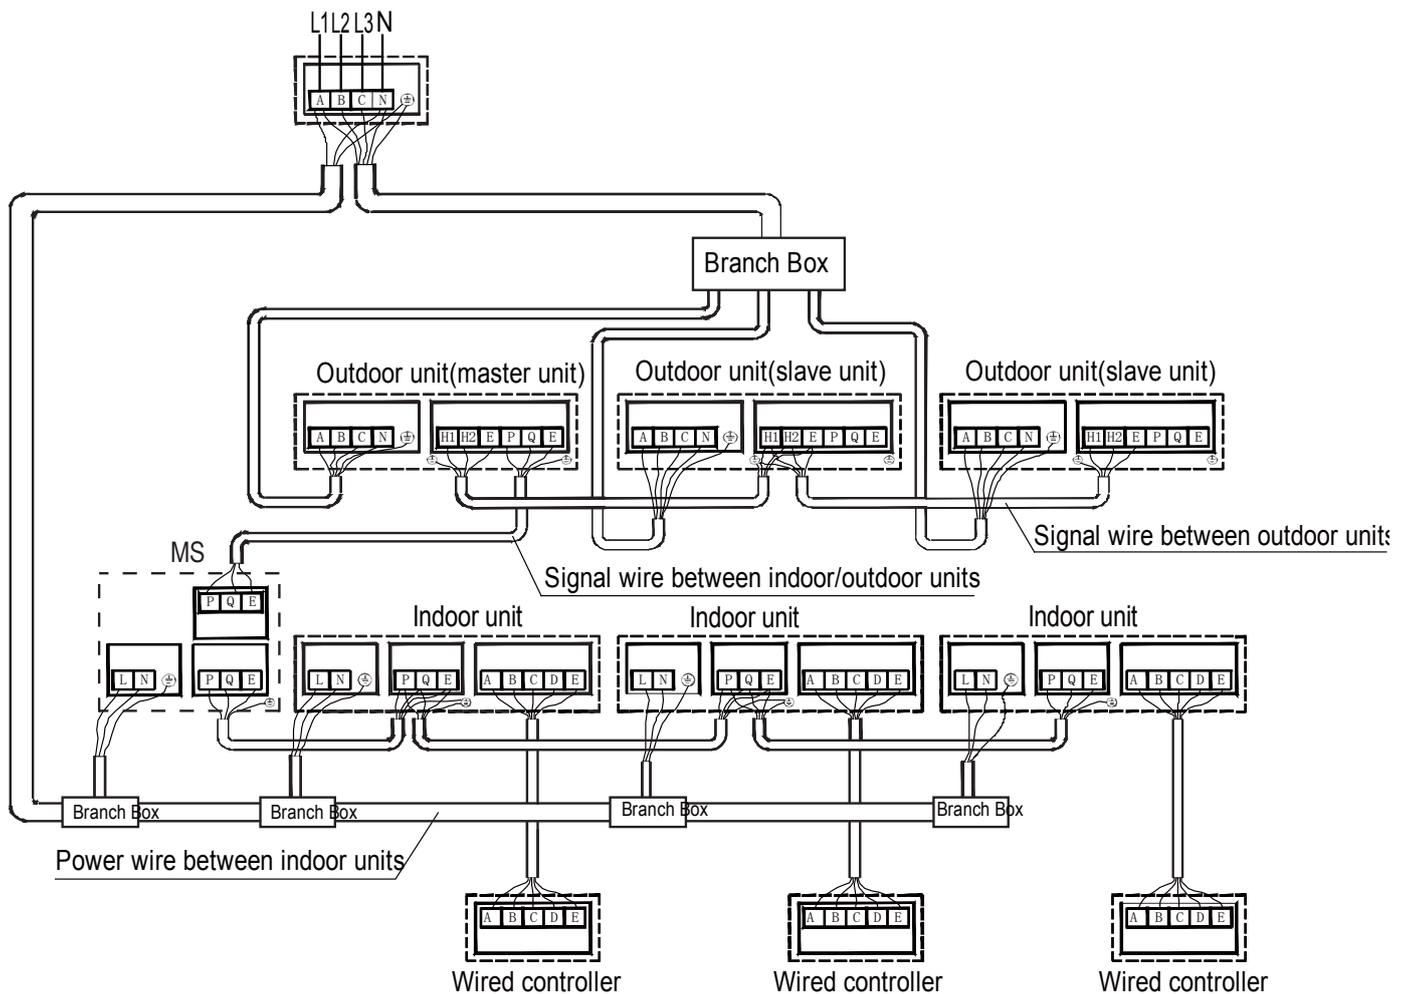

## 6. Electric characteristics

Model	Units				Power supply			Compressor		OFM	
	Hz	Voltage (V)	Min. (V)	Max. (V)	MCA (A)	TOCA (A)	MFA (A)	MSC (A)	RLA (A)	kW	FLA (A)
MVUR252B-VA3	50/ 60	380~415	342	440	18.4	20.8	25	-	17.4	0.42	3.6
MVUR280B-VA3	50/ 60	380~415	342	440	20.6	22.1	25	-	17.4	0.42	3.6
MVUR335B-VA3	50/ 60	380~415	342	440	21.8	22.8	25	-	17.4	0.42	3.6
MVUR400B-VA3	50/ 60	380~415	342	440	27.9	31.8	35	-	17.4+ 10.5	0.71	5.9
MVUR450B-VA3	50/ 60	380~415	342	440	33.4	32.8	35	-	17.4+ 10.5	0.71	5.9

The current value of combination unit is the total value of each basic model (refer to Units Combination Table in Part1)

For example: 46HP=16HP+16HP+14HP

Power current: MCA=33.4+33.4+27.9=94.7

TOCA=32.8+32.8+31.8=97.4

MFA=35+35+35=105

Compressor: RLA=(17.4+10.5)+ (17.4+10.5)+ (17.4+10.5)=83.7

OFM: FLA=5.9+5.9+5.9=17.7

### Notes:

1. RLA is based on the following conditions, Indoor temp. 27°C DB/19°C WB, Outdoor temp. 35°C DB
2. TOCA means the total value of each OC set.
3. MSC means the Max. current during the starting of compressor.
4. Voltage range.

Units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed range limits.

5. Maximum allowable voltage variation between phases is 2%
6. Selection wire size based on the larger value of MCA or TOCA
7. MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth circuit breaker).

**MCA:** Min. Circuit Amps. (A)

**TOCA:** Total Over-current Amps. (A)

**MFA:** Max. Fuse Amps. (A)

**MSC:** Max. Starting Amps. (A)

**RLA:** Rated Load Amps. (A)

**OFM:** Outdoor Fan Motor.

**FLA:** Full Load Amps. (A)

**KW:** Rated Motor Output (KW)

## 7. Capacity tables

### 7.1 Cooling capacity tables

MVUR252B-VA3

TC: Total Capacity (kW); PI: Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature(°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	
130%	-5	22.14	2.34	26.37	2.86	30.60	3.06	31.77	3.19	33.30	3.28	34.11	3.57	34.97	3.59
	-2	22.14	2.34	26.37	2.91	30.60	3.06	31.77	3.21	33.30	3.28	34.11	3.61	34.97	3.62
	0	22.14	2.38	26.37	2.96	30.60	3.18	31.77	3.38	33.30	3.47	34.11	3.66	34.97	3.67
	2	22.14	2.43	26.37	2.97	30.60	3.29	31.77	3.57	33.30	3.51	34.11	3.68	34.97	3.73
	4	22.14	2.48	26.37	3.03	30.60	3.40	31.77	3.59	33.30	3.56	34.11	3.68	34.97	3.80
	6	22.14	2.53	26.37	3.09	30.60	3.52	31.77	3.62	32.93	3.67	33.69	3.68	34.58	3.83
	8	22.14	2.59	26.37	3.16	30.60	3.70	31.77	3.80	32.52	3.79	33.33	3.90	34.14	3.86
	10	22.14	2.64	26.37	3.23	30.60	3.84	31.77	3.92	32.13	4.04	32.94	4.06	33.75	3.98
	12	22.14	2.69	26.37	3.29	30.60	3.92	31.32	4.03	31.77	4.06	32.49	4.07	33.30	4.00
	14	22.14	2.74	26.37	3.35	30.51	4.05	30.96	4.06	31.32	4.08	32.13	4.09	32.94	4.09
	16	22.14	2.79	26.37	3.42	30.15	4.06	30.51	4.08	30.87	4.10	31.68	4.12	32.49	4.16
	18	22.14	2.84	26.37	3.49	29.70	4.09	30.06	4.12	30.51	4.14	31.32	4.18	32.13	4.22
	20	22.14	2.90	26.37	3.71	29.25	4.29	29.70	4.32	30.06	4.34	30.87	4.38	31.68	4.43
	21	22.14	2.98	26.37	3.85	29.07	4.39	29.52	4.42	29.88	4.44	30.69	4.49	31.50	4.53
	23	22.14	3.20	26.37	4.12	28.71	4.60	29.07	4.62	29.43	4.64	30.24	4.69	31.05	4.73
	25	22.14	3.41	26.37	4.42	28.26	4.80	28.62	4.82	29.07	4.85	29.88	4.90	30.69	4.94
	27	22.14	3.65	26.37	4.73	27.90	5.00	28.26	5.03	28.62	5.05	29.43	5.11	30.24	5.16
	29	22.14	3.89	26.37	5.05	27.45	5.20	27.81	5.23	28.26	5.26	29.07	5.31	29.88	5.37
	31	22.14	4.15	26.28	5.34	27.00	5.41	27.45	5.44	27.81	5.46	28.62	5.52	29.43	5.58
	33	22.14	4.43	25.83	5.55	26.64	5.61	27.00	5.64	27.45	5.67	28.26	5.73	28.98	5.79
35	22.14	4.72	25.38	5.75	26.19	5.82	26.64	5.85	27.00	5.88	27.81	5.95	28.62	6.01	
37	22.14	5.02	25.02	5.95	25.83	6.02	26.19	6.06	26.64	6.09	27.36	6.16	28.17	6.23	
39	22.14	5.34	24.57	6.02	25.38	6.22	25.83	6.26	26.19	6.30	27.00	6.37	27.81	6.45	
41	22.14	5.62	24.32	6.07	25.11	6.28	25.56	6.32	25.92	6.36	26.73	6.38	26.74	6.51	
43	22.14	5.77	24.14	6.10	24.98	6.30	25.43	6.35	25.66	6.37	26.25	6.40	26.42	6.52	
45	22.14	6.05	23.99	6.16	24.71	6.36	25.16	6.39	25.28	6.40	25.53	6.42	25.91	6.64	
48	22.14	6.27	24.84	6.36	26.94	6.42	27.44	6.45	27.66	6.47	27.54	6.53	28.04	6.55	
120%	-5	20.43	2.26	24.30	2.74	28.26	3.24	30.24	3.53	31.68	3.68	32.40	3.80	33.12	3.90
	-2	20.43	2.28	24.30	2.77	28.26	3.27	30.24	3.55	31.68	3.73	32.40	3.83	33.12	3.92
	0	20.43	2.31	24.30	2.79	28.26	3.31	30.24	3.56	31.68	3.76	32.40	3.86	33.12	3.92
	2	20.43	2.31	24.30	2.82	28.26	3.33	30.24	3.60	31.68	3.77	32.40	3.88	33.12	3.93
	4	20.43	2.33	24.30	2.85	28.26	3.38	30.24	3.63	31.68	3.83	32.40	3.89	33.12	3.94
	6	20.43	2.36	24.30	2.87	28.26	3.42	30.24	3.67	31.68	3.87	32.40	3.92	33.12	3.95
	8	20.43	2.38	24.30	2.90	28.26	3.47	30.24	3.72	31.68	3.91	32.40	3.94	33.12	3.97
	10	20.43	2.41	24.30	2.94	28.26	3.50	30.24	3.78	31.68	3.91	32.40	3.95	33.12	3.99
	12	20.43	2.46	24.30	3.00	28.26	3.57	30.24	3.85	31.23	3.92	31.95	3.93	32.67	4.02
	14	20.43	2.50	24.30	3.06	28.26	3.64	30.24	3.93	30.78	3.95	31.59	3.99	32.31	4.07
	16	20.43	2.55	24.30	3.12	28.26	3.71	30.06	4.10	30.42	4.01	31.14	4.05	31.86	4.13
	18	20.43	2.59	24.30	3.18	28.26	3.83	29.61	4.09	29.97	4.11	30.69	4.15	31.50	4.19
	20	20.43	2.65	24.30	3.30	28.26	4.12	29.25	4.29	29.61	4.31	30.33	4.35	31.05	4.39
	21	20.43	2.67	24.30	3.42	28.26	4.27	28.98	4.39	29.34	4.41	30.15	4.45	30.87	4.49
	23	20.43	2.86	24.30	3.67	28.26	4.57	28.62	4.59	28.98	4.61	29.70	4.66	30.42	4.70
	25	20.43	3.05	24.30	3.92	27.81	4.77	28.17	4.79	28.53	4.81	29.34	4.86	30.06	4.90
	27	20.43	3.26	24.30	4.19	27.45	4.97	27.81	5.00	28.17	5.02	28.89	5.07	29.61	5.11
	29	20.43	3.48	24.30	4.48	27.00	5.17	27.36	5.20	27.72	5.22	28.44	5.27	29.25	5.32
	31	20.43	3.71	24.30	4.78	26.55	5.37	27.00	5.40	27.36	5.43	28.08	5.48	28.80	5.54
	33	20.43	3.95	24.30	5.10	26.19	5.58	26.55	5.61	26.91	5.63	27.63	5.69	28.35	5.75
35	20.43	4.20	24.30	5.44	25.74	5.78	26.10	5.81	26.55	5.84	27.27	5.90	27.99	5.96	
37	20.43	4.47	24.30	5.79	25.38	5.99	25.74	6.02	26.10	6.05	26.82	6.11	27.54	6.18	
39	20.43	4.76	24.21	6.12	24.93	6.19	25.29	6.22	25.65	6.26	26.46	6.32	27.18	6.39	
41	20.43	4.89	24.01	6.16	24.73	6.23	25.09	6.27	25.45	6.30	26.26	6.34	26.40	6.43	
43	20.43	4.96	23.89	6.20	24.54	6.27	24.90	6.29	25.26	6.32	25.81	6.36	25.99	6.56	
45	20.43	5.02	23.76	6.26	24.30	6.33	24.64	6.35	25.04	6.37	25.29	6.38	25.73	6.71	
48	20.43	5.06	27.29	6.33	27.80	6.38	28.09	6.40	28.69	6.42	28.84	6.40	29.42	6.79	

**Cooling capacity table**

MVUR252B-VA3

**TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature(°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
110%	-5	18.72	1.98	22.32	2.46	25.92	2.93	27.72	3.15	29.52	3.39	31.77	3.52	32.49	3.63
	-2	18.72	2.01	22.32	2.49	25.92	2.96	27.72	3.18	29.52	3.42	31.77	3.55	32.49	3.65
	0	18.72	2.03	22.32	2.51	25.92	2.98	27.72	3.20	29.52	3.45	31.77	3.59	32.49	3.69
	2	18.72	2.08	22.32	2.53	25.92	3.03	27.72	3.24	29.52	3.49	31.77	3.64	32.49	3.74
	4	18.72	2.12	22.32	2.56	25.92	3.06	27.72	3.28	29.52	3.54	31.77	3.69	32.49	3.77
	6	18.72	2.14	22.32	2.59	25.92	3.09	27.72	3.33	29.52	3.58	31.77	3.73	32.49	3.83
	8	18.72	2.16	22.32	2.63	25.92	3.12	27.72	3.36	29.52	3.62	31.77	3.76	32.49	3.87
	10	18.72	2.19	22.32	2.66	25.92	3.17	27.72	3.42	29.52	3.68	31.77	3.78	32.49	3.90
	12	18.72	2.23	22.32	2.72	25.92	3.23	27.72	3.49	29.52	3.75	31.41	3.84	32.04	3.96
	14	18.72	2.27	22.32	2.77	25.92	3.29	27.72	3.55	29.52	3.82	30.96	3.87	31.68	3.98
	16	18.72	2.31	22.32	2.82	25.92	3.35	27.72	3.62	29.52	3.90	30.60	3.92	31.23	4.03
	18	18.72	2.36	22.32	2.87	25.92	3.42	27.72	3.72	29.52	4.09	30.15	4.12	30.87	4.15
	20	18.72	2.40	22.32	2.93	25.92	3.62	27.72	4.00	29.07	4.29	29.79	4.32	30.42	4.36
	21	18.72	2.42	22.32	3.02	25.92	3.75	27.72	4.15	28.89	4.39	29.52	4.42	30.24	4.46
	23	18.72	2.54	22.32	3.24	25.92	4.02	27.72	4.45	28.44	4.58	29.16	4.62	29.79	4.66
	25	18.72	2.71	22.32	3.46	25.92	4.30	27.72	4.77	28.08	4.78	28.71	4.83	29.43	4.87
	27	18.72	2.89	22.32	3.70	25.92	4.60	27.27	4.97	27.63	4.98	28.35	5.03	28.98	5.07
	29	18.72	3.08	22.32	3.95	25.92	4.92	26.91	5.17	27.27	5.19	27.90	5.24	28.62	5.28
	31	18.72	3.28	22.32	4.21	25.92	5.25	26.46	5.37	26.82	5.39	27.54	5.44	28.17	5.49
	33	18.72	3.49	22.32	4.49	25.74	5.54	26.10	5.57	26.46	5.59	27.09	5.65	27.81	5.70
35	18.72	3.71	22.32	4.78	25.29	5.74	25.65	5.77	26.01	5.80	26.64	5.85	27.36	5.91	
37	18.72	3.95	22.32	5.09	24.93	5.95	25.29	5.97	25.56	6.00	26.28	6.06	26.91	6.12	
39	18.72	4.20	22.32	5.42	24.48	6.15	24.84	6.18	25.20	6.21	25.83	6.27	26.55	6.33	
41	18.72	4.24	22.32	5.46	24.29	6.19	24.65	6.22	25.01	6.25	25.50	6.31	25.75	6.38	
43	18.72	4.29	22.32	5.54	24.10	6.23	24.46	6.27	24.82	6.30	25.28	6.34	25.36	6.51	
45	18.72	4.43	22.32	5.57	23.85	6.29	24.20	6.34	24.60	6.35	25.02	6.51	25.12	6.66	
48	20.50	4.58	24.45	6.04	25.74	6.33	26.08	6.39	26.63	6.42	26.95	6.53	27.16	6.73	
100%	-5	17.01	1.80	20.25	2.17	23.58	2.58	25.20	2.76	26.82	3.00	30.15	3.42	31.86	3.56
	-2	17.01	1.82	20.25	2.19	23.58	2.61	25.20	2.81	26.82	3.04	30.15	3.46	31.86	3.59
	0	17.01	1.84	20.25	2.22	23.58	2.64	25.20	2.85	26.82	3.07	30.15	3.51	31.86	3.63
	2	17.01	1.88	20.25	2.25	23.58	2.66	25.20	2.89	26.82	3.10	30.15	3.56	31.86	3.68
	4	17.01	1.89	20.25	2.27	23.58	2.70	25.20	2.93	26.82	3.14	30.15	3.60	31.86	3.72
	6	17.01	1.92	20.25	2.31	23.58	2.74	25.20	2.98	26.82	3.19	30.15	3.65	31.86	3.78
	8	17.01	1.95	20.25	2.35	23.58	2.79	25.20	3.01	26.82	3.24	30.15	3.71	31.86	3.84
	10	17.01	1.98	20.25	2.39	23.58	2.83	25.20	3.07	26.82	3.30	30.15	3.77	31.86	3.90
	12	17.01	2.01	20.25	2.44	23.58	2.89	25.20	3.12	26.82	3.36	30.15	3.84	31.41	3.93
	14	17.01	2.05	20.25	2.49	23.58	2.94	25.20	3.18	26.82	3.42	30.15	3.91	31.05	3.98
	16	17.01	2.09	20.25	2.53	23.58	3.00	25.20	3.24	26.82	3.49	29.97	3.96	30.60	4.02
	18	17.01	2.12	20.25	2.58	23.58	3.06	25.20	3.31	26.82	3.56	29.61	4.09	30.24	4.12
	20	17.01	2.16	20.25	2.63	23.58	3.15	25.20	3.47	26.82	3.82	29.16	4.29	29.79	4.32
	21	17.01	2.19	20.25	2.66	23.58	3.27	25.20	3.60	26.82	3.95	28.98	4.39	29.61	4.42
	23	17.01	2.24	20.25	2.83	23.58	3.50	25.20	3.85	26.82	4.23	28.62	4.59	29.16	4.63
	25	17.01	2.39	20.25	3.03	23.58	3.75	25.20	4.13	26.82	4.53	28.17	4.79	28.80	4.83
	27	17.01	2.55	20.25	3.23	23.58	4.00	25.20	4.42	26.82	4.85	27.72	4.99	28.35	5.03
	29	17.01	2.71	20.25	3.44	23.58	4.27	25.20	4.72	26.73	5.15	27.36	5.20	27.99	5.24
	31	17.01	2.89	20.25	3.68	23.58	4.56	25.20	5.03	26.37	5.35	26.91	5.40	27.54	5.44
	33	17.01	3.07	20.25	3.92	23.58	4.86	25.20	5.37	25.92	5.55	26.55	5.60	27.18	5.65
35	17.01	3.26	20.25	4.16	23.58	5.18	25.20	5.73	25.47	5.75	26.10	5.81	26.73	5.85	
37	17.01	3.47	20.25	4.43	23.58	5.52	24.75	5.93	25.11	5.96	25.74	6.01	26.28	6.06	
39	17.01	3.68	20.25	4.71	23.58	5.88	24.39	6.13	24.66	6.16	25.29	6.22	25.92	6.28	
41	17.01	3.86	20.25	4.88	23.58	6.09	24.01	6.17	24.47	6.26	24.85	6.36	25.54	6.41	
43	17.01	4.03	20.25	5.05	23.58	6.20	23.63	6.25	24.29	6.32	25.00	6.40	25.09	6.48	
45	17.01	4.26	20.25	5.28	23.58	6.31	23.13	6.33	24.17	6.43	24.79	6.50	24.59	6.56	
48	17.62	4.44	20.97	5.47	24.42	6.32	22.97	6.40	24.99	6.55	24.11	6.57	24.91	6.63	

**Cooling capacity table**

MVUR252B-VA3

**TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature(°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
90%	-5	15.30	1.59	18.27	1.91	21.24	2.25	22.68	2.46	24.12	2.61	27.09	3.01	30.06	3.44
	-2	15.30	1.61	18.27	1.93	21.24	2.28	22.68	2.49	24.12	2.65	27.09	3.04	30.06	3.48
	0	15.30	1.63	18.27	1.95	21.24	2.32	22.68	2.52	24.12	2.68	27.09	3.07	30.06	3.50
	2	15.30	1.65	18.27	1.98	21.24	2.34	22.68	2.56	24.12	2.72	27.09	3.13	30.06	3.55
	4	15.30	1.68	18.27	2.01	21.24	2.38	22.68	2.59	24.12	2.76	27.09	3.18	30.06	3.61
	6	15.30	1.70	18.27	2.05	21.24	2.42	22.68	2.64	24.12	2.80	27.09	3.23	30.06	3.67
	8	15.30	1.74	18.27	2.09	21.24	2.47	22.68	2.68	24.12	2.85	27.09	3.29	30.06	3.70
	10	15.30	1.77	18.27	2.13	21.24	2.52	22.68	2.72	24.12	2.92	27.09	3.33	30.06	3.76
	12	15.30	1.80	18.27	2.17	21.24	2.56	22.68	2.76	24.12	2.97	27.09	3.40	30.06	3.83
	14	15.30	1.83	18.27	2.21	21.24	2.61	22.68	2.82	24.12	3.03	27.09	3.46	30.06	3.90
	16	15.30	1.86	18.27	2.25	21.24	2.66	22.68	2.87	24.12	3.09	27.09	3.53	29.97	3.97
	18	15.30	1.89	18.27	2.29	21.24	2.71	22.68	2.93	24.12	3.15	27.09	3.60	29.61	4.09
	20	15.30	1.93	18.27	2.35	21.24	2.76	22.68	2.99	24.12	3.27	27.09	3.87	29.16	4.29
	21	15.30	1.95	18.27	2.36	21.24	2.81	22.68	3.09	24.12	3.38	27.09	4.01	28.98	4.39
	23	15.30	1.98	18.27	2.46	21.24	3.01	22.68	3.31	24.12	3.63	27.09	4.30	28.53	4.59
	25	15.30	2.09	18.27	2.63	21.24	3.22	22.68	3.54	24.12	3.88	27.09	4.60	28.17	4.79
	27	15.30	2.22	18.27	2.80	21.24	3.44	22.68	3.78	24.12	4.15	27.09	4.93	27.72	4.99
	29	15.30	2.37	18.27	2.98	21.24	3.67	22.68	4.04	24.12	4.43	26.82	5.15	27.36	5.19
	31	15.30	2.52	18.27	3.17	21.24	3.91	22.68	4.31	24.12	4.73	26.37	5.35	26.91	5.40
	33	15.30	2.67	18.27	3.37	21.24	4.17	22.68	4.59	24.12	5.04	26.01	5.56	26.55	5.60
35	15.30	2.84	18.27	3.59	21.24	4.44	22.68	4.90	24.12	5.37	25.56	5.76	26.10	5.81	
37	15.30	3.01	18.27	3.81	21.24	4.73	22.68	5.21	24.12	5.73	25.11	5.96	25.74	6.01	
39	15.30	3.20	18.27	4.06	21.24	5.03	22.68	5.55	24.12	6.10	24.75	6.17	25.29	6.22	
41	15.30	3.31	18.27	4.25	21.24	5.21	22.68	5.70	24.12	6.14	24.58	6.33	25.12	6.36	
43	15.30	3.47	18.27	4.43	21.24	5.39	22.68	5.85	24.12	6.27	24.45	6.41	24.90	6.46	
45	15.30	3.69	18.27	4.65	21.24	5.61	22.68	6.04	24.12	6.44	24.32	6.48	24.52	6.55	
48	15.30	3.89	18.27	4.86	21.24	5.83	22.68	6.12	24.12	6.50	26.79	6.57	26.51	6.64	
80%	-5	13.59	1.40	16.20	1.66	18.81	1.96	20.16	2.09	21.51	2.25	24.12	2.60	26.73	2.97
	-2	13.59	1.42	16.20	1.68	18.81	1.98	20.16	2.12	21.51	2.27	24.12	2.62	26.73	2.99
	0	13.59	1.45	16.20	1.70	18.81	2.00	20.16	2.14	21.51	2.31	24.12	2.66	26.73	3.04
	2	13.59	1.48	16.20	1.72	18.81	2.03	20.16	2.19	21.51	2.35	24.12	2.71	26.73	3.09
	4	13.59	1.50	16.20	1.75	18.81	2.07	20.16	2.24	21.51	2.39	24.12	2.76	26.73	3.13
	6	13.59	1.53	16.20	1.79	18.81	2.10	20.16	2.28	21.51	2.44	24.12	2.80	26.73	3.19
	8	13.59	1.55	16.20	1.84	18.81	2.15	20.16	2.32	21.51	2.49	24.12	2.85	26.73	3.25
	10	13.59	1.57	16.20	1.88	18.81	2.21	20.16	2.38	21.51	2.55	24.12	2.91	26.73	3.28
	12	13.59	1.59	16.20	1.91	18.81	2.25	20.16	2.42	21.51	2.60	24.12	2.97	26.73	3.34
	14	13.59	1.62	16.20	1.95	18.81	2.29	20.16	2.46	21.51	2.65	24.12	3.02	26.73	3.41
	16	13.59	1.65	16.20	1.98	18.81	2.33	20.16	2.51	21.51	2.70	24.12	3.08	26.73	3.47
	18	13.59	1.68	16.20	2.02	18.81	2.38	20.16	2.56	21.51	2.75	24.12	3.14	26.73	3.54
	20	13.59	1.71	16.20	2.05	18.81	2.42	20.16	2.61	21.51	2.80	24.12	3.26	26.73	3.78
	21	13.59	1.72	16.20	2.07	18.81	2.45	20.16	2.64	21.51	2.87	24.12	3.37	26.73	3.92
	23	13.59	1.75	16.20	2.12	18.81	2.56	20.16	2.81	21.51	3.07	24.12	3.61	26.73	4.21
	25	13.59	1.81	16.20	2.25	18.81	2.74	20.16	3.00	21.51	3.27	24.12	3.87	26.73	4.50
	27	13.59	1.92	16.20	2.39	18.81	2.92	20.16	3.21	21.51	3.50	24.12	4.13	26.73	4.82
	29	13.59	2.05	16.20	2.55	18.81	3.11	20.16	3.41	21.51	3.74	24.12	4.41	26.73	5.15
	31	13.59	2.17	16.20	2.71	18.81	3.31	20.16	3.64	21.51	3.98	24.12	4.71	26.28	5.35
	33	13.59	2.31	16.20	2.88	18.81	3.53	20.16	3.88	21.51	4.24	24.12	5.02	25.92	5.55
35	13.59	2.45	16.20	3.07	18.81	3.75	20.16	4.12	21.51	4.52	24.12	5.35	25.47	5.75	
37	13.59	2.59	16.20	3.25	18.81	3.99	20.16	4.39	21.51	4.81	24.12	5.71	25.11	5.95	
39	13.59	2.75	16.20	3.47	18.81	4.25	20.16	4.67	21.51	5.12	24.12	6.08	24.66	6.16	
41	13.59	2.81	16.20	3.50	18.81	4.31	20.16	4.80	21.51	5.21	24.12	6.23	24.51	6.27	
43	13.59	2.89	16.20	3.53	18.81	4.37	20.16	4.88	21.51	5.29	24.12	6.30	24.36	6.34	
45	13.59	2.98	16.20	3.57	18.81	4.46	20.16	4.98	21.51	5.38	24.12	6.37	24.05	6.44	
48	13.59	3.07	16.20	3.60	21.16	4.53	20.16	5.05	21.51	5.42	24.12	6.44	26.83	6.53	

**Cooling capacity table**

MVUR252B-VA3

TC: Total Capacity (kW); PI: Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature(°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
70%	-5	11.88	1.25	14.22	1.47	16.47	1.66	17.64	1.78	18.81	1.90	21.06	2.18	23.40	2.50
	-2	11.88	1.26	14.22	1.47	16.47	1.67	17.64	1.82	18.81	1.94	21.06	2.21	23.40	2.54
	0	11.88	1.27	14.22	1.49	16.47	1.71	17.64	1.85	18.81	1.97	21.06	2.26	23.40	2.57
	2	11.88	1.28	14.22	1.50	16.47	1.74	17.64	1.89	18.81	2.01	21.06	2.30	23.40	2.61
	4	11.88	1.29	14.22	1.54	16.47	1.77	17.64	1.92	18.81	2.05	21.06	2.34	23.40	2.67
	6	11.88	1.31	14.22	1.57	16.47	1.82	17.64	1.98	18.81	2.10	21.06	2.38	23.40	2.73
	8	11.88	1.34	14.22	1.61	16.47	1.86	17.64	2.01	18.81	2.14	21.06	2.45	23.40	2.78
	10	11.88	1.36	14.22	1.64	16.47	1.91	17.64	2.05	18.81	2.20	21.06	2.50	23.40	2.81
	12	11.88	1.40	14.22	1.66	16.47	1.95	17.64	2.09	18.81	2.24	21.06	2.55	23.40	2.87
	14	11.88	1.42	14.22	1.69	16.47	1.98	17.64	2.12	18.81	2.28	21.06	2.59	23.40	2.92
	16	11.88	1.44	14.22	1.72	16.47	2.02	17.64	2.17	18.81	2.32	21.06	2.64	23.40	2.97
	18	11.88	1.47	14.22	1.75	16.47	2.05	17.64	2.21	18.81	2.36	21.06	2.70	23.40	3.03
	20	11.88	1.49	14.22	1.78	16.47	2.09	17.64	2.25	18.81	2.41	21.06	2.75	23.40	3.12
	21	11.88	1.51	14.22	1.80	16.47	2.11	17.64	2.27	18.81	2.43	21.06	2.79	23.40	3.23
	23	11.88	1.53	14.22	1.83	16.47	2.15	17.64	2.35	18.81	2.56	21.06	2.99	23.40	3.46
	25	11.88	1.56	14.22	1.91	16.47	2.29	17.64	2.51	18.81	2.73	21.06	3.20	23.40	3.70
	27	11.88	1.65	14.22	2.03	16.47	2.45	17.64	2.67	18.81	2.91	21.06	3.41	23.40	3.95
	29	11.88	1.75	14.22	2.15	16.47	2.60	17.64	2.85	18.81	3.10	21.06	3.64	23.40	4.22
	31	11.88	1.85	14.22	2.29	16.47	2.77	17.64	3.03	18.81	3.30	21.06	3.88	23.40	4.50
	33	11.88	1.97	14.22	2.43	16.47	2.95	17.64	3.22	18.81	3.51	21.06	4.13	23.40	4.80
35	11.88	2.09	14.22	2.58	16.47	3.13	17.64	3.43	18.81	3.74	21.06	4.40	23.40	5.12	
37	11.88	2.20	14.22	2.73	16.47	3.33	17.64	3.64	18.81	3.98	21.06	4.69	23.40	5.45	
39	11.88	2.33	14.22	2.90	16.47	3.53	17.64	3.87	18.81	4.22	21.06	4.98	23.40	5.81	
41	11.88	2.44	14.22	3.00	16.47	3.63	17.64	4.00	18.81	4.35	21.06	5.19	23.40	6.06	
43	11.88	2.63	14.22	3.20	16.47	3.78	17.64	4.21	18.81	4.48	21.06	5.38	23.40	6.25	
45	11.88	2.69	14.22	3.27	16.47	3.86	17.64	4.28	18.81	4.70	21.06	5.67	23.40	6.49	
48	11.88	2.76	14.22	3.30	16.47	3.90	17.64	4.35	18.81	4.83	21.06	5.92	23.40	6.65	
60%	-5	10.17	1.07	12.15	1.24	14.13	1.44	15.12	1.54	16.11	1.66	18.09	1.86	20.07	2.14
	-2	10.17	1.07	12.15	1.26	14.13	1.47	15.12	1.56	16.11	1.68	18.09	1.89	20.07	2.15
	0	10.17	1.09	12.15	1.27	14.13	1.49	15.12	1.58	16.11	1.71	18.09	1.92	20.07	2.18
	2	10.17	1.11	12.15	1.30	14.13	1.52	15.12	1.61	16.11	1.73	18.09	1.96	20.07	2.21
	4	10.17	1.14	12.15	1.33	14.13	1.55	15.12	1.63	16.11	1.75	18.09	1.99	20.07	2.24
	6	10.17	1.15	12.15	1.35	14.13	1.58	15.12	1.67	16.11	1.79	18.09	2.03	20.07	2.29
	8	10.17	1.17	12.15	1.38	14.13	1.60	15.12	1.70	16.11	1.83	18.09	2.07	20.07	2.33
	10	10.17	1.20	12.15	1.41	14.13	1.63	15.12	1.74	16.11	1.86	18.09	2.11	20.07	2.36
	12	10.17	1.22	12.15	1.43	14.13	1.66	15.12	1.78	16.11	1.89	18.09	2.15	20.07	2.40
	14	10.17	1.24	12.15	1.45	14.13	1.68	15.12	1.81	16.11	1.93	18.09	2.19	20.07	2.45
	16	10.17	1.25	12.15	1.47	14.13	1.71	15.12	1.84	16.11	1.96	18.09	2.22	20.07	2.49
	18	10.17	1.27	12.15	1.50	14.13	1.74	15.12	1.87	16.11	2.00	18.09	2.26	20.07	2.54
	20	10.17	1.29	12.15	1.53	14.13	1.78	15.12	1.91	16.11	2.04	18.09	2.31	20.07	2.59
	21	10.17	1.31	12.15	1.54	14.13	1.79	15.12	1.92	16.11	2.05	18.09	2.33	20.07	2.62
	23	10.17	1.32	12.15	1.57	14.13	1.82	15.12	1.96	16.11	2.09	18.09	2.42	20.07	2.79
	25	10.17	1.34	12.15	1.59	14.13	1.89	15.12	2.05	16.11	2.22	18.09	2.59	20.07	2.97
	27	10.17	1.40	12.15	1.69	14.13	2.02	15.12	2.19	16.11	2.37	18.09	2.76	20.07	3.17
	29	10.17	1.47	12.15	1.79	14.13	2.15	15.12	2.33	16.11	2.52	18.09	2.94	20.07	3.39
	31	10.17	1.57	12.15	1.90	14.13	2.28	15.12	2.48	16.11	2.69	18.09	3.13	20.07	3.61
	33	10.17	1.65	12.15	2.02	14.13	2.42	15.12	2.63	16.11	2.86	18.09	3.33	20.07	3.85
35	10.17	1.75	12.15	2.14	14.13	2.56	15.12	2.80	16.11	3.03	18.09	3.54	20.07	4.09	
37	10.17	1.85	12.15	2.26	14.13	2.72	15.12	2.97	16.11	3.22	18.09	3.77	20.07	4.35	
39	10.17	1.95	12.15	2.39	14.13	2.88	15.12	3.14	16.11	3.42	18.09	4.00	20.07	4.63	
41	10.17	2.02	12.15	2.50	14.13	2.98	15.12	3.27	16.11	3.55	18.09	4.19	20.07	4.84	
43	10.17	2.08	12.15	2.60	14.13	3.09	15.12	3.37	16.11	3.67	18.09	4.37	20.07	5.05	
45	10.17	2.18	12.15	2.73	14.13	3.22	15.12	3.49	16.11	3.85	18.09	4.56	20.07	5.33	
48	10.17	2.26	12.15	2.86	14.13	3.32	15.12	3.58	16.11	4.00	18.09	4.73	20.07	5.58	

**Cooling capacity table**

MVUR252B-VA3

**TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature(°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
50%	-5	8.51	0.93	10.17	1.07	11.79	1.23	12.60	1.29	13.41	1.36	15.03	1.55	16.74	1.67
	-2	8.51	0.93	10.17	1.09	11.79	1.25	12.60	1.31	13.41	1.39	15.03	1.57	16.74	1.69
	0	8.51	0.95	10.17	1.11	11.79	1.27	12.60	1.33	13.41	1.40	15.03	1.59	16.74	1.72
	2	8.51	0.96	10.17	1.13	11.79	1.29	12.60	1.35	13.41	1.43	15.03	1.60	16.74	1.75
	4	8.51	0.97	10.17	1.15	11.79	1.30	12.60	1.36	13.41	1.45	15.03	1.64	16.74	1.80
	6	8.51	0.99	10.17	1.16	11.79	1.32	12.60	1.39	13.41	1.48	15.03	1.67	16.74	1.85
	8	8.51	1.01	10.17	1.18	11.79	1.35	12.60	1.42	13.41	1.50	15.03	1.69	16.74	1.91
	10	8.51	1.03	10.17	1.20	11.79	1.37	12.60	1.45	13.41	1.54	15.03	1.74	16.74	1.94
	12	8.51	1.04	10.17	1.21	11.79	1.39	12.60	1.47	13.41	1.58	15.03	1.77	16.74	1.97
	14	8.51	1.06	10.17	1.23	11.79	1.41	12.60	1.51	13.41	1.60	15.03	1.80	16.74	2.01
	16	8.51	1.07	10.17	1.24	11.79	1.43	12.60	1.53	13.41	1.62	15.03	1.83	16.74	2.04
	18	8.51	1.09	10.17	1.27	11.79	1.45	12.60	1.55	13.41	1.65	15.03	1.86	16.74	2.08
	20	8.51	1.10	10.17	1.28	11.79	1.47	12.60	1.58	13.41	1.68	15.03	1.89	16.74	2.12
	21	8.51	1.11	10.17	1.30	11.79	1.49	12.60	1.59	13.41	1.70	15.03	1.91	16.74	2.14
	23	8.51	1.13	10.17	1.31	11.79	1.51	12.60	1.62	13.41	1.73	15.03	1.95	16.74	2.19
	25	8.51	1.14	10.17	1.34	11.79	1.54	12.60	1.65	13.41	1.78	15.03	2.05	16.74	2.33
	27	8.51	1.17	10.17	1.39	11.79	1.63	12.60	1.76	13.41	1.89	15.03	2.18	16.74	2.49
	29	8.51	1.23	10.17	1.47	11.79	1.73	12.60	1.87	13.41	2.02	15.03	2.32	16.74	2.65
	31	8.51	1.30	10.17	1.55	11.79	1.83	12.60	1.98	13.41	2.14	15.03	2.46	16.74	2.82
	33	8.51	1.37	10.17	1.64	11.79	1.95	12.60	2.10	13.41	2.27	15.03	2.62	16.74	3.00
35	8.51	1.45	10.17	1.74	11.79	2.05	12.60	2.22	13.41	2.40	15.03	2.78	16.74	3.18	
37	8.51	1.53	10.17	1.84	11.79	2.18	12.60	2.36	13.41	2.55	15.03	2.95	16.74	3.38	
39	8.51	1.61	10.17	1.94	11.79	2.30	12.60	2.49	13.41	2.70	15.03	3.13	16.74	3.59	
41	8.51	1.68	10.17	2.02	11.79	2.38	12.60	2.61	13.41	2.82	15.03	3.29	16.74	3.76	
43	8.51	1.79	10.17	2.16	11.79	2.47	12.60	2.73	13.41	2.89	15.03	3.46	16.74	3.92	
45	8.51	1.83	10.17	2.22	11.79	2.63	12.60	2.94	13.41	3.01	15.03	3.79	16.74	4.26	
48	8.51	1.88	10.17	2.28	11.79	2.79	12.60	3.13	13.41	3.15	15.03	4.10	16.74	4.58	

**Cooling capacity table**

MVUR280B-VA3

**TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature(°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
130%	-5	24.60	2.73	29.30	3.33	34.00	3.57	35.30	3.71	37.00	3.82	37.90	4.15	38.85	4.18
	-2	24.60	2.73	29.30	3.39	34.00	3.57	35.30	3.73	37.00	3.82	37.90	4.20	38.85	4.22
	0	24.60	2.77	29.30	3.45	34.00	3.70	35.30	3.94	37.00	4.04	37.90	4.26	38.85	4.28
	2	24.60	2.82	29.30	3.46	34.00	3.82	35.30	4.16	37.00	4.09	37.90	4.29	38.85	4.34
	4	24.60	2.89	29.30	3.53	34.00	3.96	35.30	4.18	37.00	4.14	37.90	4.28	38.85	4.42
	6	24.60	2.94	29.30	3.60	34.00	4.10	35.30	4.21	36.58	4.27	37.43	4.28	38.43	4.45
	8	24.60	3.01	29.30	3.68	34.00	4.31	35.30	4.42	36.13	4.41	37.03	3.90	37.93	4.50
	10	24.60	3.07	29.30	3.76	34.00	4.47	35.30	4.57	35.70	4.04	36.60	4.06	37.50	4.63
	12	24.60	3.13	29.30	3.83	34.00	4.56	34.80	4.03	35.30	4.06	36.10	4.07	37.00	4.66
	14	24.60	3.19	29.30	3.90	33.90	4.05	34.40	4.06	34.80	4.08	35.70	4.09	36.60	4.76
	16	24.60	3.25	29.30	3.98	33.50	4.06	33.90	4.08	34.30	4.10	35.20	4.12	36.10	4.84
	18	24.60	3.31	29.30	4.06	33.00	4.76	33.40	4.79	33.90	4.82	34.80	4.86	35.70	4.91
	20	24.60	3.38	29.30	4.32	32.50	5.00	33.00	5.03	33.40	5.05	34.30	5.10	35.20	5.15
	21	24.60	3.47	29.30	4.48	32.30	5.12	32.80	5.14	33.20	5.17	34.10	5.22	35.00	5.27
	23	24.60	3.72	29.30	4.80	31.90	5.35	32.30	5.38	32.70	5.40	33.60	5.46	34.50	5.51
	25	24.60	3.97	29.30	5.14	31.40	5.58	31.80	5.61	32.30	5.65	33.20	5.70	34.10	5.75
	27	24.60	4.24	29.30	5.50	31.00	5.82	31.40	5.85	31.80	5.88	32.70	5.94	33.60	6.01
	29	24.60	4.53	29.30	5.88	30.50	6.05	30.90	6.09	31.40	6.12	32.30	6.19	33.20	6.25
	31	24.60	4.84	29.20	6.22	30.00	6.29	30.50	6.33	30.90	6.36	31.80	6.43	32.70	6.50
	33	24.60	5.15	28.70	6.45	29.60	6.53	30.00	6.56	30.50	6.60	31.40	6.67	32.20	6.74
35	24.60	5.49	28.20	6.69	29.10	6.77	29.60	6.81	30.00	6.84	30.90	6.92	31.80	6.99	
37	24.60	5.84	27.80	6.93	28.70	7.01	29.10	7.05	29.60	7.09	30.40	7.17	31.30	7.26	
39	24.60	6.22	27.30	7.00	28.20	7.25	28.70	7.29	29.10	7.34	30.00	7.42	30.90	7.51	
41	24.60	6.55	27.02	7.07	27.90	7.31	28.40	7.36	28.80	7.40	29.70	7.43	29.71	7.57	
43	24.60	6.71	26.82	7.11	27.75	7.33	28.26	7.39	28.51	7.41	29.16	7.45	29.36	7.59	
45	24.60	7.05	26.65	7.17	27.46	7.40	27.96	7.44	28.09	7.45	28.37	7.47	28.78	7.73	
48	24.60	7.30	27.60	7.41	29.94	7.47	30.49	7.51	30.74	7.53	30.60	7.60	31.16	7.62	
120%	-5	22.70	2.63	27.00	3.19	31.40	3.77	33.60	4.11	35.20	4.29	36.00	4.43	36.80	4.54
	-2	22.70	2.66	27.00	3.22	31.40	3.81	33.60	4.14	35.20	4.34	36.00	4.46	36.80	4.56
	0	22.70	2.68	27.00	3.24	31.40	3.85	33.60	4.15	35.20	4.38	36.00	4.49	36.80	4.57
	2	22.70	2.69	27.00	3.28	31.40	3.88	33.60	4.19	35.20	4.39	36.00	4.52	36.80	4.58
	4	22.70	2.72	27.00	3.32	31.40	3.93	33.60	4.23	35.20	4.45	36.00	4.53	36.80	4.59
	6	22.70	2.75	27.00	3.35	31.40	3.98	33.60	4.27	35.20	4.50	36.00	4.57	36.80	4.60
	8	22.70	2.77	27.00	3.38	31.40	4.04	33.60	4.33	35.20	4.55	36.00	4.58	36.80	4.63
	10	22.70	2.80	27.00	3.42	31.40	4.07	33.60	4.40	35.20	4.55	36.00	4.60	36.80	4.65
	12	22.70	2.86	27.00	3.49	31.40	4.15	33.60	4.49	34.70	4.57	35.50	4.57	36.30	4.68
	14	22.70	2.91	27.00	3.56	31.40	4.23	33.60	4.58	34.20	4.60	35.10	4.64	35.90	4.73
	16	22.70	2.97	27.00	3.63	31.40	4.31	33.40	4.10	33.80	4.66	34.60	4.72	35.40	4.80
	18	22.70	3.02	27.00	3.70	31.40	4.46	32.90	4.76	33.30	4.78	34.10	4.83	35.00	4.87
	20	22.70	3.08	27.00	3.85	31.40	4.80	32.50	5.00	32.90	5.02	33.70	5.06	34.50	5.11
	21	22.70	3.11	27.00	3.98	31.40	4.97	32.20	5.11	32.60	5.13	33.50	5.18	34.30	5.23
	23	22.70	3.33	27.00	4.27	31.40	5.32	31.80	5.34	32.20	5.37	33.00	5.42	33.80	5.47
	25	22.70	3.55	27.00	4.57	30.90	5.56	31.30	5.57	31.70	5.60	32.60	5.65	33.40	5.71
	27	22.70	3.79	27.00	4.88	30.50	5.78	30.90	5.82	31.30	5.84	32.10	5.90	32.90	5.95
	29	22.70	4.05	27.00	5.21	30.00	6.01	30.40	6.05	30.80	6.08	31.60	6.14	32.50	6.19
	31	22.70	4.31	27.00	5.56	29.50	6.26	30.00	6.28	30.40	6.32	31.20	6.38	32.00	6.45
	33	22.70	4.59	27.00	5.93	29.10	6.49	29.50	6.53	29.90	6.55	30.70	6.63	31.50	6.69
35	22.70	4.89	27.00	6.33	28.60	6.72	29.00	6.76	29.50	6.80	30.30	6.87	31.10	6.94	
37	22.70	5.20	27.00	6.74	28.20	6.97	28.60	7.00	29.00	7.04	29.80	7.11	30.60	7.19	
39	22.70	5.54	26.90	7.12	27.70	7.20	28.10	7.25	28.50	7.28	29.40	7.36	30.20	7.43	
41	22.70	5.69	26.68	7.17	27.48	7.25	27.88	7.30	28.28	7.33	29.18	7.38	29.33	7.49	
43	22.70	5.77	26.54	7.22	27.27	7.30	27.67	7.32	28.07	7.36	28.67	7.40	28.88	7.64	
45	22.70	5.84	26.39	7.29	27.00	7.36	27.38	7.39	27.82	7.42	28.09	7.43	28.59	7.81	
48	22.70	5.89	30.32	7.37	30.88	7.43	31.21	7.45	31.88	7.48	32.05	7.45	32.68	7.90	

**Cooling capacity table**

MVUR280B-VA3

**TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature(°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
110%	-5	20.80	2.30	24.80	2.86	28.80	3.42	30.80	3.67	32.80	3.95	35.30	4.10	36.10	4.22
	-2	20.80	2.34	24.80	2.90	28.80	3.44	30.80	3.70	32.80	3.98	35.30	4.14	36.10	4.25
	0	20.80	2.37	24.80	2.92	28.80	3.47	30.80	3.73	32.80	4.02	35.30	4.18	36.10	4.30
	2	20.80	2.42	24.80	2.94	28.80	3.53	30.80	3.77	32.80	4.06	35.30	4.24	36.10	4.35
	4	20.80	2.47	24.80	2.98	28.80	3.56	30.80	3.81	32.80	4.13	35.30	4.30	36.10	4.39
	6	20.80	2.49	24.80	3.01	28.80	3.59	30.80	3.87	32.80	4.17	35.30	4.34	36.10	4.46
	8	20.80	2.51	24.80	3.06	28.80	3.63	30.80	3.92	32.80	4.22	35.30	4.37	36.10	4.51
	10	20.80	2.54	24.80	3.10	28.80	3.69	30.80	3.98	32.80	4.29	35.30	4.40	36.10	4.54
	12	20.80	2.60	24.80	3.16	28.80	3.76	30.80	4.06	32.80	4.37	34.90	4.47	35.60	4.60
	14	20.80	2.64	24.80	3.22	28.80	3.83	30.80	4.14	32.80	4.45	34.40	4.50	35.20	4.64
	16	20.80	2.69	24.80	3.28	28.80	3.90	30.80	4.22	32.80	4.54	34.00	4.56	34.70	4.69
	18	20.80	2.74	24.80	3.34	28.80	3.98	30.80	4.33	32.80	4.76	33.50	4.79	34.30	4.84
	20	20.80	2.80	24.80	3.42	28.80	4.22	30.80	4.66	32.30	4.99	33.10	5.03	33.80	5.07
	21	20.80	2.82	24.80	3.51	28.80	4.37	30.80	4.83	32.10	5.11	32.80	5.14	33.60	5.19
	23	20.80	2.96	24.80	3.77	28.80	4.68	30.80	5.18	31.60	5.33	32.40	5.38	33.10	5.43
	25	20.80	3.16	24.80	4.03	28.80	5.01	30.80	5.55	31.20	5.56	31.90	5.62	32.70	5.66
	27	20.80	3.36	24.80	4.31	28.80	5.36	30.30	5.78	30.70	5.80	31.50	5.85	32.20	5.91
	29	20.80	3.59	24.80	4.59	28.80	5.73	29.90	6.01	30.30	6.04	31.00	6.09	31.80	6.15
	31	20.80	3.82	24.80	4.90	28.80	6.11	29.40	6.25	29.80	6.27	30.60	6.33	31.30	6.39
	33	20.80	4.06	24.80	5.22	28.60	6.45	29.00	6.48	29.40	6.51	30.10	6.57	30.90	6.63
35	20.80	4.32	24.80	5.56	28.10	6.68	28.50	6.72	28.90	6.75	29.60	6.81	30.40	6.88	
37	20.80	4.60	24.80	5.92	27.70	6.92	28.10	6.95	28.40	6.99	29.20	7.06	29.90	7.12	
39	20.80	4.89	24.80	6.31	27.20	7.16	27.60	7.19	28.00	7.23	28.70	7.30	29.50	7.37	
41	20.80	4.94	24.80	6.36	26.99	7.21	27.39	7.24	27.79	7.28	28.34	7.35	28.61	7.42	
43	20.80	4.99	24.80	6.44	26.77	7.26	27.17	7.29	27.57	7.33	28.08	7.38	28.17	7.57	
45	20.80	5.15	24.80	6.48	26.50	7.32	26.89	7.38	27.33	7.40	27.80	7.58	27.91	7.75	
48	22.78	5.33	27.16	7.03	28.60	7.37	28.98	7.43	29.59	7.47	29.94	7.61	30.17	7.83	
100%	-5	18.90	2.09	22.50	2.52	26.20	3.00	28.00	3.21	29.80	3.49	33.50	3.98	35.40	4.15
	-2	18.90	2.12	22.50	2.55	26.20	3.03	28.00	3.27	29.80	3.54	33.50	4.02	35.40	4.18
	0	18.90	2.14	22.50	2.58	26.20	3.07	28.00	3.31	29.80	3.57	33.50	4.09	35.40	4.22
	2	18.90	2.18	22.50	2.62	26.20	3.10	28.00	3.36	29.80	3.61	33.50	4.15	35.40	4.29
	4	18.90	2.20	22.50	2.64	26.20	3.15	28.00	3.41	29.80	3.66	33.50	4.19	35.40	4.34
	6	18.90	2.23	22.50	2.69	26.20	3.19	28.00	3.47	29.80	3.71	33.50	4.25	35.40	4.40
	8	18.90	2.27	22.50	2.73	26.20	3.25	28.00	3.51	29.80	3.77	33.50	4.32	35.40	4.48
	10	18.90	2.30	22.50	2.79	26.20	3.30	28.00	3.57	29.80	3.84	33.50	4.39	35.40	4.54
	12	18.90	2.34	22.50	2.84	26.20	3.36	28.00	3.63	29.80	3.91	33.50	4.47	34.90	4.57
	14	18.90	2.38	22.50	2.89	26.20	3.43	28.00	3.70	29.80	3.98	33.50	4.56	34.50	4.63
	16	18.90	2.43	22.50	2.95	26.20	3.50	28.00	3.78	29.80	4.06	33.30	4.61	34.00	4.68
	18	18.90	2.47	22.50	3.00	26.20	3.56	28.00	3.85	29.80	4.14	32.90	4.76	33.60	4.80
	20	18.90	2.52	22.50	3.07	26.20	3.67	28.00	4.04	29.80	4.44	32.40	4.99	33.10	5.03
	21	18.90	2.54	22.50	3.09	26.20	3.80	28.00	4.19	29.80	4.59	32.20	5.11	32.90	5.15
	23	18.90	2.61	22.50	3.30	26.20	4.07	28.00	4.49	29.80	4.93	31.80	5.34	32.40	5.38
	25	18.90	2.78	22.50	3.52	26.20	4.36	28.00	4.81	29.80	5.28	31.30	5.57	32.00	5.62
	27	18.90	2.97	22.50	3.76	26.20	4.66	28.00	5.14	29.80	5.65	30.80	5.81	31.50	5.86
	29	18.90	3.15	22.50	4.01	26.20	4.97	28.00	5.49	29.70	6.00	30.40	6.05	31.10	6.09
	31	18.90	3.36	22.50	4.28	26.20	5.30	28.00	5.86	29.30	6.23	29.90	6.28	30.60	6.34
	33	18.90	3.57	22.50	4.56	26.20	5.65	28.00	6.26	28.80	6.46	29.50	6.52	30.20	6.58
35	18.90	3.79	22.50	4.85	26.20	6.03	28.00	6.67	28.30	6.70	29.00	6.76	29.70	6.81	
37	18.90	4.04	22.50	5.16	26.20	6.43	27.50	6.90	27.90	6.94	28.60	7.00	29.20	7.06	
39	18.90	4.29	22.50	5.48	26.20	6.84	27.10	7.14	27.40	7.17	28.10	7.24	28.80	7.31	
41	18.90	4.49	22.50	5.68	26.20	7.09	26.68	7.19	27.19	7.28	27.61	7.41	28.38	7.46	
43	18.90	4.69	22.50	5.88	26.20	7.22	26.26	7.27	26.99	7.35	27.78	7.46	27.88	7.54	
45	18.90	4.95	22.50	6.15	26.20	7.35	25.70	7.37	26.85	7.49	27.54	7.57	27.32	7.64	
48	19.57	5.17	23.30	6.37	27.14	7.36	25.52	7.46	27.77	7.62	26.78	7.65	27.68	7.71	

**Cooling capacity table**

MVUR280B-VA3

**TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature(°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
90%	-5	17.00	1.85	20.30	2.22	23.60	2.62	25.20	2.86	26.80	3.04	30.10	3.50	33.40	4.01
	-2	17.00	1.87	20.30	2.25	23.60	2.66	25.20	2.90	26.80	3.08	30.10	3.53	33.40	4.05
	0	17.00	1.90	20.30	2.27	23.60	2.70	25.20	2.93	26.80	3.12	30.10	3.57	33.40	4.08
	2	17.00	1.93	20.30	2.30	23.60	2.72	25.20	2.98	26.80	3.17	30.10	3.65	33.40	4.14
	4	17.00	1.96	20.30	2.34	23.60	2.77	25.20	3.02	26.80	3.21	30.10	3.70	33.40	4.20
	6	17.00	1.98	20.30	2.38	23.60	2.82	25.20	3.08	26.80	3.26	30.10	3.76	33.40	4.27
	8	17.00	2.02	20.30	2.43	23.60	2.88	25.20	3.12	26.80	3.32	30.10	3.83	33.40	4.31
	10	17.00	2.06	20.30	2.48	23.60	2.93	25.20	3.16	26.80	3.40	30.10	3.88	33.40	4.38
	12	17.00	2.09	20.30	2.53	23.60	2.98	25.20	3.22	26.80	3.46	30.10	3.96	33.40	4.46
	14	17.00	2.13	20.30	2.57	23.60	3.04	25.20	3.28	26.80	3.52	30.10	4.03	33.40	4.54
	16	17.00	2.17	20.30	2.62	23.60	3.10	25.20	3.34	26.80	3.60	30.10	4.11	33.30	4.62
	18	17.00	2.20	20.30	2.67	23.60	3.15	25.20	3.41	26.80	3.67	30.10	4.19	32.90	4.76
	20	17.00	2.25	20.30	2.73	23.60	3.22	25.20	3.48	26.80	3.80	30.10	4.50	32.40	4.99
	21	17.00	2.27	20.30	2.75	23.60	3.27	25.20	3.60	26.80	3.94	30.10	4.67	32.20	5.11
	23	17.00	2.31	20.30	2.86	23.60	3.51	25.20	3.86	26.80	4.22	30.10	5.01	31.70	5.34
	25	17.00	2.44	20.30	3.06	23.60	3.75	25.20	4.13	26.80	4.51	30.10	5.36	31.30	5.57
	27	17.00	2.59	20.30	3.25	23.60	4.00	25.20	4.40	26.80	4.83	30.10	5.73	30.80	5.81
	29	17.00	2.76	20.30	3.47	23.60	4.27	25.20	4.70	26.80	5.16	29.80	6.00	30.40	6.04
	31	17.00	2.93	20.30	3.69	23.60	4.55	25.20	5.02	26.80	5.50	29.30	6.23	29.90	6.28
	33	17.00	3.11	20.30	3.93	23.60	4.85	25.20	5.35	26.80	5.87	28.90	6.47	29.50	6.52
35	17.00	3.31	20.30	4.18	23.60	5.17	25.20	5.70	26.80	6.26	28.40	6.71	29.00	6.76	
37	17.00	3.51	20.30	4.44	23.60	5.50	25.20	6.07	26.80	6.67	27.90	6.94	28.60	6.99	
39	17.00	3.72	20.30	4.73	23.60	5.85	25.20	6.46	26.80	7.10	27.50	7.18	28.10	7.24	
41	17.00	3.85	20.30	4.94	23.60	6.07	25.20	6.63	26.80	7.14	27.31	7.36	27.91	7.41	
43	17.00	4.03	20.30	5.16	23.60	6.28	25.20	6.80	26.80	7.30	27.17	7.46	27.67	7.52	
45	17.00	4.29	20.30	5.41	23.60	6.54	25.20	7.03	26.80	7.50	27.02	7.54	27.25	7.62	
48	17.00	4.53	20.30	5.66	23.60	6.78	25.20	7.12	26.80	7.56	29.77	7.64	29.46	7.73	
80%	-5	15.10	1.63	18.00	1.93	20.90	2.28	22.40	2.43	23.90	2.62	26.80	3.02	29.70	3.45
	-2	15.10	1.66	18.00	1.95	20.90	2.30	22.40	2.47	23.90	2.64	26.80	3.05	29.70	3.49
	0	15.10	1.68	18.00	1.98	20.90	2.33	22.40	2.50	23.90	2.69	26.80	3.10	29.70	3.53
	2	15.10	1.72	18.00	2.01	20.90	2.37	22.40	2.54	23.90	2.74	26.80	3.16	29.70	3.60
	4	15.10	1.75	18.00	2.04	20.90	2.41	22.40	2.60	23.90	2.78	26.80	3.22	29.70	3.65
	6	15.10	1.78	18.00	2.09	20.90	2.45	22.40	2.66	23.90	2.84	26.80	3.26	29.70	3.71
	8	15.10	1.81	18.00	2.14	20.90	2.51	22.40	2.70	23.90	2.90	26.80	3.31	29.70	3.78
	10	15.10	1.82	18.00	2.18	20.90	2.57	22.40	2.77	23.90	2.97	26.80	3.39	29.70	3.82
	12	15.10	1.85	18.00	2.22	20.90	2.62	22.40	2.82	23.90	3.03	26.80	3.45	29.70	3.89
	14	15.10	1.89	18.00	2.27	20.90	2.66	22.40	2.87	23.90	3.08	26.80	3.51	29.70	3.96
	16	15.10	1.91	18.00	2.30	20.90	2.71	22.40	2.92	23.90	3.14	26.80	3.59	29.70	4.04
	18	15.10	1.95	18.00	2.35	20.90	2.77	22.40	2.98	23.90	3.20	26.80	3.66	29.70	4.12
	20	15.10	1.99	18.00	2.39	20.90	2.82	22.40	3.04	23.90	3.26	26.80	3.79	29.70	4.40
	21	15.10	2.00	18.00	2.41	20.90	2.85	22.40	3.07	23.90	3.34	26.80	3.93	29.70	4.57
	23	15.10	2.04	18.00	2.46	20.90	2.98	22.40	3.27	23.90	3.57	26.80	4.21	29.70	4.90
	25	15.10	2.10	18.00	2.62	20.90	3.19	22.40	3.50	23.90	3.81	26.80	4.50	29.70	5.24
	27	15.10	2.24	18.00	2.79	20.90	3.40	22.40	3.73	23.90	4.07	26.80	4.81	29.70	5.61
	29	15.10	2.38	18.00	2.97	20.90	3.62	22.40	3.97	23.90	4.35	26.80	5.13	29.70	6.00
	31	15.10	2.53	18.00	3.16	20.90	3.86	22.40	4.23	23.90	4.64	26.80	5.48	29.20	6.23
	33	15.10	2.69	18.00	3.35	20.90	4.11	22.40	4.51	23.90	4.94	26.80	5.84	28.80	6.46
35	15.10	2.85	18.00	3.57	20.90	4.37	22.40	4.80	23.90	5.26	26.80	6.23	28.30	6.70	
37	15.10	3.02	18.00	3.78	20.90	4.65	22.40	5.11	23.90	5.60	26.80	6.64	27.90	6.93	
39	15.10	3.20	18.00	4.04	20.90	4.94	22.40	5.44	23.90	5.96	26.80	7.07	27.40	7.17	
41	15.10	3.27	18.00	4.07	20.90	5.02	22.40	5.58	23.90	6.07	26.80	7.25	27.23	7.30	
43	15.10	3.37	18.00	4.11	20.90	5.09	22.40	5.68	23.90	6.15	26.80	7.34	27.06	7.38	
45	15.10	3.46	18.00	4.16	20.90	5.19	22.40	5.80	23.90	6.26	26.80	7.42	26.73	7.50	
48	15.10	3.58	18.00	4.19	23.51	5.27	22.40	5.88	23.90	6.31	26.80	7.49	29.82	7.60	

**Cooling capacity table**

MVUR280B-VA3

**TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature(°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC kW	PI kW	TC kW	PI kW	TC kW	PI kW	TC kW	PI kW	TC kW	PI kW	TC kW	PI kW	TC kW	PI kW
70%	-5	13.20	1.46	15.80	1.71	18.30	1.94	19.60	2.08	20.90	2.22	23.40	2.53	26.00	2.91
	-2	13.20	1.47	15.80	1.72	18.30	1.95	19.60	2.12	20.90	2.26	23.40	2.57	26.00	2.95
	0	13.20	1.48	15.80	1.74	18.30	1.99	19.60	2.16	20.90	2.30	23.40	2.63	26.00	2.99
	2	13.20	1.48	15.80	1.75	18.30	2.02	19.60	2.20	20.90	2.33	23.40	2.68	26.00	3.04
	4	13.20	1.50	15.80	1.79	18.30	2.06	19.60	2.24	20.90	2.39	23.40	2.73	26.00	3.11
	6	13.20	1.53	15.80	1.82	18.30	2.12	19.60	2.31	20.90	2.44	23.40	2.77	26.00	3.17
	8	13.20	1.56	15.80	1.88	18.30	2.16	19.60	2.34	20.90	2.49	23.40	2.85	26.00	3.23
	10	13.20	1.59	15.80	1.91	18.30	2.22	19.60	2.39	20.90	2.56	23.40	2.91	26.00	3.27
	12	13.20	1.63	15.80	1.93	18.30	2.27	19.60	2.44	20.90	2.61	23.40	2.97	26.00	3.34
	14	13.20	1.65	15.80	1.97	18.30	2.30	19.60	2.47	20.90	2.65	23.40	3.02	26.00	3.40
	16	13.20	1.68	15.80	2.00	18.30	2.35	19.60	2.53	20.90	2.71	23.40	3.07	26.00	3.46
	18	13.20	1.71	15.80	2.04	18.30	2.39	19.60	2.57	20.90	2.75	23.40	3.14	26.00	3.53
	20	13.20	1.74	15.80	2.08	18.30	2.44	19.60	2.62	20.90	2.80	23.40	3.20	26.00	3.63
	21	13.20	1.75	15.80	2.09	18.30	2.45	19.60	2.64	20.90	2.83	23.40	3.25	26.00	3.76
	23	13.20	1.78	15.80	2.13	18.30	2.51	19.60	2.73	20.90	2.98	23.40	3.48	26.00	4.03
	25	13.20	1.82	15.80	2.22	18.30	2.67	19.60	2.92	20.90	3.17	23.40	3.72	26.00	4.31
	27	13.20	1.92	15.80	2.36	18.30	2.85	19.60	3.11	20.90	3.39	23.40	3.97	26.00	4.60
	29	13.20	2.04	15.80	2.51	18.30	3.03	19.60	3.32	20.90	3.60	23.40	4.23	26.00	4.92
	31	13.20	2.16	15.80	2.66	18.30	3.23	19.60	3.52	20.90	3.84	23.40	4.51	26.00	5.24
	33	13.20	2.29	15.80	2.83	18.30	3.43	19.60	3.75	20.90	4.09	23.40	4.81	26.00	5.59
35	13.20	2.43	15.80	3.00	18.30	3.64	19.60	3.99	20.90	4.35	23.40	5.12	26.00	5.96	
37	13.20	2.56	15.80	3.18	18.30	3.87	19.60	4.23	20.90	4.63	23.40	5.46	26.00	6.35	
39	13.20	2.71	15.80	3.37	18.30	4.11	19.60	4.50	20.90	4.92	23.40	5.80	26.00	6.76	
41	13.20	2.83	15.80	3.49	18.30	4.23	19.60	4.65	20.90	5.07	23.40	6.04	26.00	7.06	
43	13.20	3.07	15.80	3.73	18.30	4.40	19.60	4.90	20.90	5.22	23.40	6.26	26.00	7.28	
45	13.20	3.13	15.80	3.81	18.30	4.49	19.60	4.98	20.90	5.48	23.40	6.60	26.00	7.56	
48	13.20	3.21	15.80	3.84	18.30	4.54	19.60	5.06	20.90	5.63	23.40	6.89	26.00	7.74	
60%	-5	11.30	1.24	13.50	1.44	15.70	1.68	16.80	1.79	17.90	1.93	20.10	2.17	22.30	2.49
	-2	11.30	1.25	13.50	1.46	15.70	1.71	16.80	1.82	17.90	1.95	20.10	2.20	22.30	2.51
	0	11.30	1.27	13.50	1.48	15.70	1.73	16.80	1.84	17.90	1.98	20.10	2.24	22.30	2.54
	2	11.30	1.29	13.50	1.52	15.70	1.77	16.80	1.87	17.90	2.01	20.10	2.28	22.30	2.57
	4	11.30	1.33	13.50	1.55	15.70	1.80	16.80	1.90	17.90	2.04	20.10	2.32	22.30	2.61
	6	11.30	1.34	13.50	1.57	15.70	1.83	16.80	1.94	17.90	2.08	20.10	2.36	22.30	2.67
	8	11.30	1.37	13.50	1.60	15.70	1.87	16.80	1.98	17.90	2.12	20.10	2.41	22.30	2.71
	10	11.30	1.39	13.50	1.64	15.70	1.90	16.80	2.03	17.90	2.17	20.10	2.45	22.30	2.75
	12	11.30	1.42	13.50	1.66	15.70	1.93	16.80	2.07	17.90	2.20	20.10	2.50	22.30	2.80
	14	11.30	1.44	13.50	1.69	15.70	1.96	16.80	2.10	17.90	2.25	20.10	2.54	22.30	2.85
	16	11.30	1.46	13.50	1.72	15.70	2.00	16.80	2.14	17.90	2.28	20.10	2.59	22.30	2.90
	18	11.30	1.48	13.50	1.74	15.70	2.03	16.80	2.18	17.90	2.33	20.10	2.63	22.30	2.96
	20	11.30	1.50	13.50	1.78	15.70	2.07	16.80	2.22	17.90	2.37	20.10	2.69	22.30	3.02
	21	11.30	1.52	13.50	1.79	15.70	2.09	16.80	2.24	17.90	2.39	20.10	2.71	22.30	3.05
	23	11.30	1.54	13.50	1.82	15.70	2.12	16.80	2.28	17.90	2.44	20.10	2.82	22.30	3.24
	25	11.30	1.56	13.50	1.85	15.70	2.20	16.80	2.39	17.90	2.59	20.10	3.01	22.30	3.46
	27	11.30	1.63	13.50	1.97	15.70	2.35	16.80	2.55	17.90	2.76	20.10	3.21	22.30	3.69
	29	11.30	1.72	13.50	2.09	15.70	2.50	16.80	2.71	17.90	2.94	20.10	3.42	22.30	3.95
	31	11.30	1.82	13.50	2.21	15.70	2.65	16.80	2.88	17.90	3.13	20.10	3.64	22.30	4.20
	33	11.30	1.92	13.50	2.35	15.70	2.81	16.80	3.06	17.90	3.33	20.10	3.87	22.30	4.48
35	11.30	2.04	13.50	2.49	15.70	2.98	16.80	3.25	17.90	3.53	20.10	4.13	22.30	4.76	
37	11.30	2.16	13.50	2.63	15.70	3.16	16.80	3.45	17.90	3.75	20.10	4.39	22.30	5.07	
39	11.30	2.27	13.50	2.79	15.70	3.35	16.80	3.66	17.90	3.98	20.10	4.66	22.30	5.39	
41	11.30	2.35	13.50	2.91	15.70	3.47	16.80	3.80	17.90	4.13	20.10	4.88	22.30	5.64	
43	11.30	2.42	13.50	3.03	15.70	3.60	16.80	3.92	17.90	4.27	20.10	5.08	22.30	5.88	
45	11.30	2.53	13.50	3.18	15.70	3.74	16.80	4.06	17.90	4.48	20.10	5.31	22.30	6.21	
48	11.30	2.63	13.50	3.32	15.70	3.87	16.80	4.17	17.90	4.66	20.10	5.50	22.30	6.50	

**Cooling capacity table**

MVUR280B-VA3

**TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature(°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
50%	-5	9.45	1.08	11.30	1.25	13.10	1.43	14.00	1.50	14.90	1.58	16.70	1.80	18.60	1.94
	-2	9.45	1.09	11.30	1.27	13.10	1.45	14.00	1.52	14.90	1.61	16.70	1.83	18.60	1.97
	0	9.45	1.11	11.30	1.29	13.10	1.48	14.00	1.54	14.90	1.63	16.70	1.86	18.60	2.00
	2	9.45	1.12	11.30	1.31	13.10	1.50	14.00	1.57	14.90	1.66	16.70	1.86	18.60	2.04
	4	9.45	1.13	11.30	1.33	13.10	1.52	14.00	1.58	14.90	1.69	16.70	1.91	18.60	2.09
	6	9.45	1.15	11.30	1.35	13.10	1.54	14.00	1.62	14.90	1.72	16.70	1.94	18.60	2.15
	8	9.45	1.18	11.30	1.38	13.10	1.57	14.00	1.66	14.90	1.75	16.70	1.97	18.60	2.22
	10	9.45	1.20	11.30	1.39	13.10	1.59	14.00	1.68	14.90	1.80	16.70	2.02	18.60	2.26
	12	9.45	1.21	11.30	1.41	13.10	1.62	14.00	1.72	14.90	1.83	16.70	2.06	18.60	2.29
	14	9.45	1.23	11.30	1.43	13.10	1.64	14.00	1.75	14.90	1.86	16.70	2.09	18.60	2.34
	16	9.45	1.25	11.30	1.45	13.10	1.66	14.00	1.78	14.90	1.89	16.70	2.13	18.60	2.37
	18	9.45	1.27	11.30	1.47	13.10	1.69	14.00	1.81	14.90	1.92	16.70	2.17	18.60	2.42
	20	9.45	1.29	11.30	1.49	13.10	1.72	14.00	1.83	14.90	1.96	16.70	2.20	18.60	2.46
	21	9.45	1.29	11.30	1.51	13.10	1.73	14.00	1.85	14.90	1.98	16.70	2.23	18.60	2.49
	23	9.45	1.31	11.30	1.53	13.10	1.76	14.00	1.89	14.90	2.01	16.70	2.27	18.60	2.54
	25	9.45	1.33	11.30	1.55	13.10	1.80	14.00	1.92	14.90	2.08	16.70	2.38	18.60	2.71
	27	9.45	1.36	11.30	1.62	13.10	1.90	14.00	2.05	14.90	2.20	16.70	2.53	18.60	2.89
	29	9.45	1.43	11.30	1.71	13.10	2.01	14.00	2.18	14.90	2.35	16.70	2.70	18.60	3.08
	31	9.45	1.51	11.30	1.81	13.10	2.13	14.00	2.31	14.90	2.49	16.70	2.87	18.60	3.28
	33	9.45	1.60	11.30	1.91	13.10	2.27	14.00	2.44	14.90	2.64	16.70	3.05	18.60	3.49
35	9.45	1.69	11.30	2.02	13.10	2.39	14.00	2.59	14.90	2.80	16.70	3.24	18.60	3.70	
37	9.45	1.78	11.30	2.14	13.10	2.53	14.00	2.74	14.90	2.97	16.70	3.43	18.60	3.94	
39	9.45	1.88	11.30	2.26	13.10	2.68	14.00	2.90	14.90	3.15	16.70	3.64	18.60	4.18	
41	9.45	1.96	11.30	2.35	13.10	2.78	14.00	3.04	14.90	3.28	16.70	3.83	18.60	4.37	
43	9.45	2.09	11.30	2.51	13.10	2.87	14.00	3.17	14.90	3.37	16.70	4.03	18.60	4.57	
45	9.45	2.13	11.30	2.58	13.10	3.07	14.00	3.42	14.90	3.51	16.70	4.42	18.60	4.96	
48	9.45	2.18	11.30	2.65	13.10	3.25	14.00	3.64	14.90	3.66	16.70	4.77	18.60	5.33	

**Cooling capacity table**

MVUR335B-VA3

TC: Total Capacity (kW); PI: Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature(°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
130%	-5	29.43	3.30	35.05	4.03	40.68	4.32	42.23	4.49	44.26	4.62	45.34	5.02	46.48	5.05
	-2	29.43	3.30	35.05	4.10	40.68	4.32	42.23	4.52	44.26	4.62	45.34	5.09	46.48	5.10
	0	29.43	3.36	35.05	4.18	40.68	4.47	42.23	4.77	44.26	4.89	45.34	5.15	46.48	5.17
	2	29.43	3.42	35.05	4.18	40.68	4.63	42.23	5.03	44.26	4.94	45.34	5.19	46.48	5.25
	4	29.43	3.49	35.05	4.27	40.68	4.79	42.23	5.06	44.26	5.01	45.34	5.18	46.48	5.35
	6	29.43	3.56	35.05	4.35	40.68	4.96	42.23	5.10	43.77	5.16	44.79	5.18	45.97	5.39
	8	29.43	3.64	35.05	4.45	40.68	5.21	42.23	5.35	43.23	5.33	44.30	3.90	45.39	5.44
	10	29.43	3.72	35.05	4.55	40.68	5.41	42.23	5.53	42.71	4.04	43.79	4.06	44.86	5.60
	12	29.43	3.79	35.05	4.63	40.68	5.51	41.63	4.03	42.23	4.06	43.19	4.07	44.27	5.63
	14	29.43	3.86	35.05	4.72	40.56	4.05	41.16	4.06	41.63	4.08	42.71	4.09	43.79	5.76
	16	29.43	3.93	35.05	4.82	40.08	4.06	40.56	4.08	41.04	4.10	42.11	4.12	43.19	5.85
	18	29.43	4.00	35.05	4.92	39.48	5.76	39.96	5.80	40.56	5.83	41.63	5.88	42.71	5.94
	20	29.43	4.09	35.05	5.23	38.88	6.05	39.48	6.08	39.96	6.11	41.04	6.17	42.11	6.23
	21	29.43	4.20	35.05	5.42	38.64	6.19	39.24	6.22	39.72	6.25	40.80	6.32	41.87	6.37
	23	29.43	4.50	35.05	5.81	38.16	6.47	38.64	6.50	39.12	6.54	40.20	6.60	41.27	6.67
	25	29.43	4.81	35.05	6.22	37.57	6.75	38.04	6.79	38.64	6.83	39.72	6.90	40.80	6.96
	27	29.43	5.13	35.05	6.66	37.09	7.04	37.57	7.08	38.04	7.11	39.12	7.19	40.20	7.27
	29	29.43	5.48	35.05	7.11	36.49	7.32	36.97	7.36	37.57	7.41	38.64	7.48	39.72	7.56
	31	29.43	5.85	34.94	7.53	35.89	7.61	36.49	7.66	36.97	7.69	38.04	7.78	39.12	7.86
	33	29.43	6.23	34.33	7.81	35.41	7.90	35.89	7.94	36.49	7.98	37.57	8.07	38.52	8.16
	35	29.43	6.65	33.74	8.09	34.81	8.19	35.41	8.23	35.89	8.28	36.97	8.38	38.04	8.46
37	29.43	7.07	33.26	8.39	34.34	8.48	34.81	8.53	35.41	8.58	36.37	8.68	37.45	8.78	
39	29.43	7.53	32.66	8.47	33.74	8.77	34.34	8.82	34.81	8.88	35.89	8.97	36.97	9.08	
41	29.43	7.92	32.32	8.56	33.38	8.85	33.98	8.90	34.46	8.96	35.54	8.99	35.55	9.16	
43	29.43	8.12	32.09	8.60	33.21	8.87	33.81	8.94	34.11	8.97	34.89	9.01	35.13	9.18	
45	29.43	8.53	31.89	8.68	32.85	8.96	33.45	9.00	33.61	9.01	33.94	9.04	34.44	9.36	
48	29.43	8.83	33.02	8.96	35.82	9.04	36.48	9.08	36.77	9.11	36.61	9.20	37.28	9.22	
120%	-5	27.16	3.19	32.30	3.86	37.57	4.56	40.20	4.98	42.11	5.19	43.07	5.35	44.03	5.50
	-2	27.16	3.22	32.30	3.90	37.57	4.61	40.20	5.01	42.11	5.25	43.07	5.40	44.03	5.52
	0	27.16	3.25	32.30	3.93	37.57	4.66	40.20	5.02	42.11	5.30	43.07	5.43	44.03	5.53
	2	27.16	3.26	32.30	3.97	37.57	4.69	40.20	5.07	42.11	5.32	43.07	5.47	44.03	5.54
	4	27.16	3.29	32.30	4.02	37.57	4.76	40.20	5.11	42.11	5.39	43.07	5.48	44.03	5.55
	6	27.16	3.32	32.30	4.05	37.57	4.82	40.20	5.17	42.11	5.45	43.07	5.53	44.03	5.57
	8	27.16	3.35	32.30	4.09	37.57	4.88	40.20	5.23	42.11	5.50	43.07	5.55	44.03	5.60
	10	27.16	3.39	32.30	4.14	37.57	4.93	40.20	5.33	42.11	5.50	43.07	5.56	44.03	5.62
	12	27.16	3.46	32.30	4.22	37.57	5.02	40.20	5.43	41.52	5.53	42.47	5.53	43.43	5.66
	14	27.16	3.52	32.30	4.31	37.57	5.12	40.20	5.54	40.92	5.56	41.99	5.61	42.95	5.73
	16	27.16	3.59	32.30	4.39	37.57	5.22	39.96	4.10	40.44	5.64	41.40	5.71	42.35	5.81
	18	27.16	3.65	32.30	4.48	37.57	5.39	39.36	5.76	39.84	5.79	40.80	5.84	41.87	5.89
	20	27.16	3.73	32.30	4.65	37.57	5.81	38.88	6.05	39.36	6.07	40.32	6.12	41.28	6.18
	21	27.16	3.76	32.30	4.82	37.57	6.01	38.52	6.19	39.00	6.21	40.08	6.27	41.04	6.33
	23	27.16	4.02	32.30	5.17	37.57	6.44	38.05	6.46	38.52	6.49	39.48	6.56	40.44	6.61
	25	27.16	4.30	32.30	5.52	36.97	6.72	37.45	6.74	37.93	6.78	39.00	6.84	39.96	6.91
	27	27.16	4.59	32.30	5.91	36.49	6.99	36.97	7.04	37.45	7.07	38.40	7.13	39.36	7.20
	29	27.16	4.89	32.30	6.31	35.89	7.28	36.37	7.32	36.85	7.35	37.81	7.43	38.88	7.49
	31	27.16	5.22	32.30	6.73	35.29	7.57	35.89	7.60	36.37	7.65	37.33	7.72	38.28	7.80
	33	27.16	5.56	32.30	7.18	34.81	7.85	35.29	7.90	35.77	7.93	36.73	8.02	37.69	8.09
	35	27.16	5.92	32.30	7.66	34.22	8.13	34.70	8.18	35.29	8.22	36.25	8.31	37.21	8.40
37	27.16	6.30	32.30	8.16	33.74	8.43	34.22	8.47	34.70	8.52	35.65	8.60	36.61	8.70	
39	27.16	6.70	32.18	8.61	33.14	8.71	33.62	8.77	34.10	8.81	35.17	8.91	36.13	8.99	
41	27.16	6.88	31.92	8.68	32.88	8.77	33.36	8.83	33.84	8.87	34.91	8.93	35.09	9.06	
43	27.16	6.99	31.75	8.74	32.62	8.83	33.10	8.86	33.58	8.90	34.31	8.96	34.55	9.24	
45	27.16	7.07	31.58	8.82	32.31	8.91	32.75	8.94	33.28	8.97	33.61	8.98	34.20	9.44	
48	27.16	7.12	36.28	8.92	36.95	8.99	37.34	9.01	38.14	9.04	38.34	9.02	39.10	9.56	

**Cooling capacity table**

MVUR335B-VA3

**TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature (°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
110%	-5	24.89	2.78	29.67	3.46	34.46	4.13	36.85	4.44	39.24	4.77	42.24	4.96	43.19	5.11
	-2	24.89	2.84	29.67	3.51	34.46	4.17	36.85	4.48	39.24	4.81	42.24	5.01	43.19	5.14
	0	24.89	2.86	29.67	3.53	34.46	4.20	36.85	4.51	39.24	4.86	42.24	5.06	43.19	5.20
	2	24.89	2.93	29.67	3.56	34.46	4.27	36.85	4.56	39.24	4.92	42.24	5.13	43.19	5.26
	4	24.89	2.99	29.67	3.60	34.46	4.31	36.85	4.61	39.24	4.99	42.24	5.20	43.19	5.31
	6	24.89	3.01	29.67	3.64	34.46	4.35	36.85	4.69	39.24	5.05	42.24	5.25	43.19	5.39
	8	24.89	3.04	29.67	3.70	34.46	4.40	36.85	4.74	39.24	5.10	42.24	5.29	43.19	5.45
	10	24.89	3.08	29.67	3.75	34.46	4.46	36.85	4.82	39.24	5.19	42.24	5.33	43.19	5.50
	12	24.89	3.14	29.67	3.83	34.46	4.55	36.85	4.92	39.24	5.29	41.76	5.41	42.59	5.57
	14	24.89	3.20	29.67	3.89	34.46	4.63	36.85	5.00	39.24	5.38	41.16	5.45	42.12	5.61
	16	24.89	3.25	29.67	3.97	34.46	4.72	36.85	5.10	39.24	5.49	40.68	5.51	41.52	5.67
	18	24.89	3.32	29.67	4.05	34.46	4.82	36.85	5.24	39.24	5.75	40.08	5.80	41.04	5.85
	20	24.89	3.38	29.67	4.13	34.46	5.10	36.85	5.63	38.65	6.04	39.60	6.08	40.44	6.13
	21	24.89	3.41	29.67	4.25	34.46	5.29	36.85	5.84	38.41	6.18	39.25	6.22	40.20	6.28
	23	24.89	3.58	29.67	4.56	34.46	5.67	36.85	6.27	37.81	6.45	38.77	6.51	39.60	6.57
	25	24.89	3.82	29.67	4.87	34.46	6.06	36.85	6.71	37.33	6.73	38.17	6.80	39.12	6.85
	27	24.89	4.07	29.67	5.21	34.46	6.48	36.25	6.99	36.73	7.02	37.69	7.08	38.53	7.15
	29	24.89	4.34	29.67	5.56	34.46	6.93	35.77	7.28	36.25	7.31	37.09	7.37	38.05	7.44
	31	24.89	4.62	29.67	5.93	34.46	7.40	35.18	7.56	35.65	7.59	36.61	7.66	37.45	7.73
	33	24.89	4.92	29.67	6.32	34.22	7.80	34.70	7.84	35.18	7.87	36.01	7.95	36.97	8.03
35	24.89	5.23	29.67	6.73	33.62	8.08	34.10	8.12	34.58	8.17	35.42	8.24	36.37	8.32	
37	24.89	5.57	29.67	7.17	33.14	8.38	33.62	8.41	33.98	8.45	34.94	8.54	35.77	8.61	
39	24.89	5.92	29.67	7.64	32.54	8.66	33.02	8.70	33.50	8.74	34.34	8.83	35.30	8.92	
41	24.89	5.98	29.67	7.70	32.29	8.72	32.77	8.76	33.25	8.81	33.90	8.89	34.23	8.98	
43	24.89	6.04	29.67	7.80	32.03	8.78	32.51	8.82	32.99	8.87	33.60	8.93	33.71	9.16	
45	24.89	6.23	29.67	7.84	31.71	8.86	32.17	8.93	32.70	8.95	33.26	9.17	33.39	9.37	
48	27.25	6.45	32.50	8.50	34.22	8.92	34.67	8.99	35.40	9.04	35.82	9.20	36.10	9.48	
100%	-5	22.61	2.53	26.92	3.05	31.35	3.63	33.50	3.89	35.65	4.22	40.08	4.81	42.35	5.02
	-2	22.61	2.56	26.92	3.09	31.35	3.67	33.50	3.96	35.65	4.28	40.08	4.87	42.35	5.05
	0	22.61	2.59	26.92	3.12	31.35	3.71	33.50	4.01	35.65	4.32	40.08	4.95	42.35	5.11
	2	22.61	2.64	26.92	3.17	31.35	3.75	33.50	4.06	35.65	4.37	40.08	5.02	42.35	5.19
	4	22.61	2.66	26.92	3.20	31.35	3.81	33.50	4.12	35.65	4.42	40.08	5.07	42.35	5.25
	6	22.61	2.70	26.92	3.26	31.35	3.86	33.50	4.20	35.65	4.49	40.08	5.14	42.35	5.33
	8	22.61	2.75	26.92	3.31	31.35	3.93	33.50	4.24	35.65	4.56	40.08	5.22	42.35	5.41
	10	22.61	2.78	26.92	3.37	31.35	3.99	33.50	4.32	35.65	4.64	40.08	5.31	42.35	5.49
	12	22.61	2.83	26.92	3.44	31.35	4.07	33.50	4.39	35.65	4.73	40.08	5.41	41.75	5.54
	14	22.61	2.88	26.92	3.50	31.35	4.14	33.50	4.48	35.65	4.82	40.08	5.51	41.28	5.60
	16	22.61	2.94	26.92	3.57	31.35	4.23	33.50	4.57	35.65	4.92	39.84	5.58	40.68	5.67
	18	22.61	2.99	26.92	3.63	31.35	4.31	33.50	4.65	35.65	5.01	39.36	5.76	40.20	5.81
	20	22.61	3.05	26.92	3.71	31.35	4.44	33.50	4.89	35.65	5.37	38.76	6.04	39.60	6.09
	21	22.61	3.08	26.92	3.74	31.35	4.60	33.50	5.07	35.65	5.56	38.53	6.18	39.36	6.23
	23	22.61	3.15	26.92	3.99	31.35	4.93	33.50	5.43	35.65	5.96	38.05	6.46	38.76	6.51
	25	22.61	3.36	26.92	4.26	31.35	5.27	33.50	5.82	35.65	6.38	37.45	6.74	38.28	6.80
	27	22.61	3.59	26.92	4.55	31.35	5.63	33.50	6.22	35.65	6.83	36.85	7.03	37.69	7.09
	29	22.61	3.82	26.92	4.85	31.35	6.01	33.50	6.65	35.53	7.25	36.37	7.32	37.21	7.37
	31	22.61	4.07	26.92	5.18	31.35	6.42	33.50	7.09	35.05	7.54	35.77	7.60	36.61	7.67
	33	22.61	4.32	26.92	5.51	31.35	6.84	33.50	7.57	34.46	7.82	35.30	7.89	36.13	7.96
35	22.61	4.59	26.92	5.86	31.35	7.30	33.50	8.07	33.86	8.10	34.70	8.18	35.53	8.24	
37	22.61	4.88	26.92	6.24	31.35	7.78	32.90	8.35	33.38	8.40	34.22	8.47	34.94	8.54	
39	22.61	5.19	26.92	6.63	31.35	8.28	32.42	8.64	32.78	8.68	33.62	8.76	34.46	8.84	
41	22.61	5.43	26.92	6.88	31.35	8.58	31.92	8.70	32.53	8.81	33.04	8.96	33.96	9.02	
43	22.61	5.67	26.92	7.12	31.35	8.74	31.42	8.80	32.29	8.90	33.23	9.02	33.36	9.12	
45	22.61	5.99	26.92	7.44	31.35	8.89	30.75	8.92	32.13	9.06	32.95	9.16	32.69	9.25	
48	23.42	6.26	27.88	7.70	32.47	8.90	30.53	9.02	33.22	9.22	32.05	9.25	33.11	9.33	

**Cooling capacity table**

MVUR335B-VA3

TC: Total Capacity (kW); PI: Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature(°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC kW	PI kW	TC kW	PI kW	TC kW	PI kW	TC kW	PI kW	TC kW	PI kW	TC kW	PI kW	TC kW	PI kW
90%	-5	20.34	2.24	24.29	2.69	28.24	3.17	30.15	3.46	32.06	3.68	36.01	4.23	39.96	4.85
	-2	20.34	2.26	24.29	2.72	28.24	3.21	30.15	3.51	32.06	3.73	36.01	4.27	39.96	4.90
	0	20.34	2.30	24.29	2.75	28.24	3.26	30.15	3.55	32.06	3.77	36.01	4.32	39.96	4.93
	2	20.34	2.33	24.29	2.79	28.24	3.30	30.15	3.61	32.06	3.83	36.01	4.41	39.96	5.01
	4	20.34	2.37	24.29	2.83	28.24	3.35	30.15	3.65	32.06	3.88	36.01	4.48	39.96	5.08
	6	20.34	2.40	24.29	2.88	28.24	3.41	30.15	3.72	32.06	3.95	36.01	4.55	39.96	5.16
	8	20.34	2.44	24.29	2.94	28.24	3.48	30.15	3.77	32.06	4.02	36.01	4.64	39.96	5.21
	10	20.34	2.49	24.29	3.00	28.24	3.55	30.15	3.83	32.06	4.11	36.01	4.70	39.96	5.30
	12	20.34	2.53	24.29	3.06	28.24	3.61	30.15	3.89	32.06	4.19	36.01	4.79	39.96	5.39
	14	20.34	2.58	24.29	3.11	28.24	3.68	30.15	3.97	32.06	4.26	36.01	4.87	39.96	5.49
	16	20.34	2.62	24.29	3.16	28.24	3.75	30.15	4.05	32.06	4.35	36.01	4.97	39.84	5.59
	18	20.34	2.66	24.29	3.23	28.24	3.82	30.15	4.12	32.06	4.44	36.01	5.07	39.36	5.76
	20	20.34	2.72	24.29	3.30	28.24	3.89	30.15	4.21	32.06	4.60	36.01	5.45	38.76	6.04
	21	20.34	2.74	24.29	3.33	28.24	3.96	30.15	4.35	32.06	4.76	36.01	5.64	38.53	6.18
	23	20.34	2.80	24.29	3.46	28.24	4.24	30.15	4.67	32.06	5.11	36.01	6.06	37.93	6.46
	25	20.34	2.95	24.29	3.70	28.24	4.53	30.15	4.99	32.06	5.46	36.01	6.48	37.45	6.74
	27	20.34	3.13	24.29	3.94	28.24	4.84	30.15	5.33	32.06	5.84	36.01	6.94	36.85	7.03
	29	20.34	3.34	24.29	4.20	28.24	5.17	30.15	5.69	32.06	6.24	35.65	7.25	36.37	7.31
	31	20.34	3.55	24.29	4.47	28.24	5.50	30.15	6.07	32.06	6.66	35.06	7.54	35.77	7.60
	33	20.34	3.76	24.29	4.75	28.24	5.87	30.15	6.47	32.06	7.10	34.58	7.83	35.29	7.88
35	20.34	4.00	24.29	5.06	28.24	6.25	30.15	6.90	32.06	7.57	33.98	8.11	34.70	8.18	
37	20.34	4.24	24.29	5.37	28.24	6.66	30.15	7.34	32.06	8.07	33.38	8.40	34.22	8.46	
39	20.34	4.50	24.29	5.72	28.24	7.08	30.15	7.82	32.06	8.59	32.90	8.69	33.62	8.75	
41	20.34	4.66	24.29	5.98	28.24	7.34	30.15	8.03	32.06	8.64	32.67	8.91	33.39	8.96	
43	20.34	4.88	24.29	6.24	28.24	7.60	30.15	8.23	32.06	8.83	32.51	9.03	33.11	9.10	
45	20.34	5.19	24.29	6.55	28.24	7.91	30.15	8.51	32.06	9.07	32.32	9.12	32.60	9.22	
48	20.34	5.48	24.29	6.85	28.24	8.21	30.15	8.62	32.06	9.15	35.61	9.25	35.24	9.35	
80%	-5	18.07	1.97	21.54	2.33	25.00	2.76	26.80	2.94	28.60	3.17	32.06	3.66	35.53	4.18
	-2	18.07	2.00	21.54	2.36	25.00	2.79	26.80	2.99	28.60	3.19	32.06	3.69	35.53	4.22
	0	18.07	2.04	21.54	2.39	25.00	2.82	26.80	3.02	28.60	3.25	32.06	3.75	35.53	4.27
	2	18.07	2.08	21.54	2.43	25.00	2.86	26.80	3.08	28.60	3.31	32.06	3.82	35.53	4.36
	4	18.07	2.11	21.54	2.47	25.00	2.92	26.80	3.15	28.60	3.37	32.06	3.89	35.53	4.41
	6	18.07	2.15	21.54	2.53	25.00	2.96	26.80	3.22	28.60	3.43	32.06	3.95	35.53	4.49
	8	18.07	2.19	21.54	2.58	25.00	3.03	26.80	3.27	28.60	3.51	32.06	4.01	35.53	4.58
	10	18.07	2.21	21.54	2.64	25.00	3.11	26.80	3.35	28.60	3.59	32.06	4.10	35.53	4.62
	12	18.07	2.24	21.54	2.69	25.00	3.16	26.80	3.42	28.60	3.67	32.06	4.18	35.53	4.71
	14	18.07	2.28	21.54	2.74	25.00	3.22	26.80	3.47	28.60	3.73	32.06	4.25	35.53	4.80
	16	18.07	2.32	21.54	2.78	25.00	3.28	26.80	3.53	28.60	3.80	32.06	4.34	35.53	4.88
	18	18.07	2.36	21.54	2.84	25.00	3.35	26.80	3.61	28.60	3.87	32.06	4.43	35.53	4.98
	20	18.07	2.40	21.54	2.89	25.00	3.42	26.80	3.68	28.60	3.95	32.06	4.59	35.53	5.33
	21	18.07	2.43	21.54	2.92	25.00	3.45	26.80	3.72	28.60	4.04	32.06	4.75	35.53	5.53
	23	18.07	2.47	21.54	2.98	25.00	3.61	26.80	3.96	28.60	4.32	32.06	5.09	35.53	5.93
	25	18.07	2.55	21.54	3.16	25.00	3.86	26.80	4.23	28.60	4.61	32.06	5.45	35.53	6.34
	27	18.07	2.71	21.54	3.37	25.00	4.11	26.80	4.51	28.60	4.93	32.06	5.82	35.53	6.79
	29	18.07	2.88	21.54	3.59	25.00	4.38	26.80	4.81	28.60	5.26	32.06	6.21	35.53	7.25
	31	18.07	3.06	21.54	3.82	25.00	4.67	26.80	5.12	28.60	5.61	32.06	6.63	34.94	7.54
	33	18.07	3.25	21.54	4.06	25.00	4.97	26.80	5.46	28.60	5.97	32.06	7.07	34.46	7.82
35	18.07	3.45	21.54	4.32	25.00	5.29	26.80	5.81	28.60	6.36	32.06	7.54	33.86	8.10	
37	18.07	3.65	21.54	4.58	25.00	5.62	26.80	6.19	28.60	6.78	32.06	8.04	33.38	8.39	
39	18.07	3.87	21.54	4.88	25.00	5.98	26.80	6.58	28.60	7.21	32.06	8.56	32.78	8.68	
41	18.07	3.96	21.54	4.93	25.00	6.07	26.80	6.75	28.60	7.34	32.06	8.78	32.58	8.83	
43	18.07	4.08	21.54	4.97	25.00	6.16	26.80	6.87	28.60	7.44	32.06	8.88	32.38	8.93	
45	18.07	4.19	21.54	5.03	25.00	6.28	26.80	7.02	28.60	7.57	32.06	8.98	31.98	9.07	
48	18.07	4.33	21.54	5.06	28.13	6.37	26.80	7.11	28.60	7.64	32.06	9.07	35.67	9.20	

**Cooling capacity table**

MVUR335B-VA3

**TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature(°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC kW	PI kW	TC kW	PI kW	TC kW	PI kW	TC kW	PI kW	TC kW	PI kW	TC kW	PI kW	TC kW	PI kW
70%	-5	15.79	1.76	18.90	2.07	21.90	2.34	23.45	2.51	25.00	2.68	28.00	3.07	31.11	3.53
	-2	15.79	1.78	18.90	2.08	21.90	2.36	23.45	2.56	25.00	2.73	28.00	3.11	31.11	3.57
	0	15.79	1.79	18.90	2.11	21.90	2.40	23.45	2.61	25.00	2.78	28.00	3.18	31.11	3.62
	2	15.79	1.80	18.90	2.12	21.90	2.44	23.45	2.66	25.00	2.83	28.00	3.25	31.11	3.68
	4	15.79	1.82	18.90	2.17	21.90	2.50	23.45	2.70	25.00	2.89	28.00	3.30	31.11	3.77
	6	15.79	1.85	18.90	2.21	21.90	2.56	23.45	2.79	25.00	2.96	28.00	3.36	31.11	3.84
	8	15.79	1.88	18.90	2.27	21.90	2.62	23.45	2.83	25.00	3.02	28.00	3.45	31.11	3.91
	10	15.79	1.92	18.90	2.31	21.90	2.69	23.45	2.89	25.00	3.10	28.00	3.52	31.11	3.96
	12	15.79	1.97	18.90	2.34	21.90	2.74	23.45	2.95	25.00	3.15	28.00	3.59	31.11	4.04
	14	15.79	2.00	18.90	2.38	21.90	2.78	23.45	2.99	25.00	3.21	28.00	3.65	31.11	4.11
	16	15.79	2.03	18.90	2.43	21.90	2.84	23.45	3.06	25.00	3.27	28.00	3.72	31.11	4.19
	18	15.79	2.07	18.90	2.47	21.90	2.89	23.45	3.11	25.00	3.33	28.00	3.80	31.11	4.27
	20	15.79	2.10	18.90	2.51	21.90	2.95	23.45	3.16	25.00	3.39	28.00	3.87	31.11	4.39
	21	15.79	2.12	18.90	2.53	21.90	2.97	23.45	3.20	25.00	3.43	28.00	3.93	31.11	4.55
	23	15.79	2.15	18.90	2.58	21.90	3.03	23.45	3.31	25.00	3.60	28.00	4.21	31.11	4.87
	25	15.79	2.20	18.90	2.69	21.90	3.23	23.45	3.53	25.00	3.84	28.00	4.50	31.11	5.21
	27	15.79	2.33	18.90	2.86	21.90	3.45	23.45	3.76	25.00	4.10	28.00	4.81	31.11	5.57
	29	15.79	2.47	18.90	3.03	21.90	3.67	23.45	4.01	25.00	4.36	28.00	5.12	31.11	5.95
	31	15.79	2.61	18.90	3.22	21.90	3.90	23.45	4.26	25.00	4.64	28.00	5.46	31.11	6.34
	33	15.79	2.77	18.90	3.43	21.90	4.15	23.45	4.54	25.00	4.95	28.00	5.82	31.11	6.77
35	15.79	2.94	18.90	3.63	21.90	4.41	23.45	4.83	25.00	5.26	28.00	6.20	31.11	7.21	
37	15.79	3.10	18.90	3.85	21.90	4.69	23.45	5.12	25.00	5.60	28.00	6.60	31.11	7.68	
39	15.79	3.28	18.90	4.08	21.90	4.97	23.45	5.45	25.00	5.95	28.00	7.02	31.11	8.18	
41	15.79	3.43	18.90	4.22	21.90	5.12	23.45	5.63	25.00	6.13	28.00	7.30	31.11	8.54	
43	15.79	3.71	18.90	4.51	21.90	5.33	23.45	5.93	25.00	6.31	28.00	7.57	31.11	8.81	
45	15.79	3.79	18.90	4.61	21.90	5.44	23.45	6.03	25.00	6.63	28.00	7.98	31.11	9.14	
48	15.79	3.89	18.90	4.65	21.90	5.49	23.45	6.13	25.00	6.81	28.00	8.34	31.11	9.36	
60%	-5	13.52	1.50	16.15	1.74	18.78	2.03	20.10	2.17	21.42	2.34	24.05	2.63	26.68	3.01
	-2	13.52	1.51	16.15	1.77	18.78	2.07	20.10	2.20	21.42	2.36	24.05	2.67	26.68	3.03
	0	13.52	1.54	16.15	1.79	18.78	2.10	20.10	2.22	21.42	2.40	24.05	2.70	26.68	3.07
	2	13.52	1.56	16.15	1.83	18.78	2.14	20.10	2.27	21.42	2.43	24.05	2.76	26.68	3.11
	4	13.52	1.61	16.15	1.87	18.78	2.18	20.10	2.30	21.42	2.47	24.05	2.80	26.68	3.15
	6	13.52	1.62	16.15	1.91	18.78	2.22	20.10	2.35	21.42	2.52	24.05	2.86	26.68	3.23
	8	13.52	1.65	16.15	1.94	18.78	2.26	20.10	2.39	21.42	2.57	24.05	2.91	26.68	3.28
	10	13.52	1.69	16.15	1.98	18.78	2.29	20.10	2.46	21.42	2.62	24.05	2.97	26.68	3.33
	12	13.52	1.72	16.15	2.01	18.78	2.34	20.10	2.50	21.42	2.66	24.05	3.02	26.68	3.38
	14	13.52	1.74	16.15	2.04	18.78	2.37	20.10	2.54	21.42	2.72	24.05	3.08	26.68	3.45
	16	13.52	1.76	16.15	2.08	18.78	2.41	20.10	2.59	21.42	2.76	24.05	3.13	26.68	3.51
	18	13.52	1.79	16.15	2.11	18.78	2.46	20.10	2.63	21.42	2.82	24.05	3.19	26.68	3.58
	20	13.52	1.82	16.15	2.15	18.78	2.50	20.10	2.69	21.42	2.87	24.05	3.25	26.68	3.65
	21	13.52	1.84	16.15	2.16	18.78	2.52	20.10	2.71	21.42	2.89	24.05	3.28	26.68	3.69
	23	13.52	1.86	16.15	2.21	18.78	2.57	20.10	2.76	21.42	2.95	24.05	3.41	26.68	3.93
	25	13.52	1.89	16.15	2.24	18.78	2.66	20.10	2.89	21.42	3.13	24.05	3.64	26.68	4.19
	27	13.52	1.97	16.15	2.38	18.78	2.84	20.10	3.09	21.42	3.34	24.05	3.88	26.68	4.47
	29	13.52	2.08	16.15	2.52	18.78	3.02	20.10	3.28	21.42	3.56	24.05	4.14	26.68	4.77
	31	13.52	2.21	16.15	2.68	18.78	3.21	20.10	3.49	21.42	3.78	24.05	4.40	26.68	5.08
	33	13.52	2.33	16.15	2.84	18.78	3.40	20.10	3.71	21.42	4.02	24.05	4.69	26.68	5.42
35	13.52	2.47	16.15	3.01	18.78	3.61	20.10	3.94	21.42	4.27	24.05	4.99	26.68	5.76	
37	13.52	2.61	16.15	3.19	18.78	3.83	20.10	4.18	21.42	4.53	24.05	5.31	26.68	6.13	
39	13.52	2.75	16.15	3.37	18.78	4.06	20.10	4.43	21.42	4.82	24.05	5.63	26.68	6.52	
41	13.52	2.84	16.15	3.52	18.78	4.20	20.10	4.60	21.42	4.99	24.05	5.90	26.68	6.82	
43	13.52	2.93	16.15	3.67	18.78	4.35	20.10	4.74	21.42	5.17	24.05	6.15	26.68	7.12	
45	13.52	3.07	16.15	3.85	18.78	4.53	20.10	4.92	21.42	5.42	24.05	6.42	26.68	7.51	
48	13.52	3.18	16.15	4.02	18.78	4.68	20.10	5.05	21.42	5.63	24.05	6.66	26.68	7.86	

**Cooling capacity table**

MVUR335B-VA3

**TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature(°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
50%	-5	11.31	1.31	13.52	1.51	15.67	1.74	16.75	1.82	17.83	1.92	19.98	2.18	22.25	2.35
	-2	11.31	1.32	13.52	1.54	15.67	1.75	16.75	1.84	17.83	1.95	19.98	2.21	22.25	2.38
	0	11.31	1.34	13.52	1.57	15.67	1.79	16.75	1.87	17.83	1.97	19.98	2.25	22.25	2.42
	2	11.31	1.36	13.52	1.59	15.67	1.82	16.75	1.89	17.83	2.01	19.98	2.26	22.25	2.47
	4	11.31	1.37	13.52	1.61	15.67	1.84	16.75	1.92	17.83	2.05	19.98	2.31	22.25	2.53
	6	11.31	1.39	13.52	1.64	15.67	1.86	16.75	1.96	17.83	2.09	19.98	2.35	22.25	2.61
	8	11.31	1.43	13.52	1.67	15.67	1.90	16.75	2.00	17.83	2.11	19.98	2.38	22.25	2.69
	10	11.31	1.46	13.52	1.69	15.67	1.92	16.75	2.04	17.83	2.17	19.98	2.45	22.25	2.73
	12	11.31	1.47	13.52	1.71	15.67	1.96	16.75	2.08	17.83	2.22	19.98	2.49	22.25	2.77
	14	11.31	1.49	13.52	1.73	15.67	1.98	16.75	2.12	17.83	2.25	19.98	2.53	22.25	2.83
	16	11.31	1.51	13.52	1.75	15.67	2.01	16.75	2.15	17.83	2.28	19.98	2.58	22.25	2.87
	18	11.31	1.53	13.52	1.78	15.67	2.04	16.75	2.19	17.83	2.33	19.98	2.62	22.25	2.93
	20	11.31	1.56	13.52	1.81	15.67	2.08	16.75	2.22	17.83	2.37	19.98	2.66	22.25	2.98
	21	11.31	1.57	13.52	1.83	15.67	2.10	16.75	2.24	17.83	2.39	19.98	2.70	22.25	3.01
	23	11.31	1.59	13.52	1.85	15.67	2.13	16.75	2.28	17.83	2.44	19.98	2.74	22.25	3.08
	25	11.31	1.61	13.52	1.88	15.67	2.17	16.75	2.33	17.83	2.51	19.98	2.88	22.25	3.28
	27	11.31	1.64	13.52	1.96	15.67	2.29	16.75	2.48	17.83	2.66	19.98	3.07	22.25	3.50
	29	11.31	1.73	13.52	2.07	15.67	2.44	16.75	2.63	17.83	2.84	19.98	3.26	22.25	3.73
	31	11.31	1.83	13.52	2.19	15.67	2.58	16.75	2.79	17.83	3.01	19.98	3.47	22.25	3.97
	33	11.31	1.94	13.52	2.32	15.67	2.74	16.75	2.96	17.83	3.20	19.98	3.69	22.25	4.22
35	11.31	2.04	13.52	2.45	15.67	2.89	16.75	3.13	17.83	3.38	19.98	3.91	22.25	4.48	
37	11.31	2.15	13.52	2.59	15.67	3.07	16.75	3.32	17.83	3.59	19.98	4.15	22.25	4.76	
39	11.31	2.27	13.52	2.73	15.67	3.24	16.75	3.51	17.83	3.81	19.98	4.40	22.25	5.06	
41	11.31	2.37	13.52	2.85	15.67	3.36	16.75	3.68	17.83	3.97	19.98	4.64	22.25	5.29	
43	11.31	2.52	13.52	3.04	15.67	3.48	16.75	3.84	17.83	4.07	19.98	4.87	22.25	5.53	
45	11.31	2.58	13.52	3.12	15.67	3.71	16.75	4.14	17.83	4.24	19.98	5.34	22.25	6.00	
48	11.31	2.64	13.52	3.21	15.67	3.93	16.75	4.40	17.83	4.43	19.98	5.77	22.25	6.45	









**Cooling capacity table**

MVUR400B-VA3

**TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature(°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
50%	-5	13.50	1.83	16.14	2.11	18.71	2.43	20.00	2.54	21.29	2.68	23.86	3.05	26.57	3.29
	-2	13.50	1.84	16.14	2.16	18.71	2.46	20.00	2.58	21.29	2.73	23.86	3.09	26.57	3.33
	0	13.50	1.87	16.14	2.19	18.71	2.50	20.00	2.61	21.29	2.76	23.86	3.14	26.57	3.39
	2	13.50	1.90	16.14	2.22	18.71	2.54	20.00	2.65	21.29	2.81	23.86	3.16	26.57	3.46
	4	13.50	1.92	16.14	2.26	18.71	2.57	20.00	2.68	21.29	2.87	23.86	3.24	26.57	3.54
	6	13.50	1.95	16.14	2.29	18.71	2.61	20.00	2.75	21.29	2.92	23.86	3.29	26.57	3.65
	8	13.50	2.00	16.14	2.33	18.71	2.65	20.00	2.81	21.29	2.96	23.86	3.34	26.57	3.77
	10	13.50	2.04	16.14	2.36	18.71	2.70	20.00	2.85	21.29	3.05	23.86	3.43	26.57	3.82
	12	13.50	2.06	16.14	2.39	18.71	2.74	20.00	2.91	21.29	3.11	23.86	3.49	26.57	3.88
	14	13.50	2.09	16.14	2.42	18.71	2.77	20.00	2.97	21.29	3.15	23.86	3.55	26.57	3.96
	16	13.50	2.12	16.14	2.45	18.71	2.82	20.00	3.02	21.29	3.20	23.86	3.61	26.57	4.02
	18	13.50	2.15	16.14	2.50	18.71	2.86	20.00	3.06	21.29	3.26	23.86	3.67	26.57	4.10
	20	13.50	2.18	16.14	2.53	18.71	2.91	20.00	3.11	21.29	3.32	23.86	3.73	26.57	4.17
	21	13.50	2.19	16.14	2.56	18.71	2.94	20.00	3.14	21.29	3.35	23.86	3.78	26.57	4.22
	23	13.50	2.22	16.14	2.59	18.71	2.98	20.00	3.20	21.29	3.41	23.86	3.84	26.57	4.31
	25	13.50	2.25	16.14	2.63	18.71	3.05	20.00	3.26	21.29	3.52	23.86	4.04	26.57	4.60
	27	13.50	2.30	16.14	2.74	18.71	3.21	20.00	3.47	21.29	3.73	23.86	4.29	26.57	4.90
	29	13.50	2.42	16.14	2.89	18.71	3.41	20.00	3.69	21.29	3.97	23.86	4.57	26.57	5.22
	31	13.50	2.56	16.14	3.06	18.71	3.61	20.00	3.91	21.29	4.22	23.86	4.86	26.57	5.56
	33	13.50	2.71	16.14	3.24	18.71	3.84	20.00	4.14	21.29	4.48	23.86	5.16	26.57	5.91
35	13.50	2.86	16.14	3.43	18.71	4.05	20.00	4.39	21.29	4.74	23.86	5.48	26.57	6.27	
37	13.50	3.02	16.14	3.62	18.71	4.29	20.00	4.64	21.29	5.02	23.86	5.82	26.57	6.67	
39	13.50	3.18	16.14	3.82	18.71	4.54	20.00	4.92	21.29	5.33	23.86	6.17	26.57	7.08	
41	13.50	3.31	16.14	3.99	18.71	4.70	20.00	5.15	21.29	5.56	23.86	6.50	26.57	7.41	
43	13.50	3.53	16.14	4.26	18.71	4.87	20.00	5.38	21.29	5.70	23.86	6.83	26.57	7.74	
45	13.50	3.61	16.14	4.37	18.71	5.20	20.00	5.80	21.29	5.94	23.86	7.48	26.57	8.40	
48	13.50	3.70	16.14	4.49	18.71	5.50	20.00	6.16	21.29	6.21	23.86	8.08	26.57	9.04	









**Cooling capacity table**

MVUR450B-VA3

**TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature (°C DB)	Indoor temperature(°C)													
		DB:20.8 WB:14		DB:23.3 WB:16		DB:25.8 WB:18		DB:27 WB:19		DB:28.2 WB:20		DB:30.7 WB:22		DB:32 WB:24	
		TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW
50%	-5	15.19	2.14	18.16	2.48	21.05	2.85	22.50	2.98	23.95	3.14	26.84	3.58	29.89	3.85
	-2	15.19	2.16	18.16	2.53	21.05	2.88	22.50	3.02	23.95	3.20	26.84	3.62	29.89	3.91
	0	15.19	2.19	18.16	2.57	21.05	2.93	22.50	3.06	23.95	3.24	26.84	3.68	29.89	3.97
	2	15.19	2.22	18.16	2.60	21.05	2.98	22.50	3.11	23.95	3.29	26.84	3.70	29.89	4.05
	4	15.19	2.25	18.16	2.65	21.05	3.01	22.50	3.14	23.95	3.36	26.84	3.79	29.89	4.15
	6	15.19	2.29	18.16	2.69	21.05	3.06	22.50	3.22	23.95	3.42	26.84	3.85	29.89	4.28
	8	15.19	2.34	18.16	2.73	21.05	3.11	22.50	3.29	23.95	3.47	26.84	3.91	29.89	4.41
	10	15.19	2.39	18.16	2.77	21.05	3.16	22.50	3.34	23.95	3.57	26.84	4.01	29.89	4.48
	12	15.19	2.41	18.16	2.80	21.05	3.21	22.50	3.41	23.95	3.64	26.84	4.09	29.89	4.55
	14	15.19	2.44	18.16	2.84	21.05	3.25	22.50	3.48	23.95	3.69	26.84	4.16	29.89	4.64
	16	15.19	2.48	18.16	2.87	21.05	3.30	22.50	3.53	23.95	3.75	26.84	4.23	29.89	4.71
	18	15.19	2.52	18.16	2.93	21.05	3.35	22.50	3.59	23.95	3.82	26.84	4.30	29.89	4.80
	20	15.19	2.55	18.16	2.96	21.05	3.41	22.50	3.64	23.95	3.89	26.84	4.37	29.89	4.89
	21	15.19	2.57	18.16	3.00	21.05	3.44	22.50	3.68	23.95	3.93	26.84	4.42	29.89	4.94
	23	15.19	2.60	18.16	3.03	21.05	3.50	22.50	3.75	23.95	4.00	26.84	4.50	29.89	5.05
	25	15.19	2.64	18.16	3.09	21.05	3.57	22.50	3.82	23.95	4.12	26.84	4.73	29.89	5.39
	27	15.19	2.69	18.16	3.21	21.05	3.76	22.50	4.07	23.95	4.37	26.84	5.03	29.89	5.75
	29	15.19	2.84	18.16	3.39	21.05	4.00	22.50	4.32	23.95	4.66	26.84	5.35	29.89	6.12
	31	15.19	3.00	18.16	3.59	21.05	4.23	22.50	4.59	23.95	4.94	26.84	5.69	29.89	6.51
	33	15.19	3.18	18.16	3.80	21.05	4.50	22.50	4.85	23.95	5.25	26.84	6.05	29.89	6.92
35	15.19	3.35	18.16	4.01	21.05	4.75	22.50	5.14	23.95	5.55	26.84	6.42	29.89	7.35	
37	15.19	3.53	18.16	4.25	21.05	5.03	22.50	5.44	23.95	5.89	26.84	6.82	29.89	7.81	
39	15.19	3.73	18.16	4.48	21.05	5.32	22.50	5.76	23.95	6.24	26.84	7.23	29.89	8.30	
41	15.19	3.88	18.16	4.67	21.05	5.51	22.50	6.03	23.95	6.51	26.84	7.61	29.89	8.68	
43	15.19	4.14	18.16	4.99	21.05	5.70	22.50	6.30	23.95	6.68	26.84	8.00	29.89	9.07	
45	15.19	4.23	18.16	5.12	21.05	6.09	22.50	6.79	23.95	6.96	26.84	8.77	29.89	9.84	
48	15.19	4.33	18.16	5.26	21.05	6.45	22.50	7.22	23.95	7.27	26.84	9.47	29.89	10.59	

## 7.2 Heating capacity tables

**MVUR252B-VA3**
**TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature		Indoor temperature(°C DB)											
			16		18		20		21		22		24	
	°C DB	°CWB	TC kW	PI kW	TC kW	PI kW	TC kW	PI kW	TC kW	PI kW	TC kW	PI kW	TC kW	PI kW
130%	-19.8	-20	17.48	4.24	17.40	4.54	17.32	4.84	17.32	4.99	17.23	5.14	17.23	5.44
	-18.8	-19	17.74	4.33	17.66	4.63	17.66	4.92	17.57	5.07	17.57	5.21	17.48	5.51
	-16.7	-17	18.43	4.54	18.34	4.82	18.26	5.10	18.26	5.24	18.26	5.38	18.17	5.67
	-13.7	-15	19.20	4.75	19.12	5.02	19.03	5.29	19.03	5.42	18.94	5.56	18.94	5.84
	-11.8	-13	19.97	4.96	19.97	5.22	19.89	5.48	19.80	5.61	19.80	5.74	19.71	6.00
	-9.8	-11	20.92	5.17	20.83	5.42	20.74	5.67	20.74	5.80	20.74	5.92	20.66	6.17
	-9.5	-10	21.43	5.28	21.34	5.52	21.26	5.77	21.26	5.89	21.17	6.01	21.17	6.25
	-8.5	-9.1	21.86	5.38	21.77	5.61	21.77	5.85	21.69	5.97	21.69	6.09	21.60	6.33
	-7	-7.6	22.63	5.53	22.63	5.77	22.54	5.99	22.54	6.11	22.46	6.22	22.37	6.45
	-5	-5.6	23.83	5.74	23.74	5.96	23.66	6.18	23.66	6.29	23.57	6.39	23.57	6.61
	-3	-3.7	24.94	5.93	24.86	6.14	24.86	6.34	24.77	6.45	24.77	6.55	24.68	6.76
	0	-0.7	26.91	6.22	26.91	6.41	26.83	6.60	26.83	6.67	26.74	6.79	26.74	6.98
	3	2.2	29.05	6.48	28.97	6.65	28.89	6.83	28.89	6.92	28.89	7.01	28.80	7.18
	5	4.1	30.51	6.64	30.43	6.81	30.43	6.97	30.34	7.06	30.34	7.15	30.26	7.31
	7	6	32.06	6.80	31.97	6.95	31.97	7.11	31.88	7.19	31.88	7.27	30.60	6.98
	9	7.9	33.68	6.93	33.60	7.09	33.60	7.24	33.51	7.32	32.83	7.16	30.60	6.56
	11	9.8	35.40	7.08	35.31	7.22	35.14	7.31	33.94	7.02	32.83	6.73	30.60	6.18
13	11.8	37.28	7.21	37.20	7.35	35.14	6.85	33.94	6.58	32.83	6.32	30.60	5.80	
15	13.7	39.08	7.33	37.37	6.96	35.14	6.45	33.94	6.20	32.83	5.95	30.60	5.47	
120%	-19.8	-20	17.40	4.64	17.31	4.92	17.23	5.20	17.23	5.33	17.23	5.47	17.14	5.75
	-18.8	-19	17.66	4.73	17.57	5.00	17.57	5.28	17.49	5.41	17.49	5.55	17.40	5.82
	-16.7	-17	18.34	4.92	18.26	5.18	18.14	5.44	18.17	5.57	18.17	5.70	18.09	5.96
	-13.7	-15	19.12	5.11	19.03	5.36	18.94	5.61	18.94	5.74	18.94	5.87	18.86	6.12
	-11.8	-13	19.89	5.31	19.89	5.55	19.80	5.79	19.80	5.91	19.72	6.03	19.72	6.27
	-9.8	-11	20.83	5.51	20.74	5.74	20.74	5.97	20.66	6.09	20.66	6.20	20.57	6.43
	-9.5	-10	21.35	5.61	21.26	5.84	21.17	6.05	21.17	6.17	21.17	6.28	21.09	6.51
	-8.5	-9.1	21.77	5.70	21.69	5.91	21.69	6.13	21.60	6.24	21.60	6.36	21.51	6.58
	-7	-7.6	22.54	5.84	22.54	6.05	22.46	6.26	22.46	6.37	22.37	6.48	22.37	6.69
	-5	-5.6	23.74	6.03	23.66	6.23	23.57	6.44	23.57	6.54	23.57	6.64	23.49	6.83
	-3	-3.7	24.86	6.21	24.86	6.41	24.77	6.59	24.77	6.69	24.69	6.79	24.69	6.97
	0	-0.7	26.83	6.48	26.83	6.65	26.74	6.83	26.74	6.92	26.66	7.00	26.66	7.18
	3	2.2	28.97	6.72	28.89	6.88	28.89	7.04	28.80	7.13	28.80	7.21	28.20	7.17
	5	4.1	30.43	6.86	30.34	7.02	30.34	7.18	30.26	7.25	30.26	7.33	28.20	6.73
	7	6	31.97	7.00	31.97	7.15	31.89	7.30	31.37	7.20	30.34	6.90	28.20	6.34
	9	7.9	33.60	7.15	33.52	7.29	32.40	7.04	31.37	6.77	30.34	6.49	28.20	5.96
	11	9.8	35.31	7.27	34.46	7.15	32.40	6.62	31.37	6.37	30.34	6.11	28.20	5.62
13	11.8	36.60	7.20	34.46	6.70	32.40	6.21	31.37	5.98	30.34	5.74	28.20	5.28	
15	13.7	36.60	6.78	34.46	6.31	32.40	5.86	31.37	5.63	30.34	5.42	28.20	4.99	
110%	-19.8	-20	17.31	5.05	17.23	5.30	17.14	5.56	17.14	5.68	17.15	5.81	17.06	6.06
	-18.8	-19	17.57	5.13	17.49	5.38	17.49	5.63	17.49	5.75	17.40	5.88	17.40	6.12
	-16.7	-17	18.26	5.30	18.17	5.54	18.43	5.78	18.09	5.90	18.09	6.02	18.00	6.26
	-13.7	-15	19.03	5.48	18.95	5.71	18.86	5.94	18.86	6.05	18.86	6.17	18.77	6.40
	-11.8	-13	19.80	5.66	19.80	5.88	19.71	6.10	19.71	6.21	19.63	6.32	19.63	6.55
	-9.8	-11	20.74	5.84	20.66	6.05	20.66	6.27	20.57	6.37	20.57	6.48	20.57	6.69
	-9.5	-10	21.26	5.94	21.17	6.14	21.08	6.35	21.08	6.45	21.08	6.55	21.00	6.76
	-8.5	-9.1	21.69	6.02	21.60	6.22	21.60	6.42	21.51	6.52	21.51	6.62	21.51	6.04
	-7	-7.6	22.46	6.16	22.46	6.34	22.37	6.54	22.37	6.64	22.37	6.73	22.29	6.93
	-5	-5.6	23.66	6.33	23.57	6.51	23.49	6.69	23.49	6.79	23.49	6.88	23.40	7.07
	-3	-3.7	24.77	6.49	24.77	6.66	24.69	6.84	24.69	6.93	24.60	7.01	24.60	7.19
	0	-0.7	26.74	6.73	26.74	6.90	26.66	7.06	26.66	7.14	26.66	7.22	25.89	7.08
	3	2.2	28.89	6.96	28.80	7.11	28.80	7.25	28.71	7.33	27.77	7.03	25.89	6.44
	5	4.1	30.34	7.09	30.34	7.24	29.74	7.17	28.71	6.88	27.77	6.61	25.89	6.06
	7	6	31.88	7.22	31.63	7.27	29.74	6.73	28.71	6.47	27.77	6.21	25.89	5.70
	9	7.9	33.51	7.34	31.63	6.83	29.74	6.33	28.71	6.09	27.77	5.84	25.89	5.38
	11	9.8	33.51	6.90	31.63	6.43	29.74	5.96	28.71	5.74	27.77	5.51	25.89	5.07
13	11.8	33.51	6.48	31.63	6.03	29.74	5.60	28.71	5.39	27.77	5.18	25.89	4.78	
15	13.7	33.51	5.75	31.63	5.69	29.74	5.29	28.71	5.09	27.77	4.90	25.89	4.52	

**Heating capacity table****TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)**MVUR252B-VA3**

Combination (%)	Outdoor temperature		Indoor temperature(°C DB)											
			16		18		20		21		22		24	
	°C DB	°CWB	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
100%	-19.8	-20	17.23	5.45	17.14	5.68	17.14	5.91	17.06	6.03	17.06	6.14	16.97	6.37
	-18.8	-19	17.49	5.52	17.49	5.75	17.40	5.98	17.40	6.09	17.32	6.21	17.32	6.44
	-16.7	-17	18.17	5.68	18.08	5.90	18.08	6.12	18.00	6.23	18.00	6.33	18.00	6.55
	-13.7	-15	18.94	5.84	18.86	6.05	18.77	6.27	18.77	6.37	18.77	6.48	18.69	6.69
	-11.8	-13	19.72	6.02	19.72	6.21	19.63	6.41	19.63	6.51	19.63	6.62	19.54	6.82
	-9.8	-11	20.66	6.18	20.57	6.37	20.57	6.56	20.57	6.66	20.48	6.76	20.48	6.94
	-9.5	-10	21.17	6.27	21.09	6.45	21.09	6.64	21.00	6.73	21.00	6.83	20.91	7.01
	-8.5	-9.1	21.60	6.33	21.51	6.52	21.51	6.70	21.51	6.80	21.43	6.89	21.43	7.07
	-7	-7.6	22.37	6.46	22.37	6.64	22.29	6.81	22.29	6.90	22.29	6.99	22.20	7.17
	-5	-5.6	23.57	6.62	23.48	6.79	23.48	6.96	23.40	7.04	23.40	7.12	23.31	7.29
	-3	-3.7	24.69	6.77	24.69	6.15	24.60	7.09	24.60	7.17	24.60	7.25	23.57	6.94
	0	-0.7	26.66	6.99	26.66	7.14	26.57	7.29	26.14	7.17	25.29	6.87	23.57	6.30
	3	2.2	28.80	7.19	28.71	7.32	27.00	6.78	26.14	6.51	25.29	6.26	23.57	5.74
	5	4.1	30.26	7.32	28.71	6.88	27.00	6.37	26.14	6.13	25.29	5.89	23.57	5.42
	7	6	30.43	6.95	28.71	6.47	27.00	6.00	26.14	5.77	25.29	5.55	23.57	5.10
	9	7.9	30.43	6.53	28.71	6.09	27.00	5.65	26.14	5.37	25.29	5.23	23.57	4.82
11	9.8	30.43	6.15	28.71	5.73	27.00	5.33	26.14	5.13	25.29	4.93	23.57	4.55	
13	11.8	30.43	5.77	28.71	5.39	27.00	5.02	26.14	4.83	25.29	4.65	23.57	4.29	
15	13.7	30.43	5.45	28.71	5.09	27.00	4.74	26.14	4.57	25.29	4.40	23.57	4.07	
90%	-19.8	-20	17.11	5.86	17.03	6.06	17.03	6.27	16.94	6.37	16.94	6.48	16.94	6.69
	-18.8	-19	17.37	5.92	17.37	6.13	17.28	6.34	17.28	6.44	17.28	6.54	17.20	6.74
	-16.7	-17	18.05	6.07	17.97	6.27	17.97	6.46	17.97	6.56	17.88	6.65	17.88	6.85
	-13.7	-15	18.82	6.22	18.74	6.40	18.74	6.59	18.65	6.69	18.65	6.78	18.65	6.97
	-11.8	-13	19.59	6.37	19.59	6.55	19.51	6.72	19.51	6.82	19.51	6.90	19.42	7.08
	-9.8	-11	20.54	6.51	20.54	6.69	20.45	6.86	20.45	6.94	20.45	7.04	20.36	7.21
	-9.5	-10	21.05	6.59	20.96	6.76	20.96	6.93	20.88	7.01	20.88	7.10	20.88	7.26
	-8.5	-9.1	21.48	6.66	21.48	6.83	21.39	6.99	21.39	7.07	21.39	7.15	21.13	7.22
	-7	-7.6	22.25	6.77	22.25	6.93	22.16	7.09	22.16	7.17	22.16	7.25	21.13	6.90
	-5	-5.6	23.44	6.92	23.36	7.07	23.36	7.22	23.27	7.29	22.67	7.07	21.13	6.48
	-3	-3.7	24.56	7.05	24.56	7.19	24.30	7.22	23.44	6.93	22.67	6.65	21.13	6.11
	0	-0.7	26.61	7.25	25.84	7.08	24.30	6.55	23.44	6.30	22.67	6.05	21.13	5.56
	3	2.2	27.38	6.91	25.84	6.44	24.30	5.97	23.44	5.74	22.67	5.52	21.13	5.08
	5	4.1	27.38	6.50	25.84	6.05	24.30	5.63	23.44	5.41	22.67	5.21	21.13	4.79
	7	6	27.38	6.11	25.84	5.70	24.30	5.30	23.44	5.10	22.67	4.91	21.13	4.53
	9	7.9	27.38	5.76	25.84	5.37	24.30	4.99	23.44	4.82	22.67	4.64	21.13	4.28
11	9.8	27.38	5.42	25.84	5.06	24.30	4.72	23.44	4.55	22.67	4.38	21.13	4.05	
13	11.8	27.38	5.10	25.84	4.78	24.30	4.45	23.44	4.29	22.67	4.14	21.13	3.83	
15	13.7	27.38	4.82	25.84	4.51	24.30	4.22	23.44	4.07	22.67	3.92	21.13	3.63	
80%	-19.8	-20	17.06	6.26	16.97	6.44	16.97	6.63	16.97	6.72	16.88	6.82	16.88	7.00
	-18.8	-19	17.31	6.32	17.31	6.51	17.23	6.69	17.23	6.78	17.23	6.86	17.14	7.05
	-16.7	-17	18.00	6.45	17.92	6.62	17.92	6.80	17.92	6.89	17.92	6.97	17.83	7.15
	-13.7	-15	18.77	6.58	18.69	6.75	18.69	6.92	18.69	7.00	18.60	7.08	18.60	7.25
	-11.8	-13	19.54	6.72	19.54	6.88	19.46	7.04	19.46	7.11	19.46	7.20	18.86	7.01
	-9.8	-11	20.49	6.85	20.49	7.01	20.40	7.16	20.40	7.23	20.23	7.22	18.86	6.62
	-9.5	-10	21.00	6.92	20.91	7.07	20.92	7.22	20.92	7.29	20.23	7.01	18.86	6.42
	-8.5	-9.1	21.43	6.98	19.92	7.13	21.34	7.27	20.92	7.11	20.23	6.82	18.86	6.25
	-7	-7.6	22.20	7.08	22.20	7.22	21.60	7.07	20.92	6.79	20.23	6.51	18.86	5.98
	-5	-5.6	23.40	7.21	22.97	7.17	21.60	6.64	20.92	6.38	20.23	6.12	18.86	5.63
	-3	-3.7	24.34	7.25	22.97	6.75	21.60	6.25	20.92	6.02	20.23	5.77	18.86	5.31
	0	-0.7	24.34	6.58	22.97	6.12	21.60	5.69	20.92	5.48	20.23	5.26	18.86	4.85
	3	2.2	24.34	5.99	22.97	5.59	21.60	5.20	20.92	5.00	20.23	4.82	18.86	4.44
	5	4.1	24.34	5.64	22.97	5.27	21.60	4.90	20.92	4.72	20.23	4.55	18.86	4.20
	7	6	24.34	5.31	22.97	4.97	21.60	4.63	20.92	4.46	20.23	4.30	18.86	3.97
	9	7.9	24.34	5.02	22.97	4.69	21.60	4.37	20.92	4.22	20.23	4.07	18.86	3.76
11	9.8	24.34	4.74	22.97	4.43	21.60	4.14	20.92	3.99	20.23	3.85	18.86	3.57	
13	11.8	24.34	4.46	22.97	4.18	21.60	3.91	20.92	3.77	20.23	3.64	18.86	3.37	
15	13.7	24.34	4.22	22.97	3.97	21.60	3.71	20.92	3.58	20.23	3.45	18.86	3.21	

**Heating capacity table**

MVUR252B-VA3

**TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)

Combination (%)	Outdoor temperature		Indoor temperature(°C DB)											
			16		18		20		21		22		24	
	°C DB	°CWB	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
70%	-19.8	-20	16.93	6.67	16.85	6.83	16.85	6.99	16.85	7.07	16.85	7.15	16.42	7.07
	-18.8	-19	17.19	6.72	17.19	6.88	17.10	7.04	17.10	7.11	17.10	7.20	16.42	6.93
	-16.7	-17	17.87	6.83	17.87	6.99	17.79	7.14	17.79	7.22	17.62	6.43	16.42	6.61
	-13.7	-15	18.64	6.95	18.56	7.10	18.56	7.25	18.22	7.14	17.62	6.85	16.42	6.28
	-11.8	-13	19.41	7.07	19.41	7.21	18.90	7.04	18.22	6.76	17.62	6.49	16.42	5.95
	-9.8	-11	20.35	7.18	20.10	7.18	18.90	6.65	18.22	6.39	17.62	6.13	16.42	5.63
	-9.5	-10	20.87	7.25	20.10	6.97	18.90	6.45	18.22	6.20	17.62	5.96	16.42	5.48
	-8.5	-9.1	21.29	7.29	20.10	6.78	18.90	6.28	18.22	6.04	17.62	5.80	16.42	5.34
	-7	-7.6	21.29	6.96	20.10	6.47	18.90	6.01	18.22	5.78	17.62	5.56	16.42	5.11
	-5	-5.6	21.29	6.54	20.10	6.09	18.90	5.66	18.22	5.44	17.62	6.42	16.42	4.82
	-3	-3.7	21.29	6.16	20.10	5.74	18.90	5.34	18.22	5.13	17.62	4.94	16.42	4.56
	0	-0.7	21.29	5.60	20.10	5.24	18.90	4.87	18.22	4.69	17.62	4.52	16.42	4.18
	3	2.2	21.29	5.12	20.10	4.79	18.90	4.46	18.22	4.30	17.62	4.14	16.42	3.83
	5	4.1	21.29	4.83	20.10	4.52	18.90	4.22	18.22	4.07	17.62	3.92	16.42	3.63
	7	6	21.29	4.57	20.10	4.28	18.90	3.99	18.22	3.85	17.62	3.72	16.42	3.44
	9	7.9	21.29	4.32	20.10	4.04	18.90	3.78	18.22	3.65	17.62	3.52	16.42	3.26
11	9.8	21.29	4.08	20.10	3.83	18.90	3.58	18.22	3.46	17.62	3.34	16.42	3.10	
13	11.8	21.29	3.86	20.10	3.62	18.90	3.39	18.22	3.28	17.62	3.16	16.42	2.95	
15	13.7	21.29	3.65	20.10	3.44	18.90	3.22	18.22	3.12	17.62	3.01	16.42	2.80	
60%	-19.8	-20	16.89	7.07	16.80	7.21	16.20	6.93	15.69	6.66	15.17	6.40	14.14	5.87
	-18.8	-19	17.14	7.12	17.14	7.25	16.20	6.79	15.69	6.52	15.17	6.26	14.14	5.74
	-16.7	-17	17.83	7.21	17.23	6.99	16.20	6.47	15.69	6.23	15.17	5.98	14.14	5.49
	-13.7	-15	18.26	7.14	17.23	6.64	16.20	6.16	15.69	5.92	15.17	5.69	14.14	5.23
	-11.8	-13	18.26	6.76	17.23	6.29	16.20	5.84	15.69	5.62	15.17	5.40	14.14	4.99
	-9.8	-11	18.26	6.38	17.23	5.95	16.20	5.52	15.69	5.31	15.17	5.11	14.14	4.71
	-9.5	-10	18.26	6.20	17.23	5.78	16.20	5.37	15.69	5.17	15.17	4.97	14.14	4.58
	-8.5	-9.1	18.26	6.04	17.23	5.63	16.20	5.24	15.69	5.04	15.17	4.85	14.14	4.47
	-7	-7.6	18.26	5.77	17.23	5.39	16.20	5.01	15.69	4.83	15.17	4.64	14.14	4.29
	-5	-5.6	18.26	5.44	17.23	5.08	16.20	4.73	15.69	4.56	15.17	4.39	14.14	4.06
	-3	-3.7	18.26	5.13	17.23	4.80	16.20	4.47	15.69	4.32	15.17	4.15	14.14	3.84
	0	-0.7	18.26	4.69	17.23	4.39	16.20	4.10	15.69	3.96	15.17	3.81	14.14	3.53
	3	2.2	18.26	4.30	17.23	4.04	16.20	3.77	15.69	3.64	15.17	3.51	14.14	3.26
	5	4.1	18.26	4.07	17.23	3.82	16.20	3.57	15.69	3.45	15.17	3.33	14.14	3.09
	7	6	18.26	3.85	17.23	3.62	16.20	3.38	15.69	3.27	15.17	3.16	14.14	2.94
	9	7.9	18.26	3.65	17.23	3.43	16.20	3.21	15.69	3.11	15.17	3.00	14.14	2.80
11	9.8	18.26	3.46	17.23	3.26	16.20	3.05	15.69	2.95	15.17	2.85	14.14	2.66	
13	11.8	18.26	3.27	17.23	3.09	16.20	2.90	15.69	2.81	15.17	2.71	14.14	2.53	
15	13.7	18.26	3.12	17.23	2.93	16.20	2.76	15.69	2.67	15.17	2.59	14.14	2.42	
50%	-19.8	-20	15.21	6.44	14.35	5.99	13.50	5.56	12.99	5.36	12.56	5.15	11.71	4.75
	-18.8	-19	15.21	6.30	14.35	5.87	13.50	5.45	12.99	5.24	12.56	5.04	11.71	4.65
	-16.7	-17	15.21	6.01	14.35	5.60	13.50	5.21	12.99	5.02	12.56	4.83	11.71	4.46
	-13.7	-15	15.21	5.72	14.35	5.34	13.50	4.96	12.99	4.78	12.56	4.60	11.71	4.25
	-11.8	-13	15.21	5.43	14.35	5.07	13.50	4.72	12.99	4.55	12.56	4.38	11.71	4.05
	-9.8	-11	15.21	5.14	14.35	4.81	13.50	4.48	12.99	4.32	12.56	4.16	11.71	3.85
	-9.5	-10	15.21	5.00	14.35	4.67	13.50	4.36	12.99	4.21	12.56	4.05	11.71	3.75
	-8.5	-9.1	15.21	4.88	14.35	4.57	13.50	4.25	12.99	4.11	12.56	3.96	11.71	3.66
	-7	-7.6	15.21	4.67	14.35	4.38	13.50	4.08	12.99	3.94	12.56	3.80	11.71	3.52
	-5	-5.6	15.21	4.41	14.35	4.14	13.50	3.86	12.99	3.73	12.56	3.60	11.71	3.33
	-3	-3.7	15.21	4.18	14.35	3.92	13.50	3.66	12.99	3.54	12.56	3.41	11.71	3.17
	0	-0.7	15.21	3.83	14.35	3.60	13.50	3.37	12.99	3.26	12.56	3.15	11.71	2.93
	3	2.2	15.21	3.53	14.35	3.32	13.50	3.11	12.99	3.01	12.56	2.91	11.71	2.71
	5	4.1	15.21	3.35	14.35	3.15	13.50	2.95	12.99	2.86	12.56	2.77	11.71	2.58
	7	6	15.21	3.18	14.35	2.99	13.50	2.81	12.99	2.72	12.56	2.63	11.71	2.46
	9	7.9	15.21	3.02	14.35	2.84	13.50	2.67	12.99	2.59	12.56	2.51	11.71	2.35
11	9.8	15.21	2.87	14.35	2.70	13.50	2.55	12.99	2.47	12.56	2.39	11.71	2.24	
13	11.8	15.21	2.73	14.35	2.57	13.50	2.42	12.99	2.35	12.56	2.28	11.71	2.13	
15	13.7	15.21	2.59	14.35	2.45	13.50	2.31	12.99	2.24	12.56	2.17	11.71	2.04	





**Heating capacity table**

**TC:** Total Capacity (kW); **PI:** Power Input (kW) (Compressor + Outdoor fan motor)

**MVUR280B-VA3**

Combination (%)	Outdoor temperature		Indoor temperature(°C DB)											
			16		18		20		21		22		24	
			TC	PI	TC	PI	TC	PI	TC	PI	TC	PI	TC	PI
°C DB    °CWB		kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	kW	
70%	-19.8	-20	19.75	8.15	19.66	8.34	19.66	8.54	19.66	8.63	19.66	8.74	19.16	8.64
	-18.8	-19	20.05	8.21	20.05	8.41	19.96	8.60	19.96	8.69	19.96	8.80	19.16	8.46
	-16.7	-17	20.85	8.35	20.85	8.54	20.75	8.72	20.75	8.81	20.55	7.85	19.16	8.07
	-13.7	-15	21.75	8.49	21.65	8.67	21.65	8.85	21.25	8.72	20.55	8.37	19.16	7.67
	-11.8	-13	22.65	8.63	22.65	8.80	22.05	8.60	21.25	8.26	20.55	7.93	19.16	7.27
	-9.8	-11	23.75	8.78	23.45	8.77	22.05	8.12	21.25	7.81	20.55	7.49	19.16	6.88
	-9.5	-10	24.35	8.85	23.45	8.51	22.05	7.88	21.25	7.58	20.55	7.28	19.16	6.69
	-8.5	-9.1	24.84	8.90	23.45	8.28	22.05	7.67	21.25	7.38	20.55	7.09	19.16	6.52
	-7	-7.6	24.84	8.50	23.45	7.91	22.05	7.34	21.25	7.06	20.55	6.79	19.16	6.24
	-5	-5.6	24.84	7.99	23.45	7.44	22.05	6.91	21.25	6.64	20.55	6.49	19.16	5.89
	-3	-3.7	24.84	7.52	23.45	7.02	22.05	6.52	21.25	6.27	20.55	6.04	19.16	5.57
	0	-0.7	24.84	6.84	23.45	6.40	22.05	5.95	21.25	5.73	20.55	5.52	19.16	5.10
	3	2.2	24.84	6.25	23.45	5.85	22.05	5.45	21.25	5.25	20.55	5.06	19.16	4.68
	5	4.1	24.84	5.90	23.45	5.52	22.05	5.16	21.25	4.97	20.55	4.79	19.16	4.44
	7	6	24.84	5.58	23.45	5.23	22.05	4.87	21.25	4.70	20.55	4.54	19.16	4.21
9	7.9	24.84	5.27	23.45	4.94	22.05	4.62	21.25	4.46	20.55	4.30	19.16	3.99	
11	9.8	24.84	4.99	23.45	4.67	22.05	4.38	21.25	4.23	20.55	4.08	19.16	3.79	
13	11.8	24.84	4.71	23.45	4.43	22.05	4.14	21.25	4.01	20.55	3.86	19.16	3.60	
15	13.7	24.84	4.46	23.45	4.20	22.05	3.93	21.25	3.81	20.55	3.67	19.16	3.43	
60%	-19.8	-20	19.70	8.64	19.60	8.80	18.90	8.47	18.30	8.14	17.70	7.81	16.50	7.17
	-18.8	-19	20.00	8.70	20.00	8.86	18.90	8.29	18.30	7.97	17.70	7.64	16.50	7.02
	-16.7	-17	20.80	8.81	20.10	8.54	18.90	7.91	18.30	7.61	17.70	7.30	16.50	6.71
	-13.7	-15	21.30	8.72	20.10	8.11	18.90	7.52	18.30	7.23	17.70	6.95	16.50	6.39
	-11.8	-13	21.30	8.25	20.10	7.68	18.90	7.13	18.30	6.86	17.70	6.60	16.50	6.10
	-9.8	-11	21.30	7.80	20.10	7.26	18.90	6.75	18.30	6.49	17.70	6.24	16.50	5.76
	-9.5	-10	21.30	7.58	20.10	7.06	18.90	6.56	18.30	6.32	17.70	6.07	16.50	5.60
	-8.5	-9.1	21.30	7.38	20.10	6.88	18.90	6.40	18.30	6.16	17.70	5.92	16.50	5.46
	-7	-7.6	21.30	7.05	20.10	6.59	18.90	6.12	18.30	5.90	17.70	5.67	16.50	5.24
	-5	-5.6	21.30	6.64	20.10	6.21	18.90	5.78	18.30	5.57	17.70	5.36	16.50	4.96
	-3	-3.7	21.30	6.27	20.10	5.86	18.90	5.46	18.30	5.27	17.70	5.07	16.50	4.69
	0	-0.7	21.30	5.73	20.10	5.37	18.90	5.01	18.30	4.84	17.70	4.65	16.50	4.31
	3	2.2	21.30	5.25	20.10	4.93	18.90	4.61	18.30	4.45	17.70	4.29	16.50	3.98
	5	4.1	21.30	4.97	20.10	4.66	18.90	4.36	18.30	4.22	17.70	4.06	16.50	3.78
	7	6	21.30	4.70	20.10	4.42	18.90	4.13	18.30	4.00	17.70	3.86	16.50	3.59
9	7.9	21.30	4.45	20.10	4.19	18.90	3.92	18.30	3.80	17.70	3.66	16.50	3.42	
11	9.8	21.30	4.23	20.10	3.98	18.90	3.73	18.30	3.61	17.70	3.48	16.50	3.26	
13	11.8	21.30	4.00	20.10	3.77	18.90	3.54	18.30	3.43	17.70	3.31	16.50	3.09	
15	13.7	21.30	3.81	20.10	3.58	18.90	3.37	18.30	3.26	17.70	3.16	16.50	2.95	
50%	-19.8	-20	17.74	7.86	16.75	7.32	15.75	6.80	15.15	6.55	14.65	6.29	13.66	5.80
	-18.8	-19	17.74	7.69	16.75	7.17	15.75	6.66	15.15	6.41	14.65	6.16	13.66	5.68
	-16.7	-17	17.74	7.34	16.75	6.84	15.75	6.37	15.15	6.13	14.65	5.90	13.66	5.44
	-13.7	-15	17.74	6.99	16.75	6.52	15.75	6.06	15.15	5.84	14.65	5.63	13.66	5.20
	-11.8	-13	17.74	6.63	16.75	6.20	15.75	5.77	15.15	5.56	14.65	5.35	13.66	4.95
	-9.8	-11	17.74	6.28	16.75	5.87	15.75	5.47	15.15	5.27	14.65	5.08	13.66	4.70
	-9.5	-10	17.74	6.11	16.75	5.71	15.75	5.33	15.15	5.14	14.65	4.95	13.66	4.58
	-8.5	-9.1	17.74	5.96	16.75	5.58	15.75	5.20	15.15	5.02	14.65	4.84	13.66	4.47
	-7	-7.6	17.74	5.71	16.75	5.35	15.75	4.99	15.15	4.82	14.65	4.65	13.66	4.30
	-5	-5.6	17.74	5.39	16.75	5.05	15.75	4.72	15.15	4.56	14.65	4.40	13.66	4.07
	-3	-3.7	17.74	5.10	16.75	4.79	15.75	4.47	15.15	4.32	14.65	4.17	13.66	3.87
	0	-0.7	17.74	4.68	16.75	4.40	15.75	4.12	15.15	3.98	14.65	3.85	13.66	3.58
	3	2.2	17.74	4.31	16.75	4.06	15.75	3.80	15.15	3.67	14.65	3.55	13.66	3.31
	5	4.1	17.74	4.09	16.75	3.85	15.75	3.61	15.15	3.49	14.65	3.38	13.66	3.15
	7	6	17.74	3.88	16.75	3.66	15.75	3.44	15.15	3.32	14.65	3.22	13.66	3.01
9	7.9	17.74	3.68	16.75	3.47	15.75	3.26	15.15	3.17	14.65	3.07	13.66	2.87	
11	9.8	17.74	3.50	16.75	3.30	15.75	3.11	15.15	3.02	14.65	2.92	13.66	2.73	
13	11.8	17.74	3.33	16.75	3.14	15.75	2.96	15.15	2.87	14.65	2.78	13.66	2.61	
15	13.7	17.74	3.17	16.75	3.00	15.75	2.83	15.15	2.74	14.65	2.66	13.66	2.49	





















## 8. Operation limits

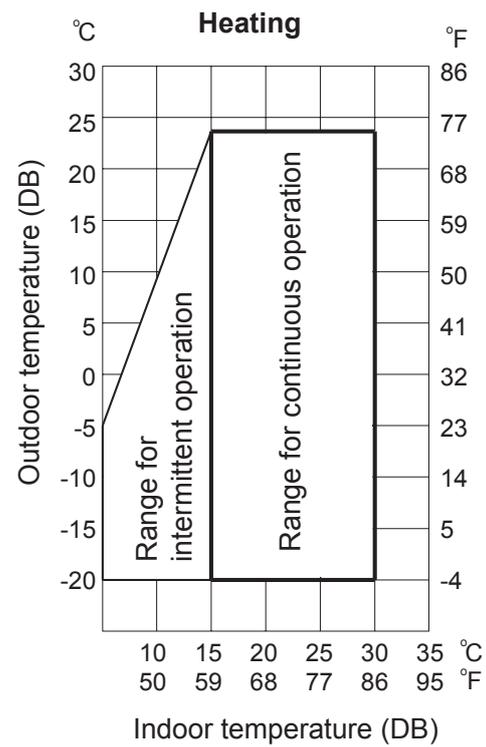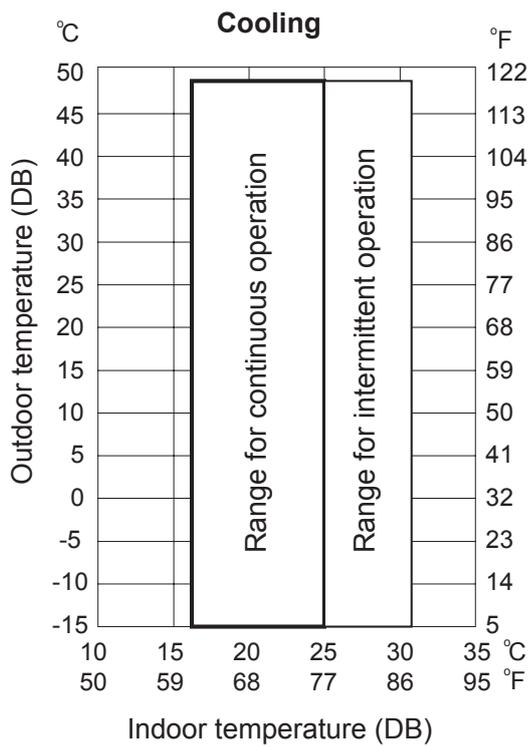

Note:


1. These figures assume the following operating conditions:

Equivalent piping length: 7.5m

Level difference: 0

2. If the system is running in cooling mode, when the ambient temperature is lower than  $-5^{\circ}\text{C}$  or higher than  $48^{\circ}\text{C}$ , the unit will stop for protection control.

### 9. Sound levels

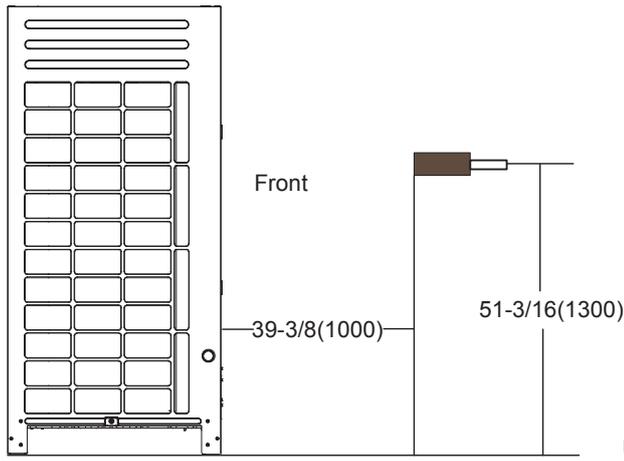


Notes:

- Data is valid at free field condition
- Data is valid at nominal operating condition
- Sound level will vary depending on a range of factors such as the construction (acoustic absorption coefficient) of particular room in which the equipment is installed
- Sound level can be increased in static pressure mode or used air guide.


Model	Sound pressure level d(B)A
MVUR252B-VA3	57
MVUR280B-VA3	57
MVUR335B-VA3	58
MVUR400B-VA3	60
MVUR450B-VA3	60

#### Sound pressure spectrum


MVUR252B-VA3, MVUR280B-VA3

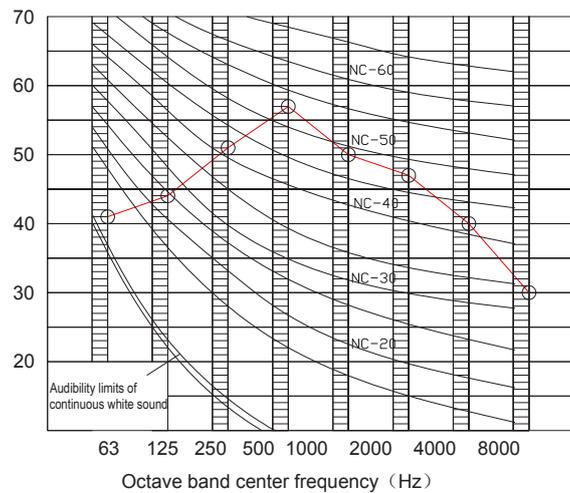


MVUR335B-VA3

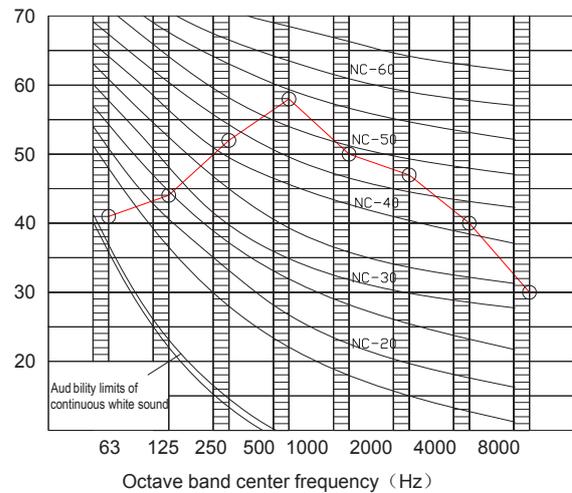

MVUR400B-VA3

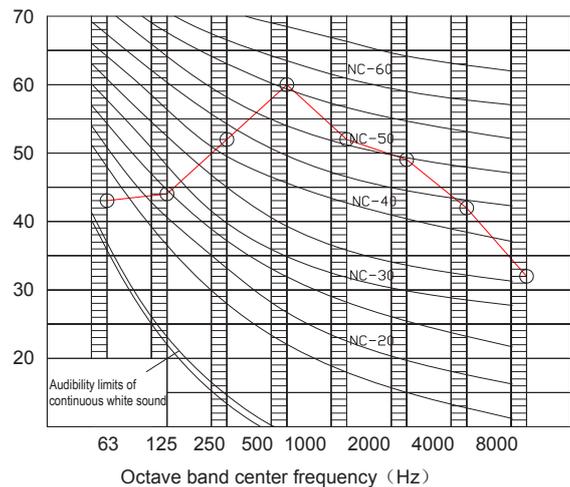

MVUR450B-VA3

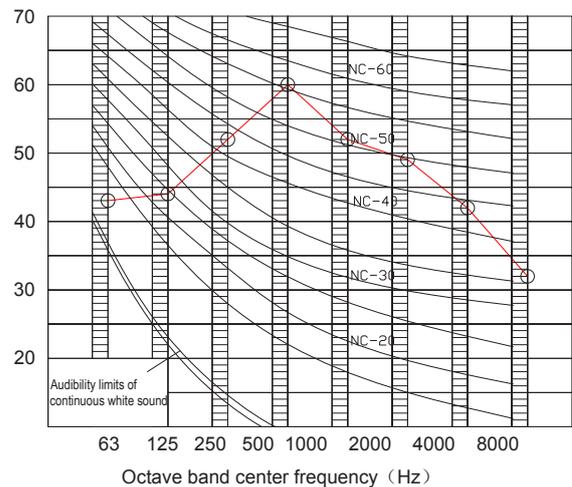

## 10. Accessories

Branch joint of outdoor & indoor unit

Optional accessories	Model name	Packing Size (mm)	Net/gross Weight (kg)	Function
Branch Joint of outdoor unit	FQZHW-02SB	272×167×232	1.6/2.2	Distribute the refrigerant to indoor units and balance the resistance between each outdoor unit.
	FQZHW-03SB	472×157×312	3.9/5.0	
	FQZHW-04SB	745×160×335	6.2/7.5	
Branch Joint between MS and outdoor unit	FQZHN-01D	290×105×100	0.3/0.4	
Branch Joint between MS and indoor unit	FQZHN-01SB	257×127×107	0.6/0.8	
	FQZHN-02SB	287×137×107	0.7/0.9	
	FQZHN-03SB	297×167×177	1.1/1.4	
	FQZHN-04SB	372×197×187	1.6/2.3	
	FQZHN-05SB	432×222×227	2.2/3.3	

Other optional accessories

Optional accessories	Model name	Function
Outdoor controller	MD-CCM02/E	Monitor the outdoor operating parameter
Three phase electricity power protector	DPA51CM44 or HWUA/DPB71CM48	To stop the air-conditioner running in case of bad power supply such as Phase Error, Over-voltage, Under-voltage lose, phase lost and phase sequence inverse. Thus to protect the equipment.
Digital ammeter (WHM)	DTS634/DT636	Electricity Charge monitor

# Part 4 Outdoor Unit Installation


1.	Select installation position.....	101
2.	Foundation for installation .....	102
3.	Master and slave unit setting .....	104
4.	Installation space .....	105
5.	Air ventilation assembly installation.....	107
6.	Refrigerant piping installation .....	109
7.	Caution for brazing .....	117
8.	Remove dirt or water in the piping .....	118
9.	Gas tightness test .....	119
10.	Vacuum .....	120
11.	Additional refrigerant charge.....	122
12.	Electric wiring installation.....	123
13.	Running test .....	130

## 1. Select installation position

- ◆ Ensure that the outdoor unit is installed in a dry, well-ventilated place.
- ◆ Ensure that the noise and exhaust ventilation of the outdoor unit do not affect the neighbors of the property owner or the surrounding ventilation.
- ◆ Ensure that the outdoor unit is installed in a well-ventilated place that is possibly closest to the indoor unit.
- ◆ Ensure that the outdoor unit is installed in a cool place without direct sunshine exposure or direct radiation of high-temp heat source.
- ◆ Do not install the outdoor unit in a dirty or severely polluted place, so as to avoid blockage of the heat exchanger in the outdoor unit.
- ◆ Do not install the outdoor unit in a place with oil pollution or full of harmful gas such as sulfurous gas.
- ◆ Do not install the outdoor unit in a place surrounded by salty air. (Except for the models with corrosion-resistant function)

## 2. Foundation for installation


- ◆ A solid, correct base can: Avoid the outdoor unit from sinking and avoid the abnormal noise generated due to base.
- ◆ Base types: Steel structure base or concrete base (See the figure below for the general making method)

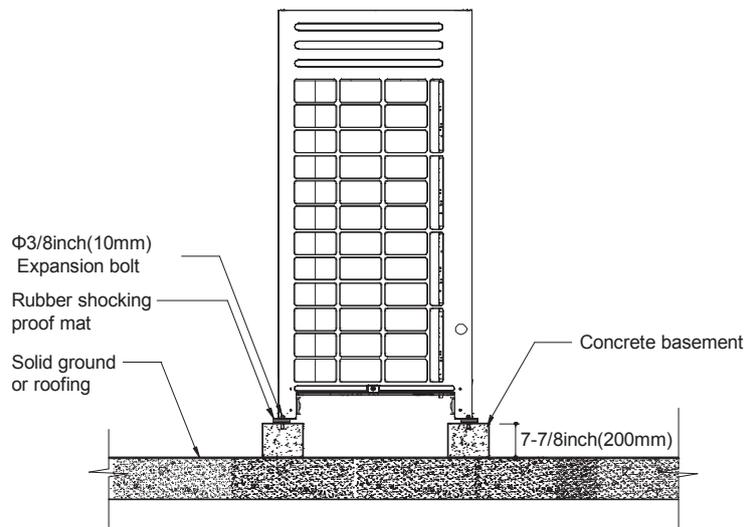

Note: The key points to make basement:

- The master unit's basement must be made on the solid concrete ground. Refer to the structure diagram to make concrete basement in detail, or make after field measurements.
- In order to ensure every point can contact equality, the basement should be on completely level.
- If the basement is placed on the roofing, the detritus layer isn't needed, but the concrete surface must be flat. The standard concrete mixture ratio is cement 1/ sand 2/ carpolite 4, and adds  $\Phi 3/8$ inch(10mm) strengthen reinforcing steel bar, the surface of the cement and sand plasm must be flat, border of the basement must be chamfer angle.
- Before construct the unit base, please ensure the base is directly supporting the rear and front folding edges of the bottom panel vertically, for the reason of these edges are the actual supported sites to the unit.
- In order to drain off the seeper around the equipment, a discharge ditch must be setup around the basement.
- Please check the affordability of the roofing to ensure the load capacity.
- When piping from the bottom of the unit, the base height should be no less than 200mm.

- ◆ Position illustration of screw bolt (Unit: mm)

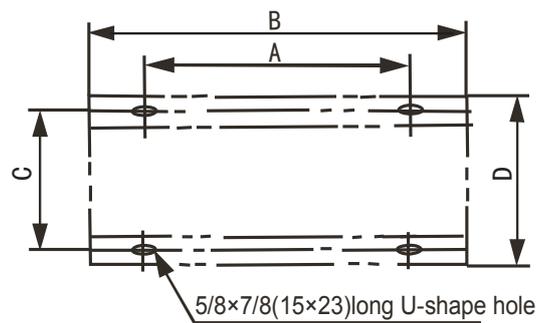


Size (mm)	8-16HP
A	1120
B	1250
C	736
D	765

### 3. Master and slave unit setting

When the quantity of outdoor unit is more than two in one system, the outdoor unit should be placed from large capacity unit to small capacity unit. The largest capacity unit must be placed at the first branch site, and be set as master unit, while the other are set as slave units.

Take 38HP (composed by 10HP, 12HP and 16HP) as an example:



- 1) Place the 16HP at a side of the first branch site.
- 2) Place the unit from the large capacity to small (See the detail placement illustration)
- 3) Set 16HP as the master unit, while the 12HP and the 10HP as slave units.

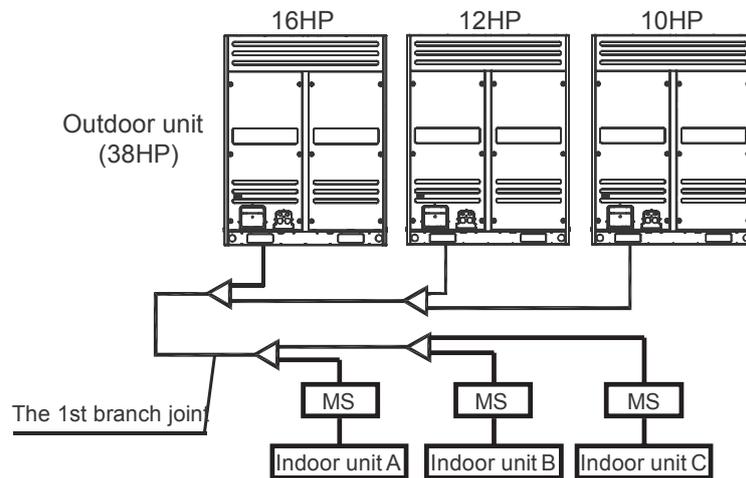

### 4. Installation space

- ◆ Ensure enough space for maintenance. The modules in the same system must be on the same height.
- ◆ When installing the unit, leave enough space for maintenance.


Unit: in.(mm)

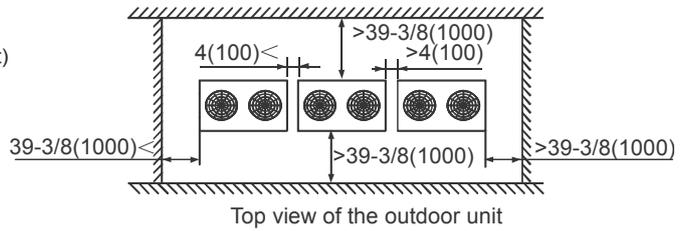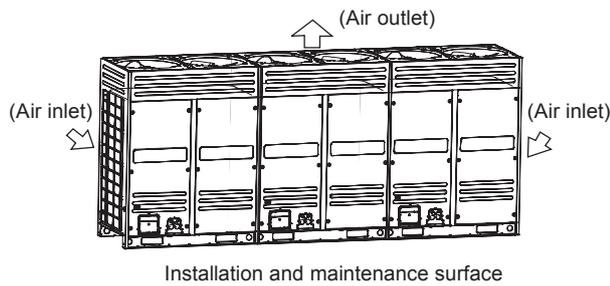


- When the outdoor unit is higher than the surrounding obstacle

Unit: mm


One row

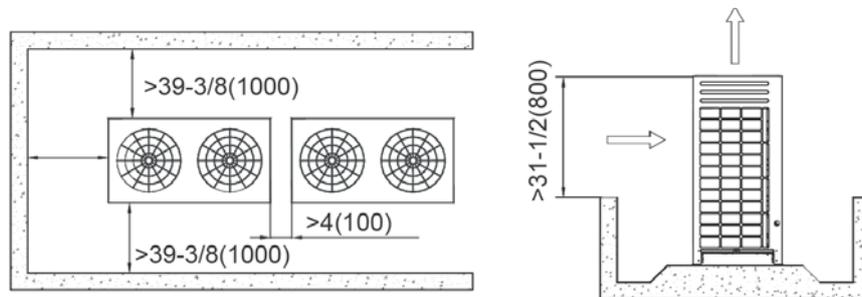

Two rows

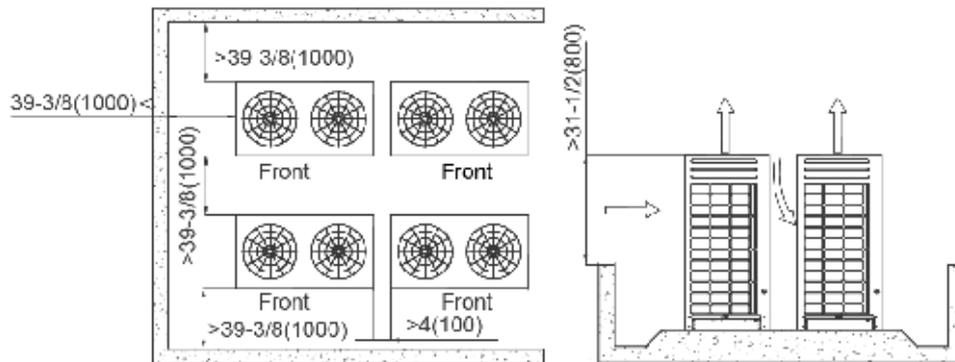


More than two rows

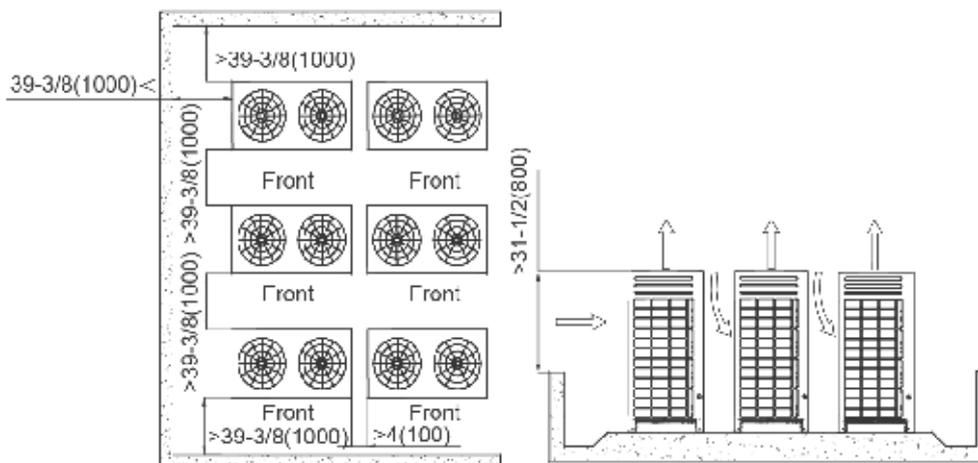


- When the outdoor unit is lower than the surrounding obstacle, to avoid cross connection of the outdoor hot air from affecting the heat exchange effect, please add an air director onto the exhaust hood of the outdoor

unit to facilitate heat dissipation. See the figure below. The height of the air director is HD (namely H-h). Please make the air director on site.

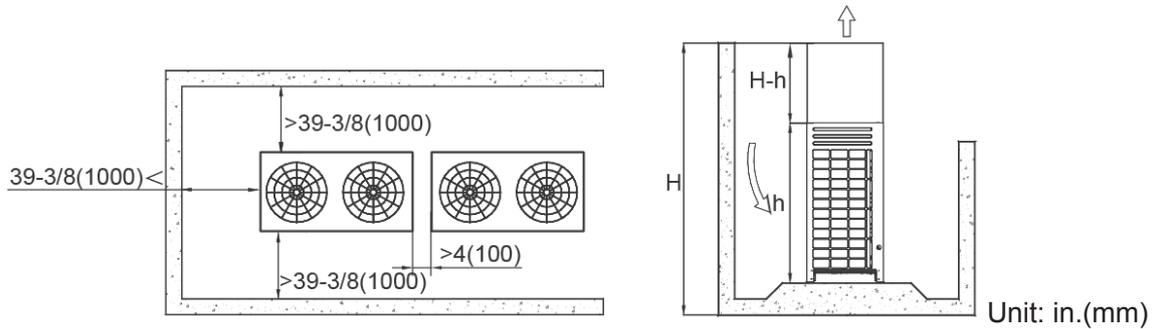


- If miscellaneous articles are piled around the outdoor unit, such articles must be 800mm below the top of the outdoor unit. The articles must be 800mm below the top of the outdoor unit. Otherwise, a mechanic exhaust device must be added.

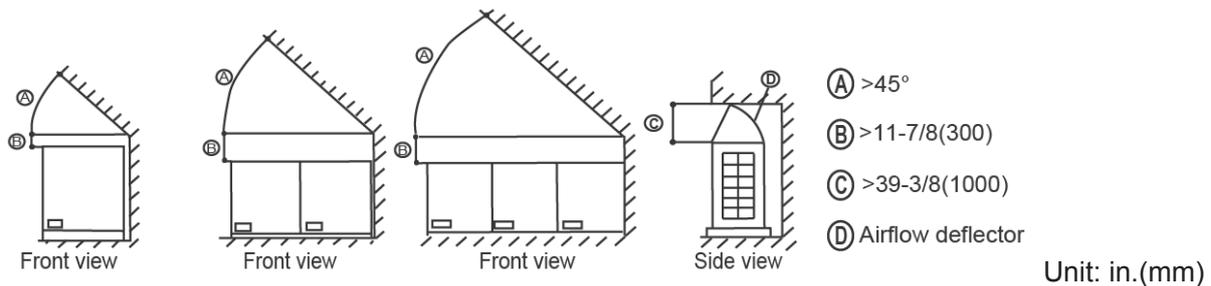

- Set the snow-proof facility

In snowy areas, facilities should be installed to prevent snow. (See the figure below) (Defective facilities may cause malfunction.) Please lift the bracket higher and install snow shield at the air inlet and air outlet.

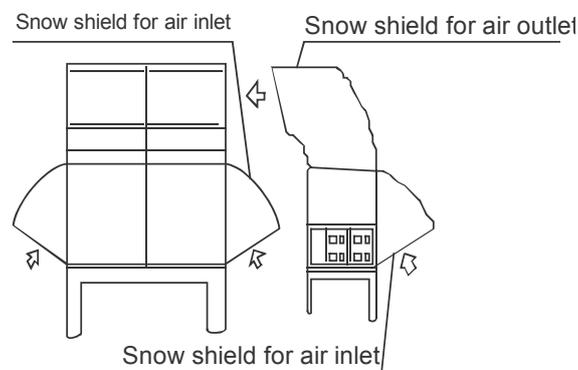


### 5. Air ventilation assembly installation

The ventilation assembly is provided at the field installation. When installing, please take off the mesh cover firstly, and then install the unit as the following method.


Example A


Unit: in.(mm)

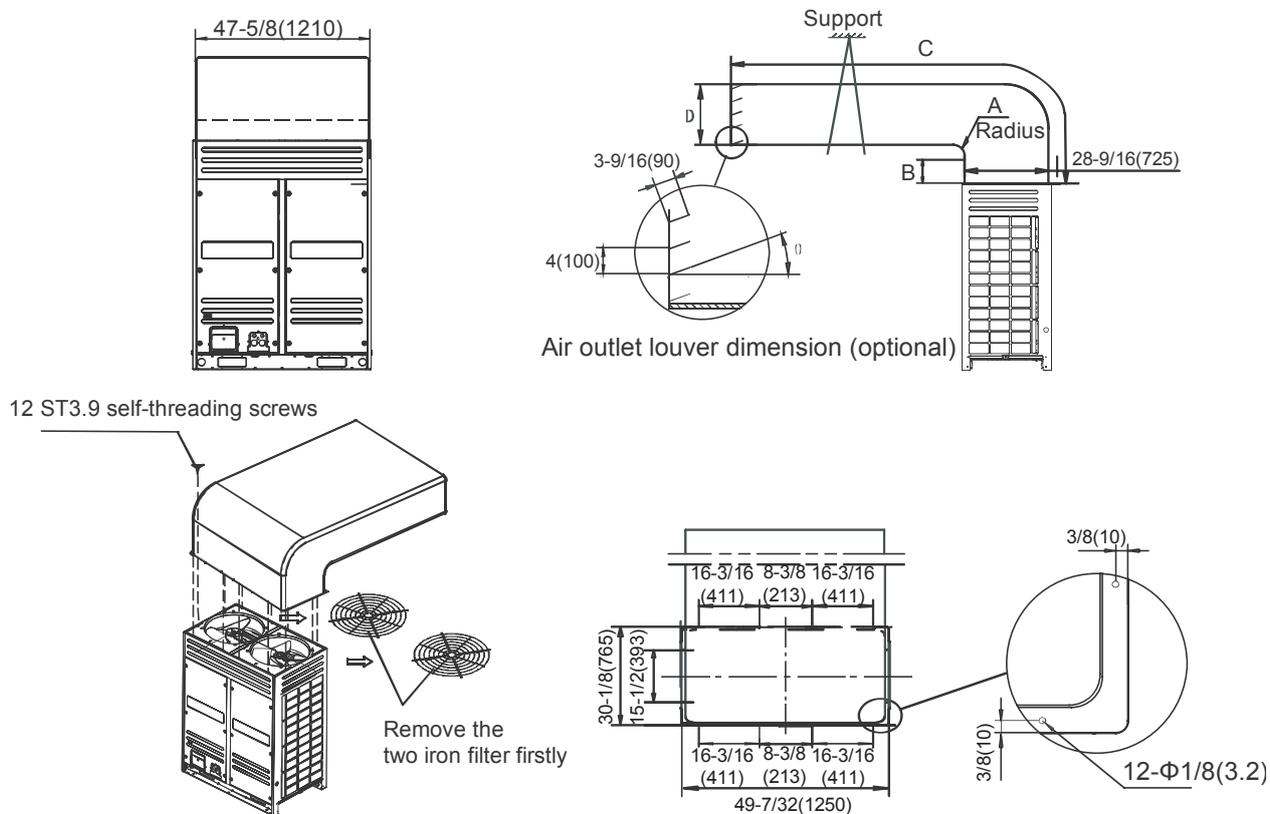

Example B

Unit: in.(mm)

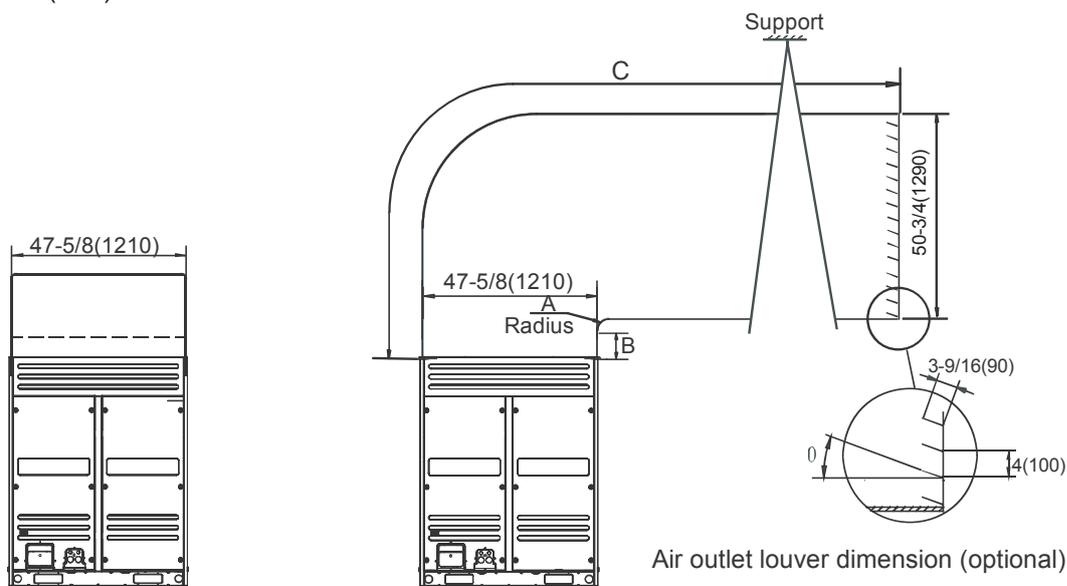

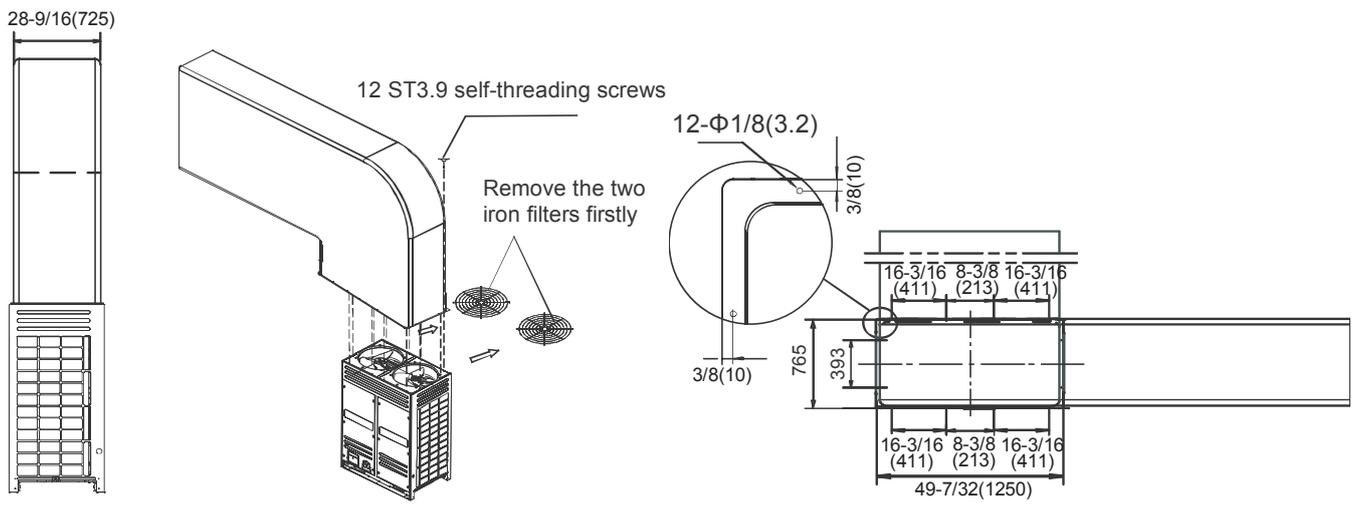

Unit: mm

Example A	
A	$A \geq 300$
B	$B \geq 250$
C	$C \leq 3000$
D	$725 \leq D \leq 760$
$\theta$	$\theta \leq 15^\circ$


Example B	
A	$A \geq 300$
B	$B \geq 250$
C	$C \leq 3000$
$\theta$	$\theta \leq 15^\circ$

**Outdoor fan performance**

The default static pressure of outdoor unit is 0 Pa, and 20Pa can be achieved when the steel mesh is removed.


**8/10HP**

Air volume  $m^3/h(CFM)$

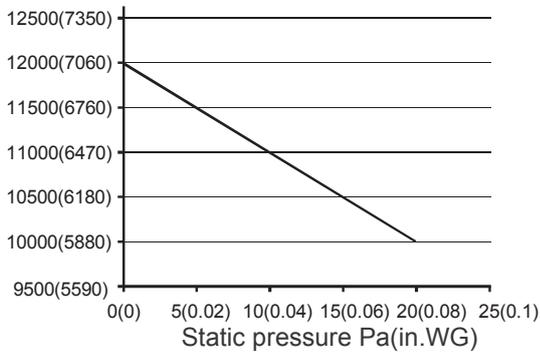


**12HP**

Air volume  $m^3/h(CFM)$

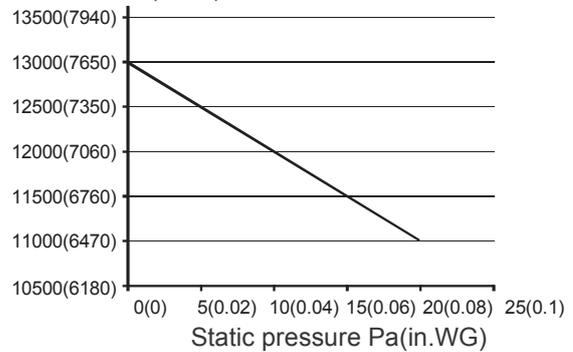

**14/16HP**

Air volume  $m^3/h(CFM)$

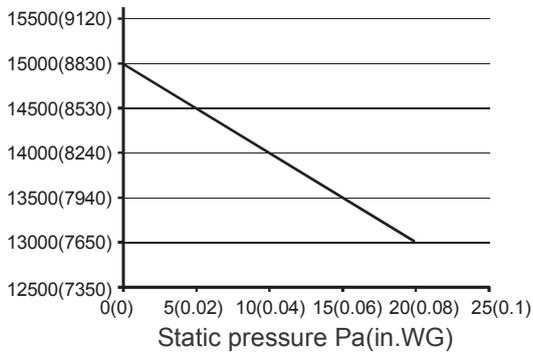


**Note:**

Before install the ventilation assembly, please remove the steel meshes firstly, otherwise, they would decrease the air supply volume.

1. Increase shutters would decrease the air supply volume, as well as cooling (heating) capacity and energy efficiency would be decreased, the larger angle of the shutter, the more effect to the unit. So we don't recommend applying shutter, if necessary to apply shutter, please ensuring the angle should not over than  $15^\circ$ .
2. The bending place at ventilated duct should be not more than 1(show in above figure), otherwise, operation malfunction would be caused.
3. Install the flexible connector between the unit and the air deflector pipe to avoid vibration noise.

## 6. Refrigerant piping installation

### 6.1 Refrigerant piping length permitted value

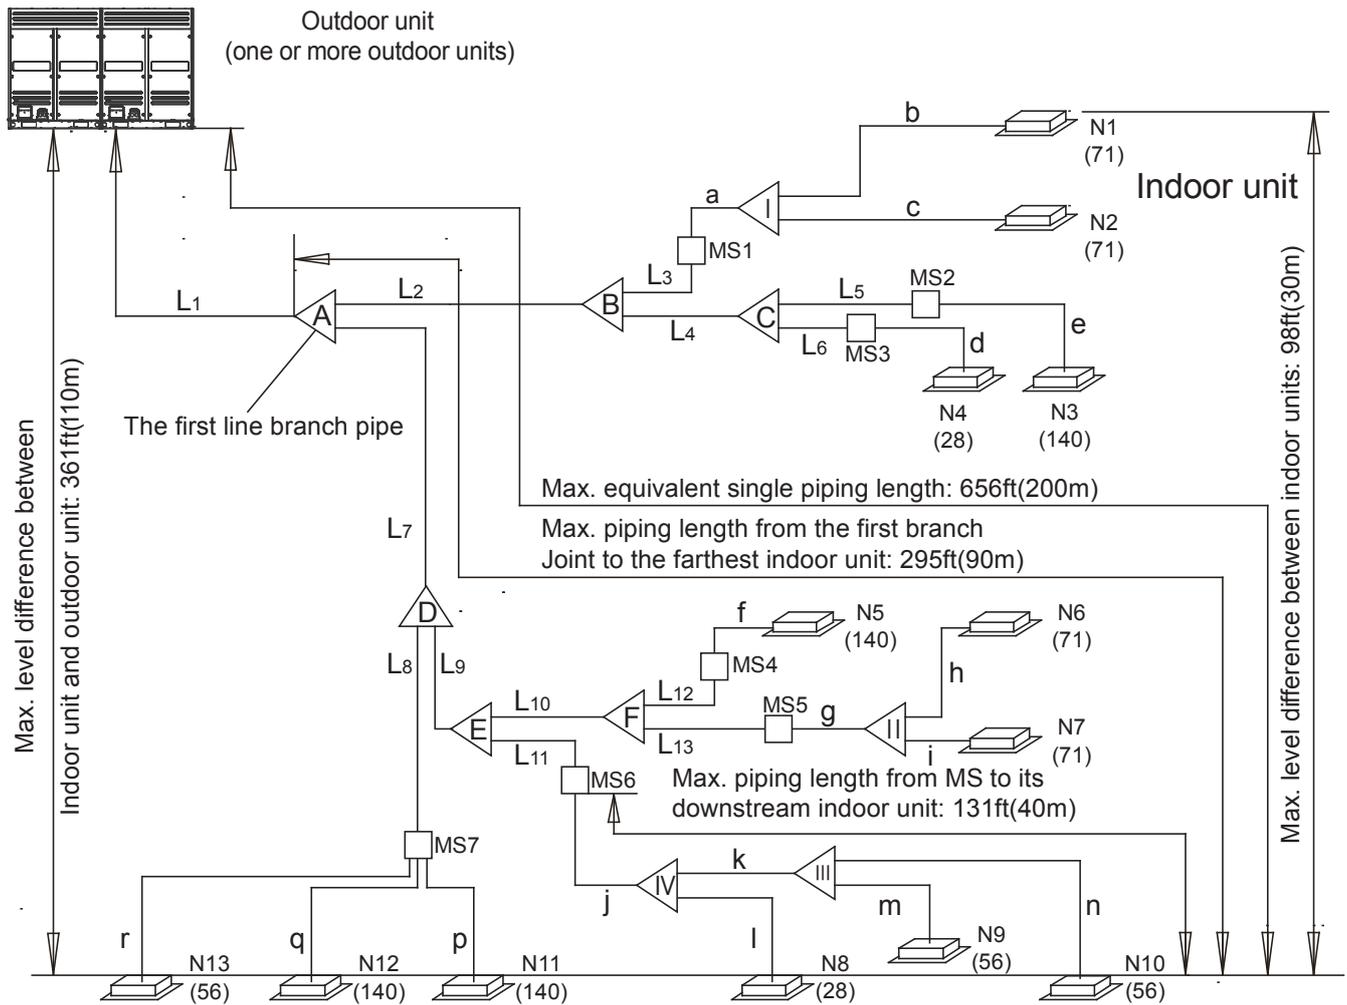

Piping length		Permitted value	Piping	
Piping length	Total piping length	≤1000m (refer to note 1)	$L1+(L2+L3+L4+L5+L6+L7+L8+L9+L10+L11+L12+L13) \times 2+a+b+c+d+e+f+g+h+i+j+k+l+m+n$	
	Single piping length	Actual length	≤175m	$L1+L7+L9+L11+j+k+n$
		Equivalent length	≤200m (refer to note 2)	
	Piping length from the first branch joint to the farthest indoor unit		≤40/90m (refer to note 3)	$L7+L9+L11+j+k+n$
Piping length from MS to the downstream indoor unit of itself		≤40m	$j+k+n$	
Level difference	Level difference between indoor unit and outdoor unit	Outdoor unit up	≤ 70m (refer to note 4)	/
		Outdoor unit down	≤110m (refer to note 5)	/
	Level difference between indoor units		≤30m	/

Note:

The indoor units should be installed as possible as equal in the both sides of the U-shape branch joint.

1. When counting the total piping length, the actual length of the distribution pipes which between the first branch joint and MS should be double:

$$\text{Total piping length} = L1+(L2+L3+L4+L5+L6+L7+L8+L9+L10+L11+L12+L13) \times 2+a+b+c+d+e+f+g+h+i+j+k+l+m+n \leq 1000m$$

2. The equivalent length of each branch pipe is 0.5m.
3. The allowable piping length from the first branch joint to the farthest indoor unit should be equal to or less than 40m, but when the following conditions are all met, the allowable length can be extended to 90m.
  - The piping length from each indoor unit to the nearest branch joint or direct connected MS should be less than 40m. (b, c, d, e, f, h, i, l, m, n, p, q, r ≤ 40m)
  - The length difference between (the outdoor unit to the farthest indoor unit) and (the outdoor unit to the nearest indoor unit) ≤ 40m.

The farthest indoor unit: N10

The nearest indoor unit: N11

$$(L1+L7+L9+L11+j+k+n)-(L1+L7+L8+p) \leq 40m$$


- It needs to increase distribution pipes which between the first branch and MS (L2~L13). (Please change the pipe diameter at field) If the pipe diameter of the main slave pipe is the same as the main pipe, then it is no need to be increased.

When:  $40m < L7+L9+L11+j+k+n \leq 90m$  L2~L13 need to increase the pipe diameter.

Increasing size as the following: unit (mm)


Φ3/8(9.53)→ Φ1/2(12.7)	Φ1/2(12.7)→ Φ5/8(15.9)	Φ5/8(15.9)→ Φ3/4(19.1)	Φ3/4(19.1)→ Φ7/8(22.2)	Φ7/8(22.2)→ Φ1(25.4)	Φ1(25.4)→ Φ1-1/8(28.6)
Φ1-1/8(28.6)→ Φ1-1/4(31.8)	Φ1-1/4(31.8)→ Φ1-1/2(38.1)	Φ1-1/2(38.1)→ Φ1-5/8(41.3)	Φ1-5/8(41.3)→ Φ1-3/4(44.5)	Φ1-3/4(44.5)→ Φ2-1/8(54.0)	

4. When the outdoor unit is higher than indoor units and the level difference is over 20m, it is recommended to set an oil return bend every 10m in the gas pipe of the main pipe, the specification of the oil return bend refers to below figure.

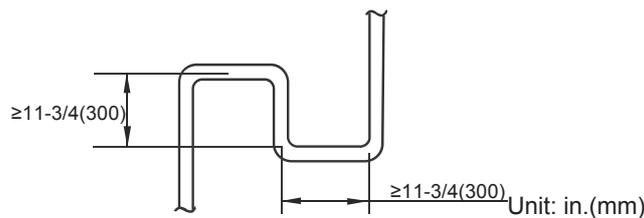

5. When the outdoor unit is lower than indoor units and the level difference is more than 40m, the liquid pipe of the main pipe need to increase one size.

### 6.2 Refrigerant piping selection

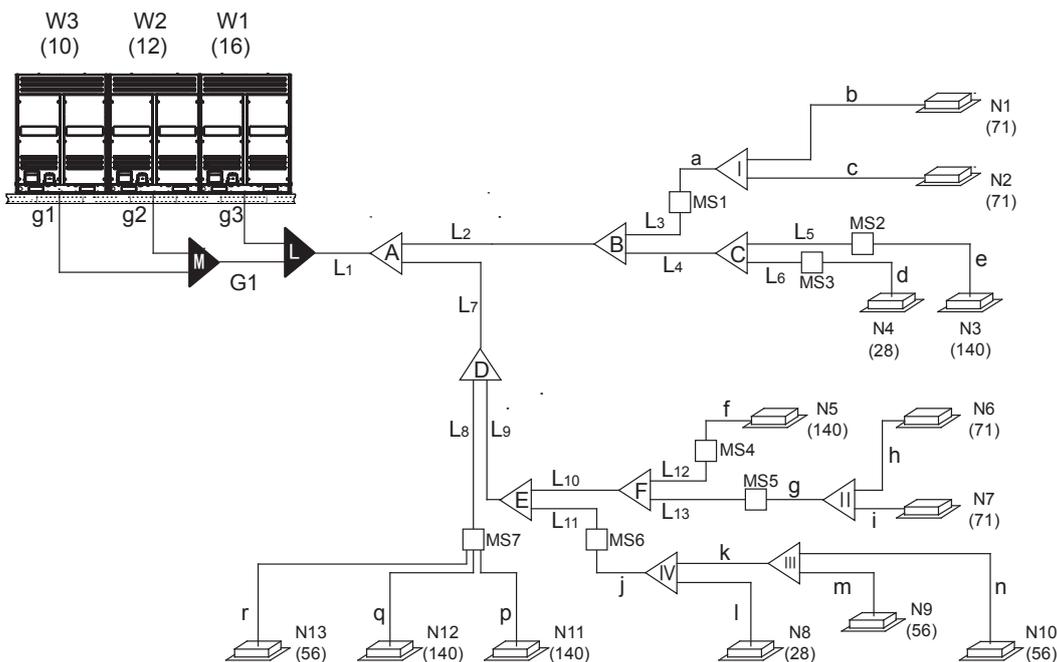

- Pipe name

Main pipe	L1
-----------	----

Indoor unit main pipe	L2, L3, L4, L5, L6, L7, L8, L9, L10, L11, L12, L13
Indoor unit auxiliary pipe between MS and downstream branch joint	a, g, j, k
Indoor unit auxiliary pipe from indoor unit to the nearest branch joint or direct connected MS	b, c, d, e, f, h, i, l, m, n, p, q, r
Branch pipe assembly between main pipe and MS	A, B, C, D, E
Branch pipe assembly between MS and indoor unit	I, II, III, IV
Outdoor unit branch pipe assembly	L, M
Outdoor connection pipe	g1, g2, g3, G1
MS equipment	MS1,...MS7

➤ Table 1: Indoor unit main pipe selection (L1~L13) Unit: mm


Capacity of indoor unit kW(kBtu/h)	Indoor unit main pipe mm			
	Low pressure gas pipe	High pressure gas pipe	Liquid pipe	Available branching pipe assembly
A<5.6	Φ12.7	Φ9.53	Φ6.35	FQZHN-01SB
5.6≤A<16.6	Φ19.1	Φ15.9	Φ9.53	FQZHN-01SB
16.6≤A<23	Φ22.2	Φ19.1	Φ9.53	FQZHN-02SB
23≤A<33	Φ22.2	Φ19.1	Φ12.7	FQZHN-02SB
33≤A<46	Φ28.6	Φ22.2	Φ12.7	FQZHN-03SB
46≤A<66	Φ28.6	Φ22.2	Φ15.9	FQZHN-03SB
66≤A<92	Φ34.9	Φ28.6	Φ19.1	FQZHN-04SB
92≤A<135	Φ41.3	Φ34.9	Φ19.1	FQZHN-05SB
135≤A	Φ44.5	Φ38.1	Φ22.2	FQZHN-05SB

➤ Table 2: Main pipe selection (L1) Unit: mm

Model	Main pipe mm							
	When the equivalent length of all liquid pipes<90m				When the equivalent length of all liquid pipes≥90m			
	Low pressure gas pipe	High pressure gas pipe	Liquid pipe	The 1 <sup>st</sup> branching pipe	Low pressure gas pipe	High pressure gas pipe	Liquid pipe	The 1 <sup>st</sup> branching pipe
8HP	Φ22.2	Φ19.1	Φ9.53	FQZHN-02SB	Φ22.2	Φ19.1	Φ12.7	FQZHN-02SB
10HP	Φ22.2	Φ19.1	Φ12.7	FQZHN-02SB	Φ22.2	Φ19.1	Φ12.7	FQZHN-02SB
12HP	Φ25.4	Φ19.1	Φ12.7	FQZHN-03SB	Φ25.4	Φ19.1	Φ15.9	FQZHN-03SB
14-16HP	Φ28.6	Φ22.2	Φ15.9	FQZHN-03SB	Φ28.6	Φ22.2	Φ15.9	FQZHN-03SB
18-22HP	Φ31.8	Φ28.6	Φ15.9	FQZHN-03SB	Φ31.8	Φ28.6	Φ19.1	FQZHN-03SB
24HP	Φ34.9	Φ28.6	Φ15.9	FQZHN-04SB	Φ34.9	Φ28.6	Φ19.1	FQZHN-04SB
26-32HP	Φ34.9	Φ28.6	Φ19.1	FQZHN-04SB	Φ34.9	Φ28.6	Φ22.2	FQZHN-04SB
34-48HP	Φ41.3	Φ34.9	Φ19.1	FQZHN-05SB	Φ41.3	Φ34.9	Φ22.2	FQZHN-05SB
50-64HP	Φ44.5	Φ38.1	Φ22.2	FQZHN-05SB	Φ44.5	Φ38.1	Φ25.4	FQZHN-05SB

**Note: the main pipe L1 can be selected from table1 or table2, the larger size should be finally selected.**

- Outdoor unit branch pipe assembly

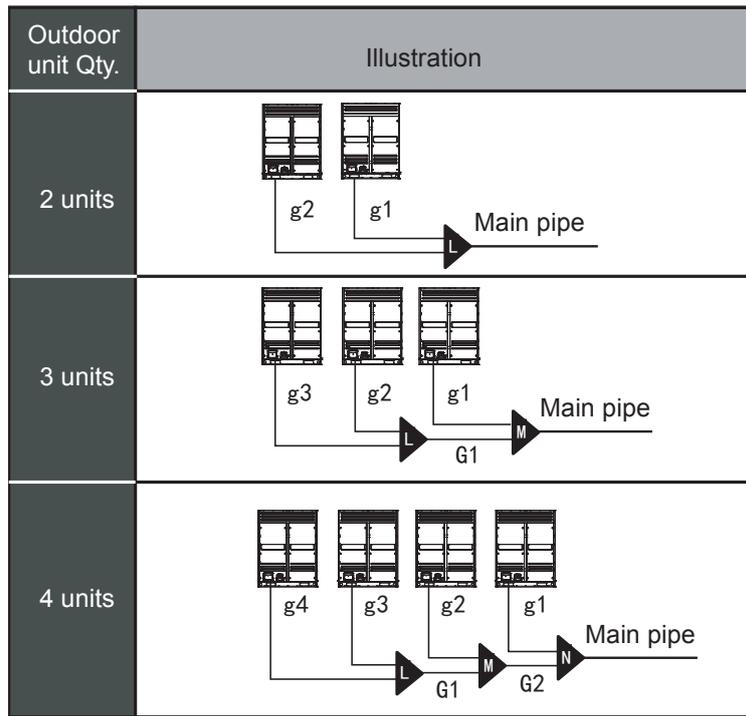

➤ Table 3: Outdoor unit connection pipe selection (g1, g2, g3, g4, G1, G2) Unit: mm

Pipe		Low pressure gas pipe	High pressure gas pipe	Liquid pipe
g1,g2,g3,g4	8/10/12HP	Φ22.2	Φ19.1	Φ12.7
	14/16HP	Φ28.6	Φ22.2	Φ15.9
G1		Φ34.9	Φ28.6	Φ19.1
G2		Φ41.3	Φ34.9	Φ22.2

➤ Table 4: Outdoor unit branching pipe assembly selection (L, M, N)

Outdoor unit quantity	Parallel connect with the branch pipes
2 units	L: FQZHW-02SB
3 units	L+M: FQZHW-03SB
4 units	L+M+N: FQZHW-04SB

- Indoor unit auxiliary pipe selection

➤ Table 5: Indoor unit auxiliary pipe between MS and downstream branch joint selection (a, g, j, k)

Capacity of indoor unit kW	Gas pipe (mm)	Liquid pipe (mm)	Available branching pipe
A<16.6	Φ15.9)	Φ9.53)	FQZHN-01D


➤ Table 6: Indoor unit auxiliary pipe from indoor unit to the nearest branch joint or direct connected MS selection (b, c, d, e, f, h, i, l, m, n, p, q, r) Unit: mm

Capacity of indoor unit kW	The pipe length from indoor unit to the nearest branch joint or direct connected MS≤10m		The pipe length from indoor unit to the nearest branch joint or direct connected MS>10m	
	Gas pipe	Liquid pipe	Gas pipe	Liquid pipe
A<5.6	Φ12.7	Φ6.35	Φ15.9	Φ9.53
5.6≤A<16	Φ15.9	Φ9.53	Φ19.1	Φ12.7

### 6.3 Example

The example is as blow:

Provided that the capacity of outdoor unit is (16+12+10) HP, the equivalent length of all pipes in this system is larger than 90m, the pipe length from the 1<sup>st</sup> branch joint to the farthest indoor unit is less than 40m, and the pipe from indoor unit to the nearest branch joint or direct connected MS is less than 10m.

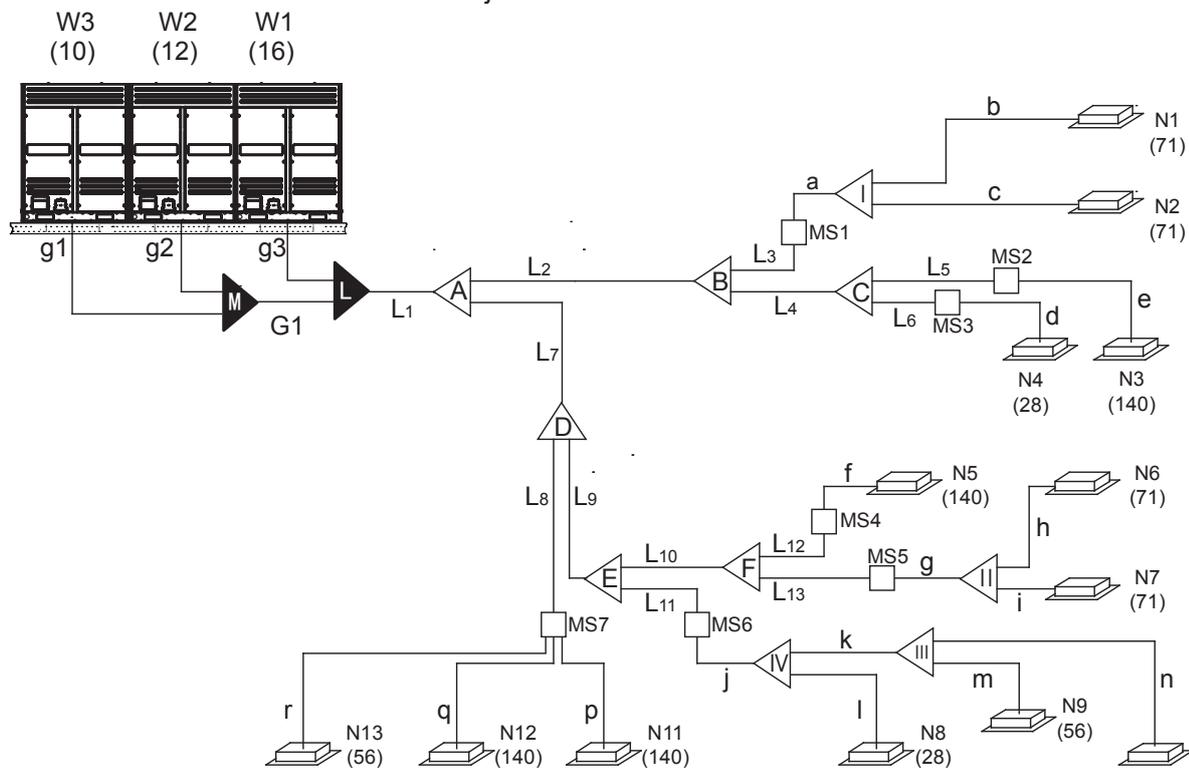

1. Select indoor unit auxiliary pipes from indoor unit to the nearest branch joint or direct connected MS: b, c, d, e, f, h, i, l, m, n, p, q, r.

Refer to table 6, the pipes of b, c, e, f, h, i, m, n, p, q and r are  $\Phi 15.9 / \Phi 9.53$ , and the pipes of d and l are  $\Phi 12.7 / \Phi 6.35$ .

2. Select indoor unit auxiliary pipes between MS and downstream branch joint: a, g, j, k.

Refer to table 5, the pipes of a, g, j and k are  $\Phi 15.9 / \Phi 9.53$ , the brand pipe assembly I, II, III and IV are FQZHN-01D.

3. Select indoor unit main pipes: L1~L13

- The downstream indoor units of L3 are N1 and N2, which capacity is  $7.1 \times 2 = 14.2$  kW. Refer to table 1, the indoor unit main pipe L3 is  $\Phi 19.1 / \Phi 15.9 / \Phi 9.53$ , select MS02/N1-C for MS1.
- The downstream indoor unit of L5 is N3, which capacity is 14 kW. Refer to table 1, the indoor unit main pipe L5 is  $\Phi 19.1 / \Phi 15.9 / \Phi 9.53$ , select MS02/N1-C for MS2.
- The downstream indoor unit of L6 is N4, which capacity is 2.8 kW. Refer to table 1, the indoor unit main pipe L6 is  $\Phi 12.7 / \Phi 9.53 / \Phi 6.35$ , select MS02/N1-C for MS3.
- The downstream indoor units of L4 are N3 and N4, which capacity is  $14 + 2.8 = 16.8$  kW. Refer to table 1, the indoor unit main pipe L4 is  $\Phi 22.2 / \Phi 19.1 / \Phi 9.53$ , the branch pipe assembly C is FQZHN-02SB.
- The downstream indoor units of L2 are N1, N2, N3 and N4, which capacity is  $7.1 \times 2 + 14 + 2.8 = 31$  kW. Refer to table 1, the indoor unit main pipe L2 is  $\Phi 22.2 / \Phi 19.1 / \Phi 12.7$ , the branch pipe assembly B is FQZHN-02SB.
- The downstream indoor unit of L12 is N5, which capacity is 14 kW. Refer to table 1, the indoor unit main pipe L12 is  $\Phi 19.1 / \Phi 15.9 / \Phi 9.53$ , select MS02/N1-C for MS4.
- The downstream indoor units of L13 are N6 and N7, which capacity is  $7.1 \times 2 = 14.2$  kW. Refer to table 1, the indoor unit main pipe L13 is  $\Phi 19.1 / \Phi 15.9 / \Phi 9.53$ , select MS02/N1-C for MS5.
- The downstream indoor units of L10 are N5, N6 and N7, which capacity is  $14 + 7.1 \times 2 = 28.2$  kW. Refer to table 1, the indoor unit main pipe L10 is  $\Phi 22.2 / \Phi 19.1 / \Phi 12.7$ , the branch pipe assembly F is FQZHN-02SB.

- The downstream indoor units of L11 are N8, N9 and N10, which capacity is  $2.8+5.6\times 2=14$  kW. Refer to table 1, the indoor unit main pipe L11 is  $\Phi 19.1/ \Phi 15.9 / \Phi 9.53$ , select MS02/N1-C for MS6.
- The downstream indoor units of L9 are N5~N10, which capacity is  $14+5.6\times 2+7.1\times 2+2.8=42.2$  kW. Refer to table 1, the indoor unit main pipe L9 is  $\Phi 28.6/ \Phi 22.2/ \Phi 12.7$ , the branch pipe assembly E is FQZHN-03SB.
- The downstream indoor units of L8 are N11~N13, which capacity is  $14\times 2+5.6=33.6$  kW. Refer to table 1, the indoor unit main pipe L8 is  $\Phi 28.6/ \Phi 22.2/ \Phi 12.7$ , select MS04/N1-C for MS7.
- The downstream indoor units of L7 are N5~N13, which capacity is  $14\times 3+7.1\times 2+5.6\times 3+2.8=75.8$  kW. Refer to table 1, the indoor unit main pipe L7 is  $\Phi 34.9/ \Phi 28.6/ \Phi 19.1$ , the branch pipe assembly D is FQZHN-04SB.
- The downstream indoor units of L1 are N1~N13, which capacity is  $14\times 4+7.1\times 4+5.6\times 3+2.8\times 2=106.8$  kW. Refer to table 1, the indoor unit main pipe L1 is  $\Phi 41.3/ \Phi 34.9/ \Phi 19.1$ , the branch pipe assembly A is FQZHN-05SB.

#### 4. Select main pipe: L1

For the capacity of outdoor unit is 38HP, the equivalent length of all pipes in this system is larger than 90m, refer to table 2, the main pipe L1 is  $\Phi 41.3/ \Phi 34.9/ \Phi 22.2$ , the branch pipe assembly A is FQZHN-05SB.

As the main pipe L1 is selected as  $\Phi 41.3/ \Phi 34.9/ \Phi 19.1$  from step 3, and  $\Phi 41.3/ \Phi 34.9/ \Phi 22.2$  from step 4, we finally select the larger pipe  $\Phi 41.3/ \Phi 34.9/ \Phi 22.2$  as main pipe L1.


#### 5. Outdoor unit connection pipe (g1, g2, g3, G1,L+M) selection (refer to table3, table 4)

- The pipe g1 is connected to 10HP outdoor unit. Refer to table3, the diameter of g1 is  $\Phi 22.2 / \Phi 19.1/ \Phi 12.7$
- The pipe g2 is connected to 12HP outdoor unit. Refer to table3, the diameter of g2 is  $\Phi 22.2 / \Phi 19.1 / \Phi 12.7$
- The pipe g3 is connected to 16HP outdoor unit. Refer to table3, the diameter of g3 is  $\Phi 28.6/ \Phi 22.2 / \Phi 15.9$
- The upstream outdoor unit quantity of G1 is two. Refer to table3, the diameter of G1 is  $\Phi 34.9/ \Phi 28.6/ \Phi 19.1$
- The quantity of combined outdoor units is three. Refer to table4, the outdoor branch assembly is L+M: FQZHW-03SB

Note: For the detail dimension and installation information pipe, please read the branch pipe installation manual carefully.


### 6.4 Piping connection between outdoor units

All connection pipes between outdoor units should be horizontally, it is not allowed the concave at junction site. The height of each connection pipe between outdoor units is not allowed to over the height of refrigerant outlet pipe.


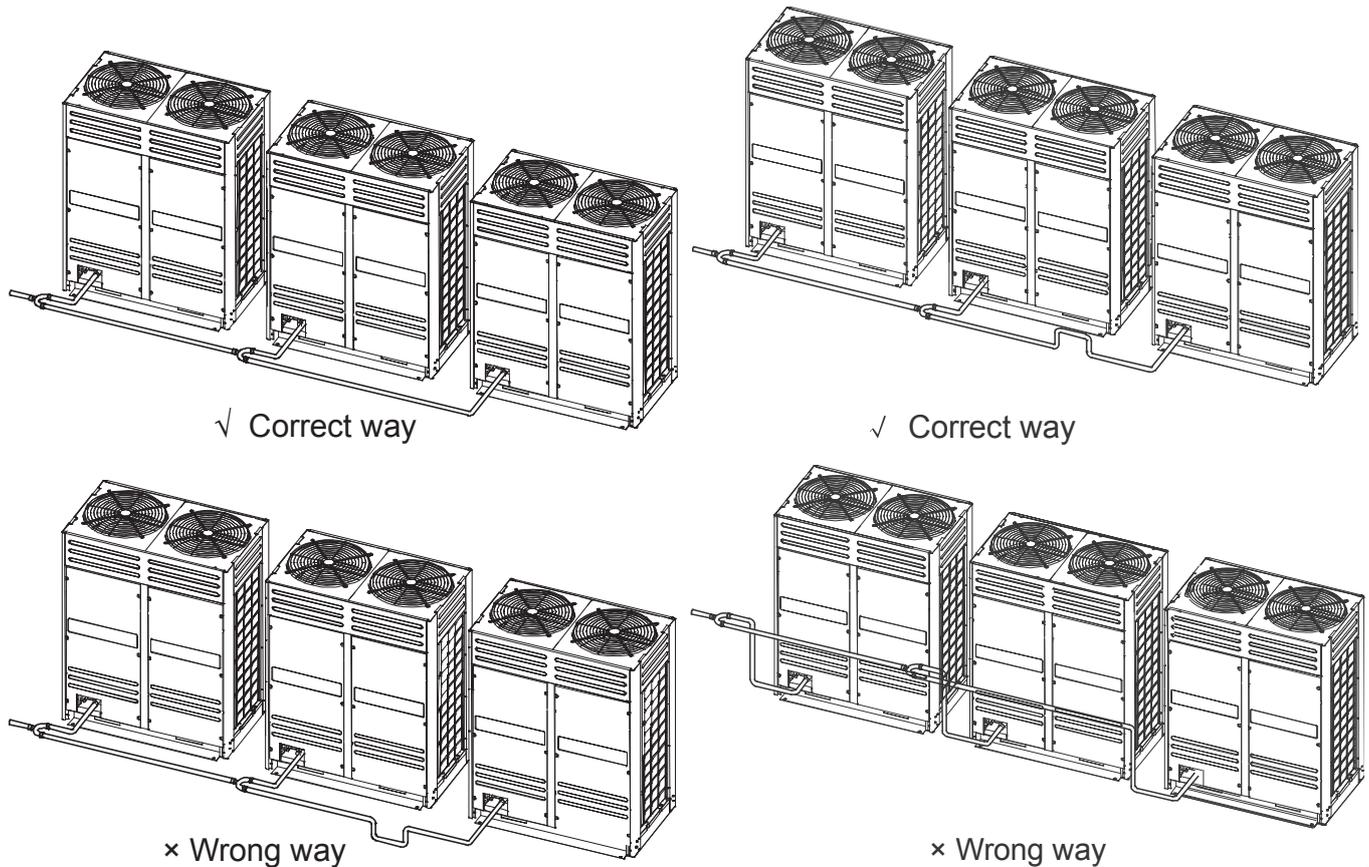


### 6.5 Branch pipe installation

The branching pipe must be installed horizontally and error angle of it should not be larger than  $10^\circ$ . Otherwise, refrigerant assignment will be uneven and malfunction will be caused.

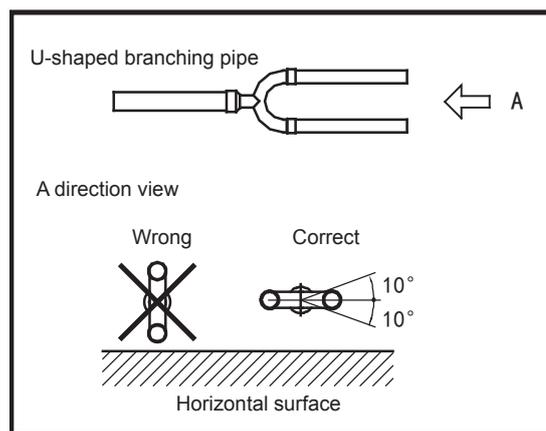


For avoiding oil accumulate at the outdoor unit, please install the branching pipes properly.

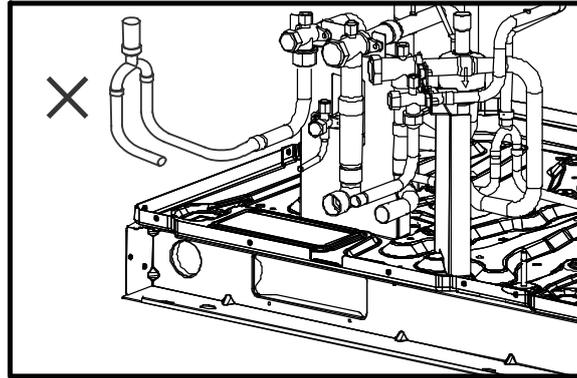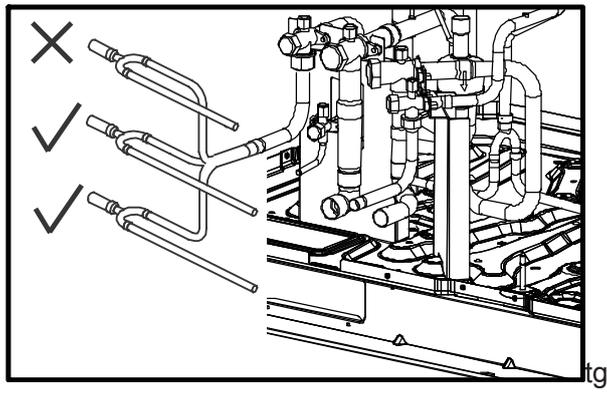

## 7. Caution for brazing

- Make sure to blow through with nitrogen when brazing. Blowing through with nitrogen prevents the creation of large quantities of oxidized film on the side of the pipe. An oxidized film adversely affects valves and compressors in the refrigerating system and prevents proper operation.
- The nitrogen pressure should be set to 0.02MPa (just enough so it can be felt on the skin) with a pressure-reducing valve.

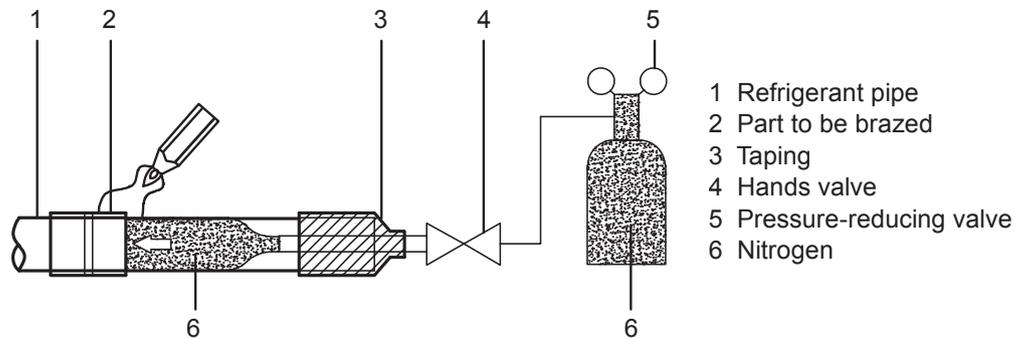


- Do not use anti-oxidants when brazing the pipe joints. Residue can clog pipes and break equipment.
- Do not use flux when brazing copper-to-copper refrigerant piping. Use phosphor copper brazing filler alloy (BCuP) which does not require flux.
- Flux has an extremely harmful influence on refrigerant pipe systems. For instance, if chlorine based flux is used, it will cause pipe corrosion in particular, if the flux contains fluorine, it will deteriorate the refrigerant oil.

## **8. Remove dirt or water in the piping**

- Make sure there is no any dirt or water in the pipe before connecting the piping to the outdoor units.
- Wash the piping with high pressure nitrogen, never use refrigerant of the outdoor unit to do that.

## 9. Gas tightness test

Charge 40kgf/cm<sup>2</sup> nitrogen gas from the high-pressure gas valve from the meter connector. Pressure inside should be maintained no less than 24 hrs.

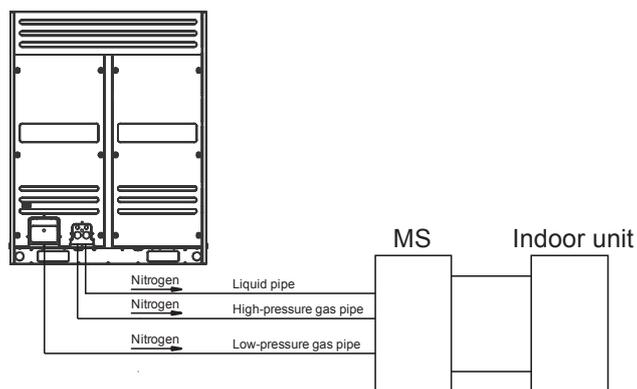


### Note:

- Pressurized nitrogen (3.9MPa; 40kgf/cm<sup>2</sup>) is used for airtightness test.
- It is not allowed to use oxygen, combustible gas or toxic gas to conduct the airtightness test.
- When welding, please use wet cloth insulating the low pressure valve for protection.
- To avoid the equipment be damaged, the pressure maintained time should not last too long.

## 10. Vacuum

- Use the vacuum pump which vacuum level lower than -0.1MPa and the air discharge capacity above 40L/min.
- The outdoor unit is not necessary to vacuum, don't open the outdoor unit gas and liquid pipe shut-off valves.
- Make sure the vacuum pump could result as -0.1MPa or below after 2 hours or above operation. If the pump operated 3 hours or above could not achieve to -0.1MPa or below, please check whether water mix or gas leak inside of the pipe.
- Pressure gauge with the switch is installed between vacuum pump and system pipes.

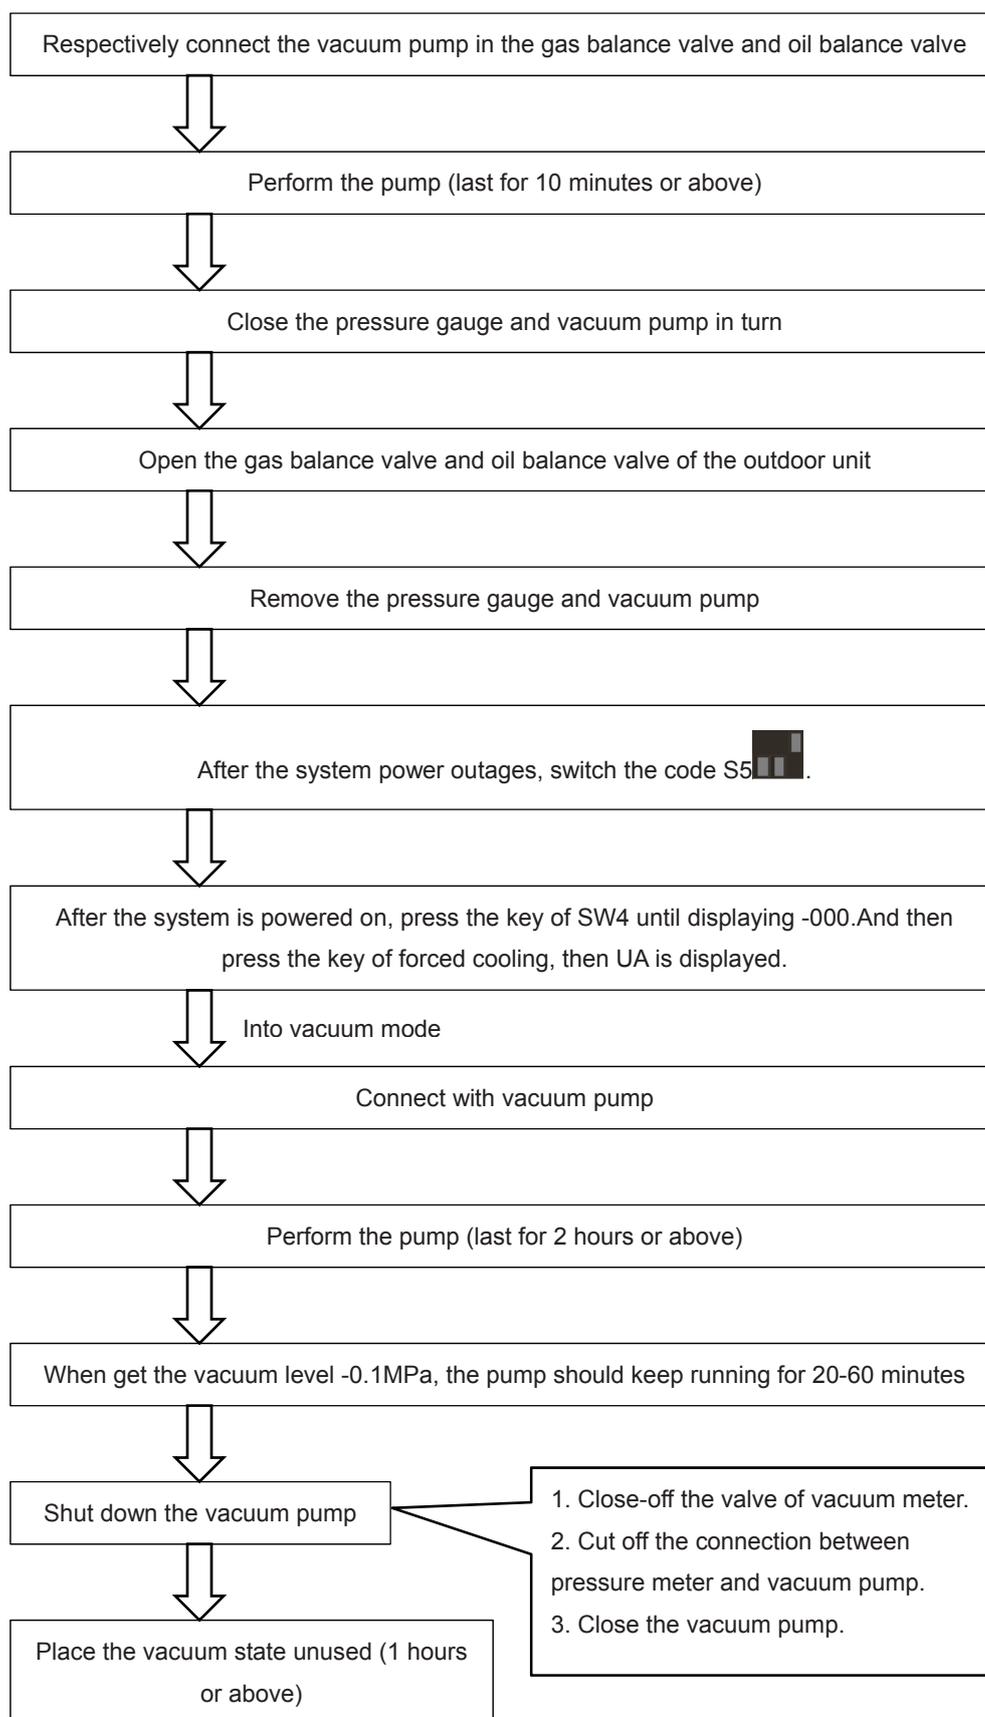**Caution:**

- Don't mix up the different refrigerants or abuse the tools and measurements which directly contact with refrigerants.
- Don't adopt refrigerant gas for air vacuuming.
- If vacuum level could not get to -0.1MPa, please check whether resulted by leakage and confirm the leakage site. If no leakage, please operate the vacuum pump again 1 or 2 hrs.

## 11. Additional refrigerant charge

- Calculate the additional refrigerant charge according to the diameter and the length of the liquid side pipe of the outdoor/indoor unit connection. The refrigerant is R410A.

Note: Assume equivalent pipe length of the branch joint is 0.5m, and MS is 1m (for calculation purposes).


The refrigerant charge of MS02 is 0.3kg/per, MS04/MS06 is 0.5kg/per.

Pipe size of liquid side ( mm)	Additional refrigerant charge per meter (kg)
Φ6.35	0.023
Φ9.53	0.060
Φ12.7	0.120
Φ15.9	0.180
Φ19.1	0.270
Φ22.2	0.380
Φ25.4	0.550
Φ28.6	(0.710

- Charge the additional refrigerant from the low-pressure pipe and liquid pipe.
- Switch the code S5 
- The system will quit from vacuum mode and go to normal running after power on.

## 12. Electric wiring installation

### 12.1 Wiring terminals instruction

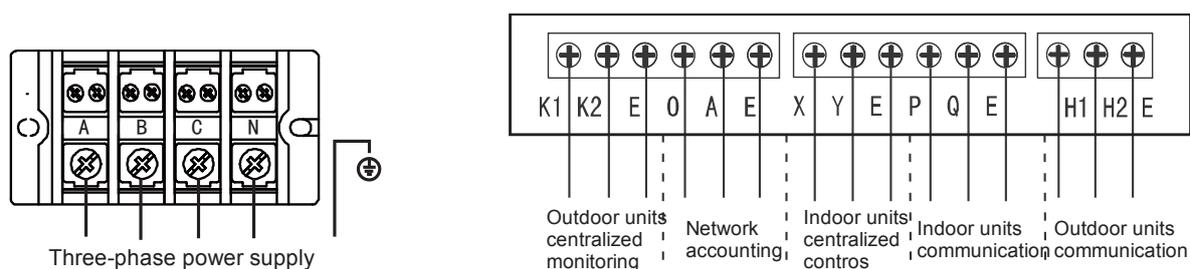

### 12.2 Electric characteristics

Model	Units				Power supply			Compressor		OFM	
	Hz	Voltage (V)	Min. (V)	Max. (V)	MCA (A)	TOCA (A)	MFA (A)	MSC (A)	RLA (A)	kW	FLA (A)
MVUR252B-VA3	50/ 60	380~415	342	440	18.4	20.8	25	-	17.4	0.42	3.6
MVUR280B-VA3	50/ 60	380~415	342	440	20.6	22.1	25	-	17.4	0.42	3.6
MVUR335B-VA3	50/ 60	380~415	342	440	21.8	22.8	25	-	17.4	0.42	3.6
MVUR400B-VA3	50/ 60	380~415	342	440	27.9	31.8	35	-	17.4+ 10.5	0.71	5.9
MVUR450B-VA3	50/ 60	380~415	342	440	33.4	32.8	35	-	17.4+ 10.5	0.71	5.9

The current value of combination unit is the total value of each basic model (refer to Units Combination Table in Part1)

For example: 46HP=16HP+16HP+14HP

Power current: MCA=33.4+33.4+27.9=94.7A

TOCA=32.8+32.8+31.8=97.4A

MFA=35+35+35=105A

Compressor: RLA=(17.4+10.5)+ (17.4+10.5)+ (17.4+10.5)=83.7A

OFM: FLA=5.9+5.9+5.9=17.7A

#### Notes:

1. RLA is based on the following conditions, Indoor temp. 27°C DB/19°C WB, Outdoor temp. 35°C DB
2. TOCA means the total value of each OC set.
3. MSC means the Max. current during the starting of compressor.
4. Voltage range.

Units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed range limits.

5. Maximum allowable voltage variation between phases is 2%
6. Selection wire size based on the larger value of MCA or TOCA
7. MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth circuit breaker).

**MCA:** Min. Circuit Amps. (A)

**TOCA:** Total Over-current Amps. (A)

**MFA:** Max. Fuse Amps. (A)

**MSC:** Max. Starting Amps. (A)

**RLA:** Rated Load Amps. (A)

**OFM:** Outdoor Fan Motor.

**FLA:** Full Load Amps. (A)


**KW:** Rated Motor Output (KW)


## 12.3 Electric wiring installation

### Note:


- Please select power supply for indoor unit and outdoor unit separately.
- The power supply should have specified branch circuit with leakage protector and manual switch.
- The power supply, leakage protector and manual of all the indoor units connecting to the same outdoor unit should be universal. (Please set all the indoor unit power supply of one system into the same circuit. It should turn on or shut down the unit at the same time, otherwise, the service life would affect seriously, even the unit may not turn on.)
- Please put the connective wiring system between indoor unit and outdoor unit with refrigerant piping system together.
- It is suggested to use 3-core shielded wire as signal wire between indoor and outdoor units, multi-core wire is unavailable.
- Please comply with relevant National Electric Standard.
- Power wiring should be done by professional electrician.

### 12.3.1 Outdoor unit powering supply wiring

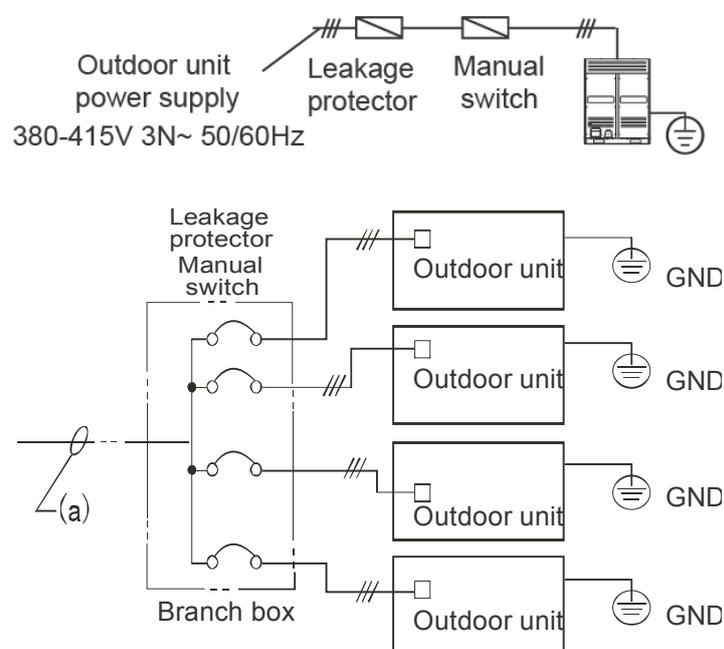

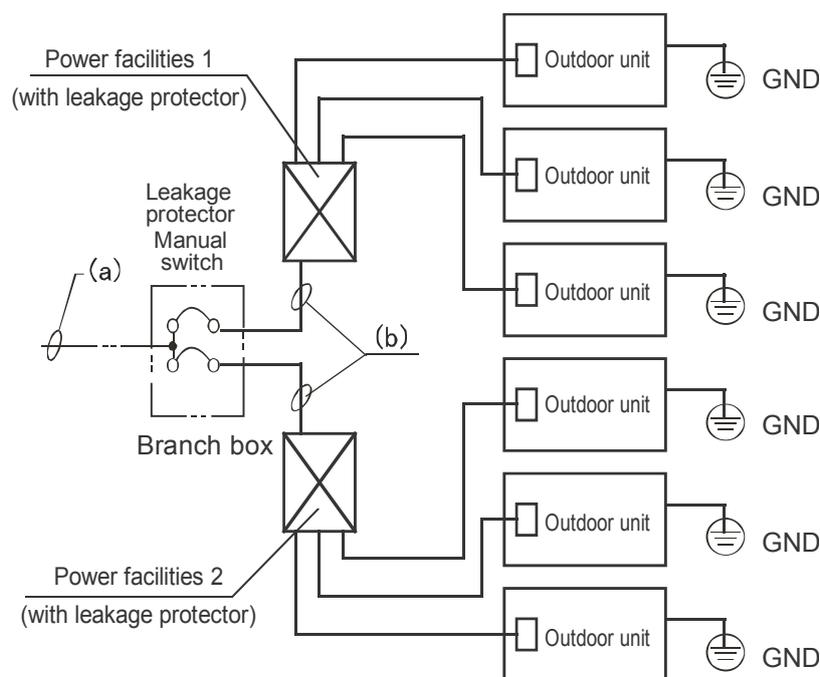

### 12.3.2 Indoor unit powering supply wiring

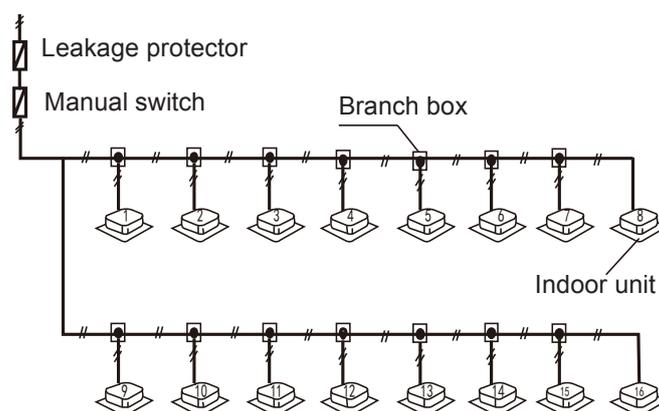

Note:

- Set refrigerant piping system, signal wires between indoor units and signal wires between outdoor units into one system.
- Power must unified supply to all indoor units in the one system.
- Please do not put the signal wires and power wires in the same wire tube; keep distance between the two tubes. (Keep distance above 300mm, when current capacity of power supply less than 10A, and Keep distance above 500mm, when current capacity of power supply less than 50A).
- Make sure to address the outdoor unit which is in combination type.

### 12.4 Control system installation

The control line should be shielded wire. Using other wiring shall create signal interference, thus leading to error operation.

The shielded nets at the two sides of shielded wires are either grounded to the earth, or connected with each other and jointed to the sheet metal along to the earth.

Control wire could not be bound together with refrigerant pipeline and power wire. When power wire and control wire is distributed in parallel form, keep gap between them above 300mm so as to preventing signal interference.


Control wire could not form closed loop.

Control wire has polarity, so be careful when connecting.


The shield net should be grounded at the wiring terminal of outdoor unit. The inlet and outlet wire net of indoor communication wire should be connected directly and could not be grounded, and form open circuit at the shield net of final indoor unit.

### 12.4.1 Signal wire between outdoor unit and indoor unit

Signal wire of indoor/outdoor unit adopts 3-core shielded wire ( $\geq 0.75\text{mm}^2$ ) which has polarity, please connect it correctly.

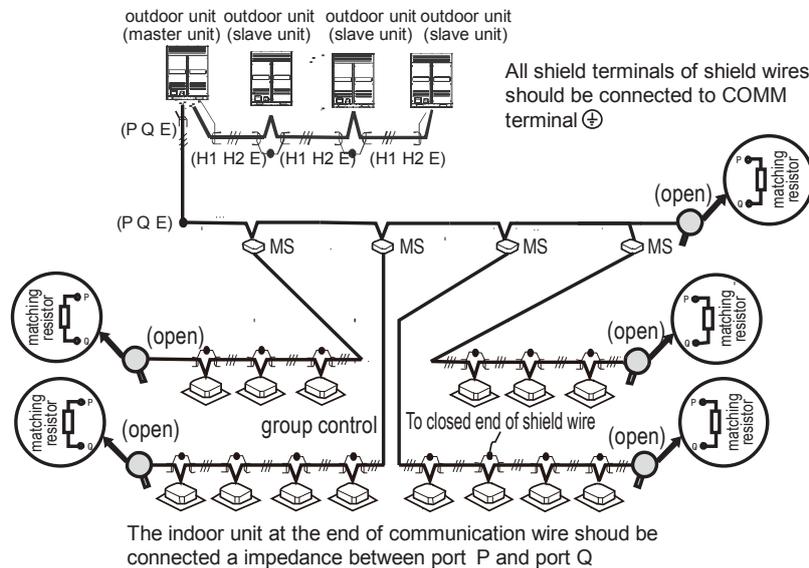


### 12.4.2 Example connection of wiring

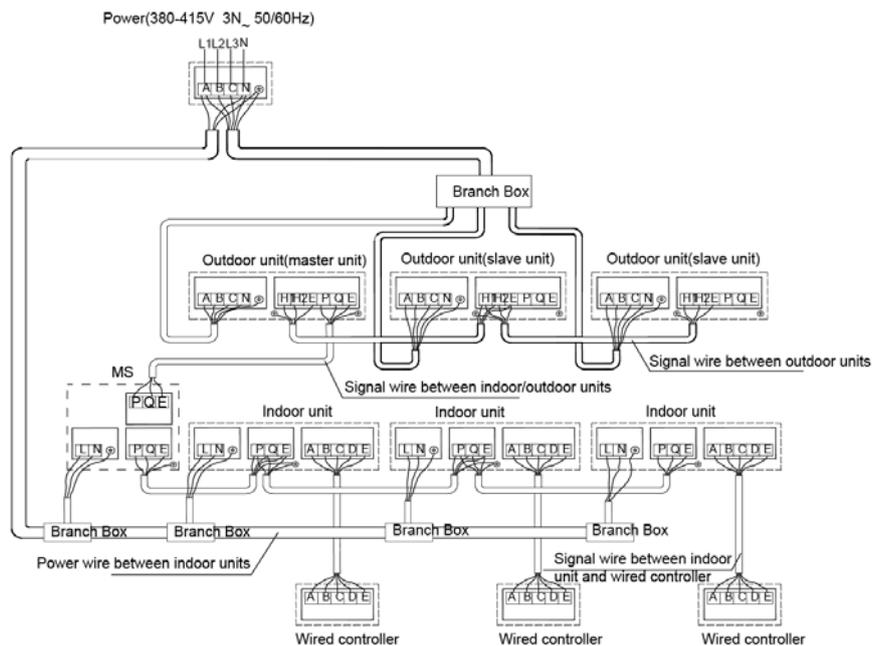

### 12.4.3 Signal wire of centralized control

When centralized control is needed, one CCM03 (central controller of indoor unit) can only control the indoor units which are in the same refrigerant system **via the port X Y E of outdoor unit.**

The diagram below shows the connection of signal wire in this case:

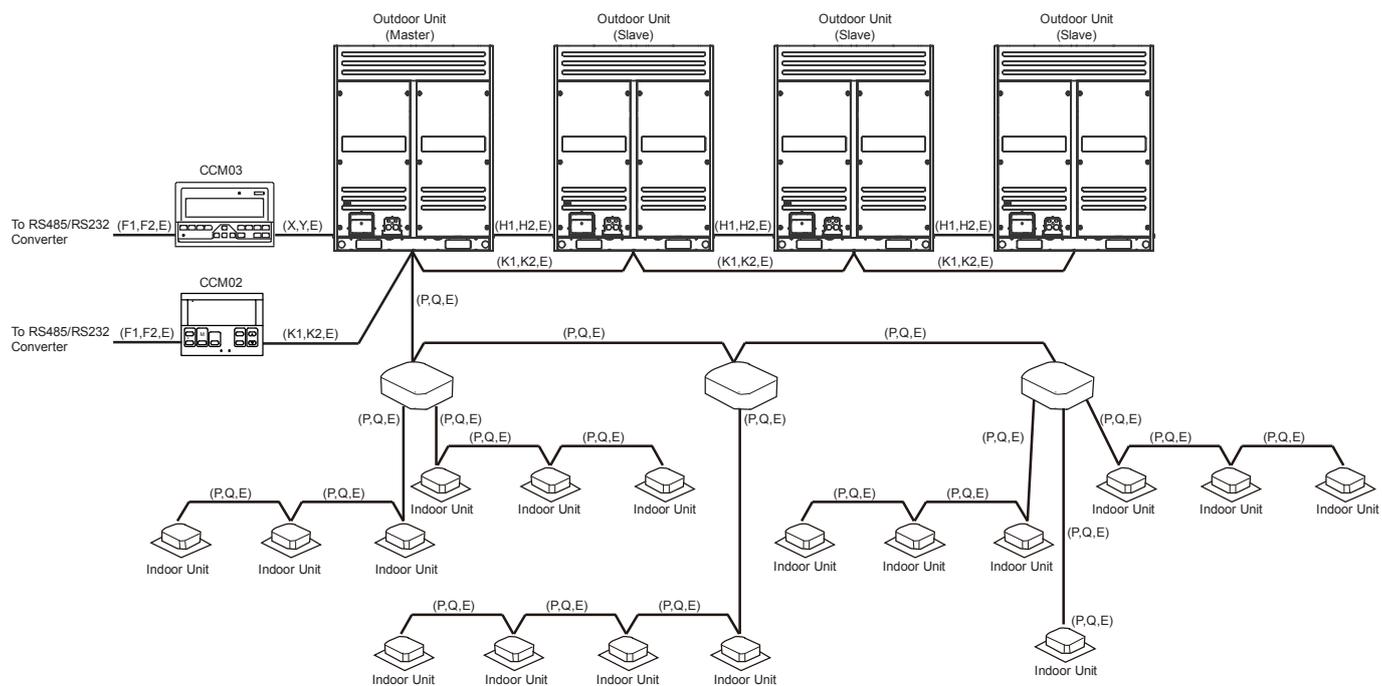

**12.5 Dial switch setting****S1: Starting time setting**

	Starting time is 10 minutes
	Starting time is 12 minutes (default)

**S2: Night silent time setting**

	Night silent time is 6h/10h (default)
	Night silent time is 6h/12h
	Night silent time is 8h/10h
	Night silent time is 8h/12h

**S3: Silent mode selection**

	Night silent mode (default)
	Silent mode
	Super silent mode.
	None silent mode.

**S4: Static pressure mode selection**

	None static pressure(default)
	Low static pressure mode (reserved, can be customized)
	Medium static pressure mode (reserved, can be customized)
	High static pressure mode (reserved, can be customized)

**ENC3+S12: Indoor unit quantity setting**

		The quantity of indoor unit is 0-15
		The quantity of indoor unit is 16-31
		The quantity of indoor unit is 32-47
		The quantity of indoor unit is 48-63

**ENC1: Outdoor unit address setting**

	Only 0, 1, 2, 3 are available. 0 is for main unit; 1, 2, 3 are for slave units
---	---

**ENC2: Outdoor unit capacity setting**

 ENC2	Only 0, 1, 2, 3, 4 are available. 0: 8HP; 1: 10HP; 2: 12HP; 3: 14HP; 4: 16HP
<b>ENC4: Network address setting</b>	
 ENC4	Only 0, 1, 2, 3, 4, 5, 6, 7 are available.

## 13. Running test

### 13.1 Inspection and confirmation before commissioning


- Check and confirm that refrigeration pipe line and communication wire of indoor and outdoor units have been connected to the same refrigeration system. Otherwise, operation troubles shall happen.
- Power voltage is within  $\pm 10\%$  rated voltage.
- Check and confirm that the power wire and control wire are correctly connected.
- Check whether wire controller is properly connected.
- Before powering on, confirm there is no short circuit to each line.
- Check whether all units have passed nitrogen pressure-keeping test for 24 hours with R410A:  $40\text{kg}/\text{cm}^2$ .
- Confirm whether the system to debugging has been carried out vacuum drying and packed with refrigeration as required.

### 13.2 Preparation before debugging

- Calculate the additional refrigerant quantity for each set of unit according to the actual length of liquid pipe.
- Keep required refrigerant ready.
- Keep system scheme, system piping diagram and control wiring diagram ready.
- Record the setting address code on the system scheme.
- Turn on power switches of outdoor unit in advance, and keep connected for above 12 hours so that heater heating up refrigerant oil in compressor.
- Turn on all valves. If the above valves do not be turned on totally, the unit should be damaged.
- Check whether the power phase sequence of outdoor unit is correct.
- All dial switch of indoor and outdoor units have been set according to the Technical Requirement of Product.


### 13.3 Fill the name of connected system

To clearly identify the connected systems among two or more indoor units and outdoor units, select names for every system and record them on the nameplate on the outdoor electric control box cover.

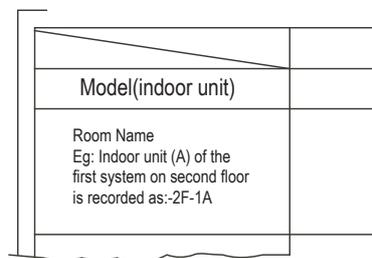

### 13.4 Caution on refrigerant leakage

- This air conditioner adopts R410A as refrigerant, which is safe and noncombustible.
- The room for air conditioner should be big enough that refrigerant leakage cannot reach the critical thickness. Besides this, you can take some action on time.
- R410A critical thickness:  $0.3\text{ kg}/\text{m}^3$ , (Critical thickness: the max thickness of Freon without any harm to person)

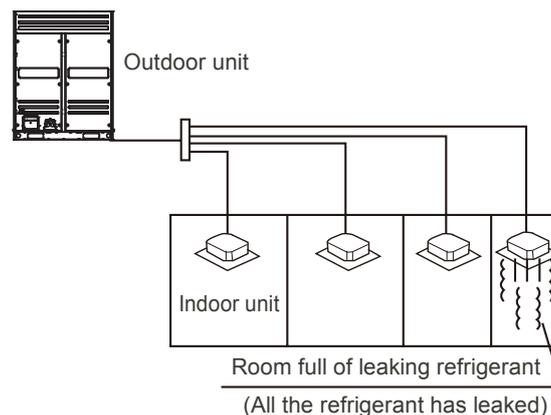

- Calculate the critical thickness through following steps, and take necessary actions.

1. Calculate the refrigerant charge A

2. Total refrigerant charge = delivered refrigerant charge (nameplate) + supplemental refrigerant charge

3. Calculate the indoor volume (B) (as the minimum volume)


4. Calculate the refrigerant thickness.

$$A/B \leq \text{critical thickness } 0.3\text{kg/m}^3$$

- Countermeasure to over-high refrigerant thickness

1. Install mechanical ventilator to reduce the refrigerant thickness under critical level. (Ventilate regularly)

2. Install leakage detector alarming device related to mechanical ventilator if you cannot regularly ventilate.

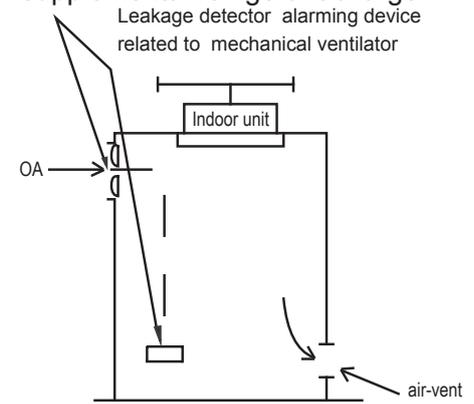

# Part 5 MS Unit Installation

1. Select installation position .....	133
2. Installation space.....	133
3. Body installation.....	134
4. Drain pipe installation .....	135
5. Refrigerant piping installation.....	136
6. Electric wiring installation .....	140
7. Running test.....	145
8. Trial running .....	146



## 1. Select installation position

1. A place can provide enough installation and maintenance space.
2. Horizontal ceiling and its building construction is able to withstand the set's weight.
3. A place where the connecting pipes and drain pipes can be connected easily.
4. The installation location should consider the length of the refrigerant pipe connected with the outdoor and indoor units; it cannot exceed the limited length range.

Note:

- ◆ Do not install the MS near the strong electromagnetic interference environment, otherwise will cause the MS communication error.
- ◆ For the MS may produce refrigerant noise, please do not install it at the silent places, such as sleeping room, hospital sickroom, dedicated silent room etc., recommend installing it at the corridor or washing room etc.
- ◆ Be sure to install drain piping in order to ensure proper drainage.
- ◆ Improper drain piping may result in water leakage and bedewing furniture etc.
- ◆ Be sure to install an earth leakage breaker. Failure to install an earth leakage breaker may result in electric shocks.
- ◆ Do not install the MS at any place where flammable gas may leak out.
- ◆ If the gas leaks out and stays around the MS, a fire may break out.
- ◆ Be sure to install at a strong and firm foundation or ceiling base. If the foundation or ceiling base is not strong and firm enough, the set will drop to cause injury.
- ◆ Connect the electric cable correctly. If wrong connecting the electric cable, then it will damage the electrical components.
- ◆ Expose the unit to the water or other moisture before installation will lead to the short circuit of the electrical components.
- ◆ Don't store the unit in the humid basement or expose to the rain or water. If refrigerant leaks happen during installation, then ventilate the room immediately.
- ◆ After finishing the installation work, be sure to check whether the refrigerant leak or not. If refrigerant leak and is exposed to the fire source such as heater, fire pot or electric cooker etc., then will produce toxic gas.

## 2. Installation space

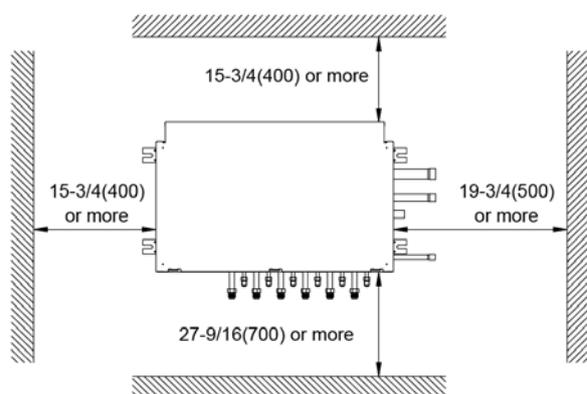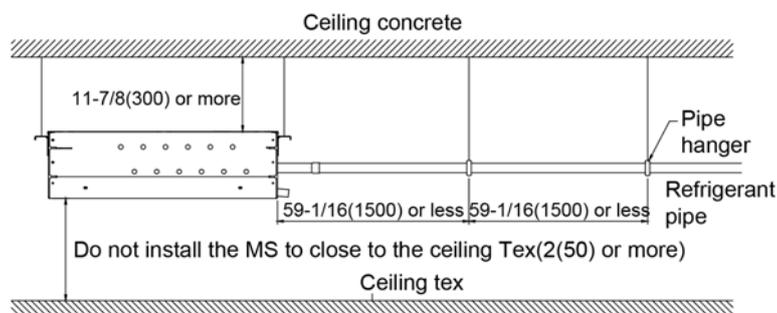

### 3. Body installation


#### 3.1 Install the $\Phi 10$ mm hoisting screw

1. Please use  $\Phi 10$ mm hoisting screw.
2. Remove the ceiling: For different architectural structure, details please contact with indoor decoration personnel.
  - ◆ Ceiling: For make sure the ceiling level and for avoiding to the ceiling vibration, it must be strengthened the ceilingplate base frame.
  - ◆ Do not cut off the ceiling plate base frame.
  - ◆ Strengthen the base frame on the both sides of the fixed ceiling.
  - ◆ After hoisting install the main body, it should do the piping and wiring work in the ceiling, decide the outlet directions of the pipes after selected the installation location. Especially for the position already has ceiling, please install pipe, drainage pipe, indoor and outdoor units connecting wires and wire controlling wire to the connecting positions before hoisting the unit.

#### 3.2 Install the MS


1. Please use the pulley to hoisting install the MS unit on the hoisting bolt.
2. Please use the gradienter to adjust the MS to be horizontal, if not, it may cause water leakage.

#### 3.3 Install the hanging screw bolts

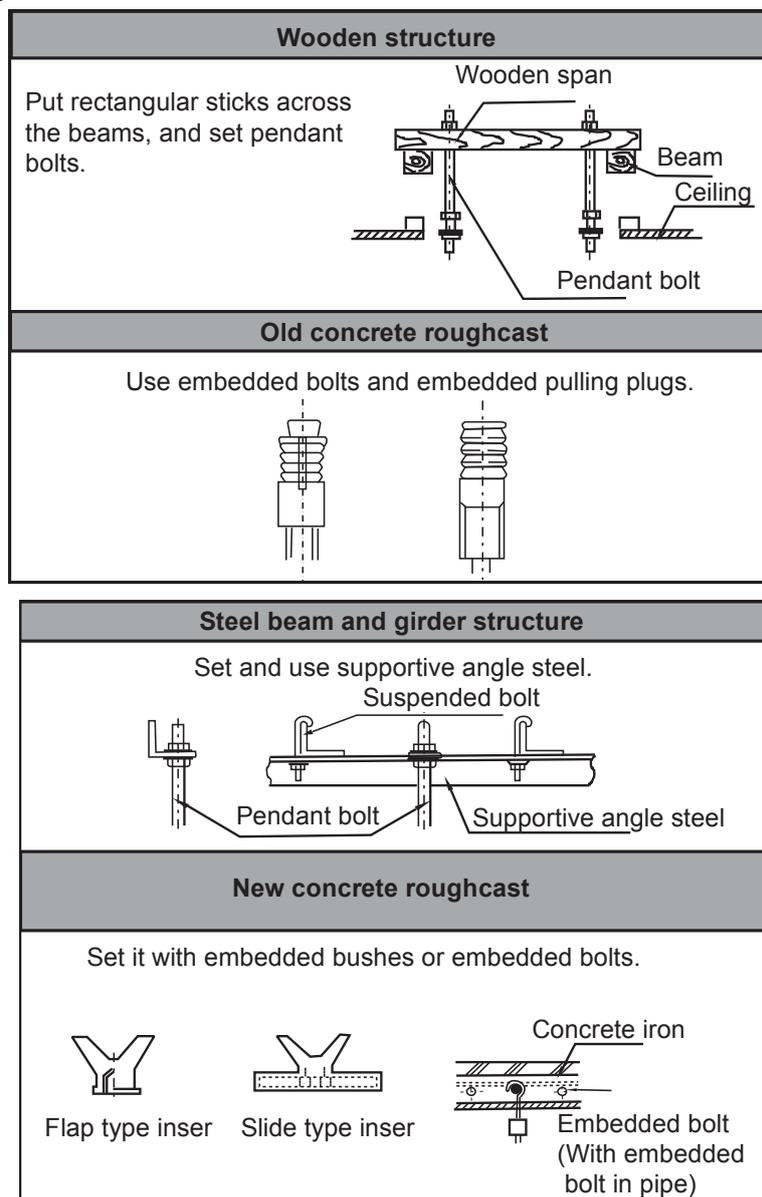


### 3.4 Hanging the MS

1. Adjust the nut's site, the interval between gasket (Down Side) and the ceiling should according to actual construction.

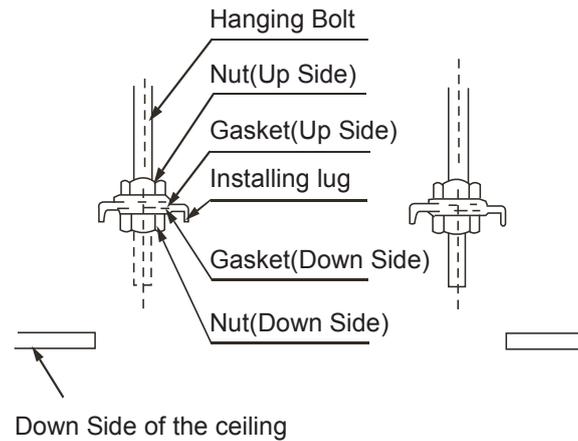


2. Hang the nut of hanging screw bolt into the slotted hole of the installing ear.
3. Use the level gauge to confirm the horizontality of the unit. (Prohibit falling toward non-drainage side, better to fall a little toward the drainage side)

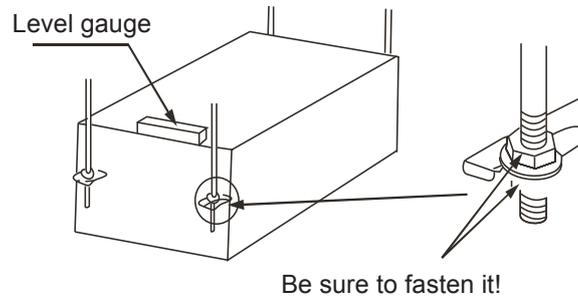


## 4. Drain pipe installation

### 4.1 Install the drain pipe


1. Please use the flexible drainage pipe to connect the MS drainage port and the PVC pipes, and use the snap ring for fastening.
2. While connecting other drain pipes please use hard PVC binder and check whether leak or not.
3. The waterspout joints and drain pipes (especially the indoor parts) of the main unit have to wrap up evenly by insulated casing pipes, and tighten up with lacing belt, in order to prevent air admission and cause condensation.

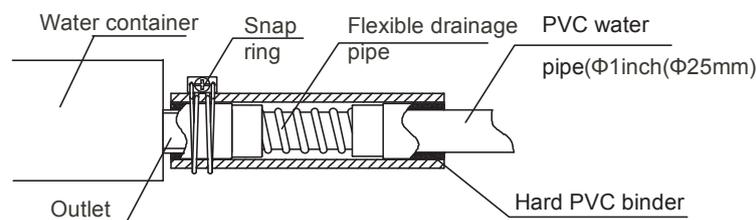

4. For avoiding to the condensate water reflow to the air-conditioner inner, the drain pipes should incline toward the outdoor side (drainage side), the gradient should be over 1/100, and do not turn up defect as prominence and water absorb etc.
5. While connecting the drain pipes, do not pull so hard for avoiding the main unit effect by force. The transverse pull-out of the drain pipes should be within 20m, meanwhile, set a supporting point every 0.8~1.0m, for avoiding the flexure of drain pipes; use hard polyethylene (PE)PE pipes to connect the drain pipes and the connecting pipes, and use the connecting pipes to fasten the drain pipes.

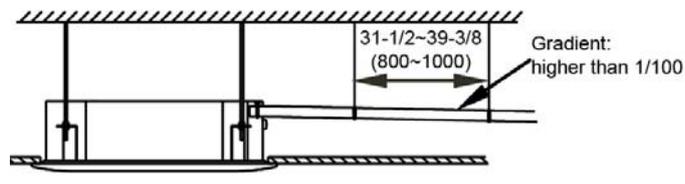

6. Central install the drain pipes please follow below diagram to match pipes.

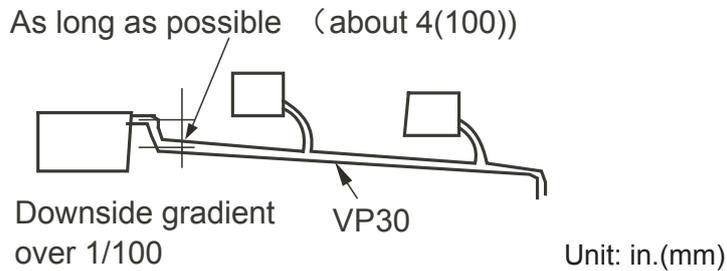

7. The end of the drain pipe should leave the ground or the bottom of the drain tank more than 50mm, and should not put into the water. While directly pour the condensate water into foul sewer, must make the sparge pipe bend up to a U-shape water seal, in order to avoid the fetor come into the indoor through the drain pipe.

Note: For avoiding water leakage, every joint of the drainage system must be sealed up.


#### 4.2 Drain test

1. It should keep the drainage piping smooth, and check every joint whether sealed up or not before doing drain test.
2. For newly built room, do the drain test before paving the ceiling.
  - ◆ Use a water main to fill the water tank with 500~1000ml water.
  - ◆ Check whether drained water normally and whether has leakage on the connectors.

Refrigerant piping installation

## 5. Refrigerant piping installation


### 5.1 Connection piping instruction

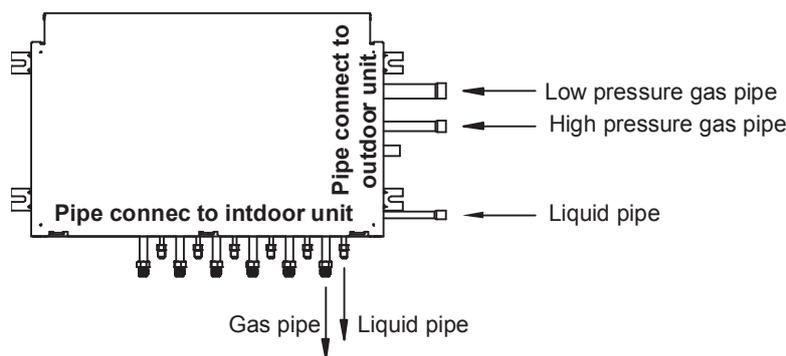

### 5.2 Connecting diagram of MS and indoor unit

#### Connecting diagram 1


“MS02/N1-C”, “MS04/N1-C”, “MS06/N1-C” which can be connected multiple indoor units.

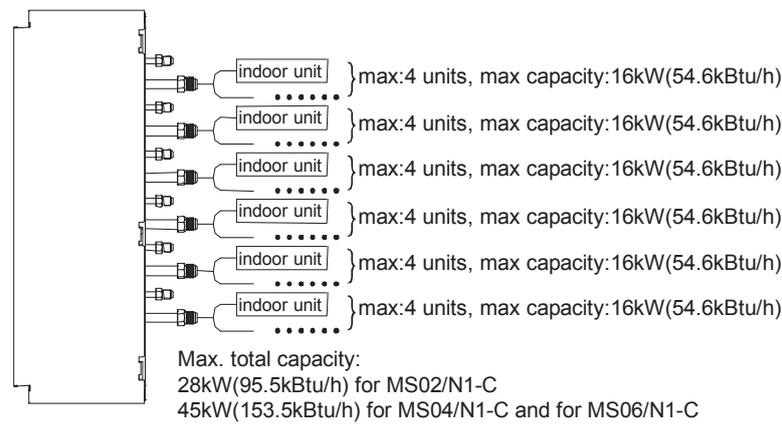**Note:**

- The maximum number of each group indoor units should be less than 4, and the maximum capacity of each group indoor units should be less than 16kW.
- If the indoor units do not have auto mode function, then each group of MS can be connected with four indoor units at most for one time; otherwise, it can be connected with only one indoor unit at most.
- Indoor units in the same group of MS cannot be operated in cooling or heating mode at the same time, or operated in heating and air supplying mode at the same time; otherwise it will be mode conflict.

**Connecting diagram 2**

“MS02E/N1-C” and “MS04E/N1-C” which can be connected only one indoor unit.

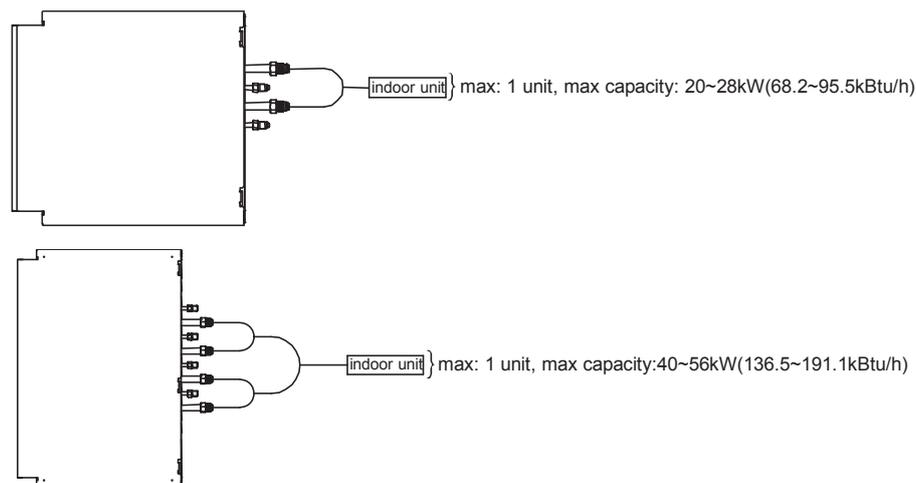**Caution:**

Do not let air, dust, or other impurities fall in the pipe system during the time of installation.


The connecting pipe should not be installed until the indoor and outdoor units have been fixed already.

Keep the connecting pipe dry, and do not let moisture in during installation.

The connecting copper pipes should be wrapped up by insulated materials (more than 10mm thick).

**5.3 The procedure of connecting pipes**

1. Connect the indoor unit first, and then connect the outdoor unit.
  - a) The pipe bend should be handled carefully, without damaging the pipe and insulation layer.
  - b) Before screwing up the flared nut, apply refrigerant oil at the outer surface of the pipeline flare and the taper surface of the connection nut. Screw the nut for 3~4 circles beforehand.

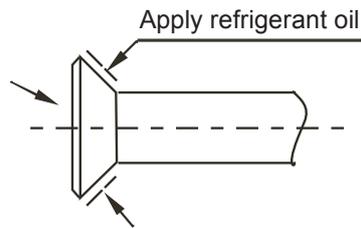


- c) When connecting or disconnecting the pipe, be sure to use two spanners concurrently.
  - d) Do not rest the weight of the connective pipe on the adapter of the indoor unit. Too heavy load on the adapter of the indoor unit may deform the pipe and thus affect the cooling/heating effect.
2. The valve of the outdoor unit should be closed completely (as in the factory status). Every time when connecting the pipe, screw off the nut at the valve, and connect the flared pipe (within 5 minutes). If the nut is put away for a long time after being screwed off the valve, dust and other foreign substance may intrude into the pipeline system and lead to fault.
  3. After the refrigerant pipe is connected to the indoor and outdoor units, expel air as instructed in the “Expel air” section. After expelling the air, screw up the nut at the maintenance orifice.
- a) Precautions for the flexible part of the pipeline
    - ♦ The bend angle shall not exceed 90°.

Use a thumb to bend the pipe



Minimum radius 100mm

- ♦ The bend shall be preferably in the middle of the pipe length, and higher bend radiuses are preferred.
  - ♦ Do not bend the flexible pipe for over 3 times.
- b) Bend the thin-wall connective pipe




→ Method of unleashing the spooled pipe  
Straighten the pipe end

- ♦ When bending the pipe, cut out a notch of the desired size at the bend of the adiabatic pipe, and then expose the pipe (wrap the pipe with the wrapping tape after bending it).
  - ♦ The radio of the elbow pipe should be as large as possible to prevent flattening or crush.
  - ♦ Use the pipe bender to make close elbow pipe.
4. Deploy the pipelines
    - ♦ Drill a porthole on the wall, and put the hole sheath and hole cover through the wall.
    - ♦ Place the connective pipe together with the indoor & outdoor connection wires. Use wrapping tape to tie them tight. Do not let air penetrate into it lest condensation and drips of moist.
    - ♦ Pull the connective wrapped connective pipe from outdoor through the sheath, which gets through the wall, and lead it into the room.
  5. Make a vacuum of connective pipeline.
  6. After the above steps are completed, the spool of the valve of the outdoor unit should be completely open, and the refrigerant pipeline of the indoor unit and the outdoor unit should be smooth.
  7. Use leak detector or soap water detect leak carefully to prevent leakage.
  8. Put on an adiabatic envelope (accessory) at connective pipe adapter of the indoor unit, and wrap it tight with the wrapping tape lest condensate and leakage.

## 5.4 Pipe connection


### 1. Flare

- Use a pipe cutter to cut off the pipe.

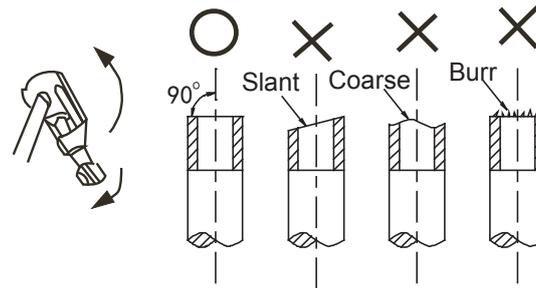


- Pull the pipe into the rear flare of the connective nut.

Outer diameter mm	A mm	
	Max.	Min.
Φ6.35	8.7	8.3
Φ9.53	12.4	12.0
Φ12.7	15.8	15.4
Φ15.9	19.0	18.6
Φ19.1	23.3	22.9

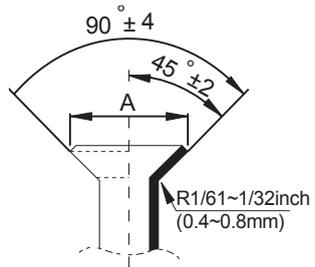

### 2. Tighten the nut

Align with the connective pipe, screw up the connection pipe nut manually, and use a spanner to tighten it.



According to the installation conditions, too large torque will damage the flaring, and too small torque will lead to looseness and leakage. Determine the tightening torque by reference to below table.

Liquid and gas pipes without connecting must be tightened with copper tube sealing piece.


Pipe size mm	Tightening torque N.M
Φ6.35	14.2~17.2
Φ9.53	32.7~39.9
Φ12.7	49.5~60.3
Φ15.9	61.8~75.4
Φ19.1	97.2~118.6

## 5.5 Welding the copper pipe

Use braze-welding for the low pressure gas pipe, high pressure gas pipe, liquid pipe which connected with MS and the outdoor unit.

During welding, use wet cloth to pack the copper pipe which near the MS.

During welding, use nitrogen gas to protect welding.

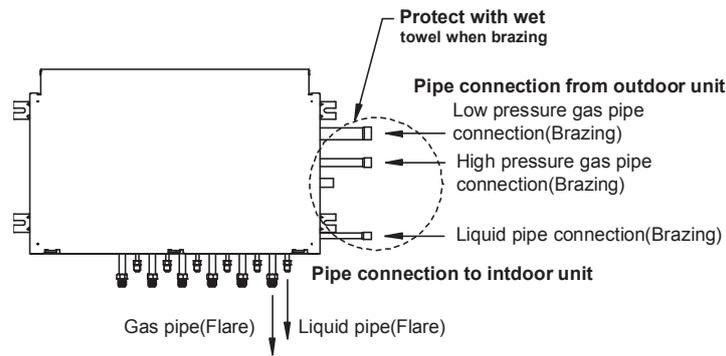

### 5.6 Airtight test

The refrigerant pipe after installation and before connect to the outdoor unit, it must undergo the airtight test with 3.92 MPa nitrogen for 24 hours from the low pressure gas pipe, high pressure gas pipe and liquid pipe.

### 5.7 Air purging

Connect the refrigerant pipe with the low pressure gas pipe, high pressure gas pipe, and liquid pipe of the outdoor unit. Use a vacuum pump, to vacuum from the low pressure gas pipe, high pressure gas pipe, and liquid pipe of the outdoor unit.


### 5.8 Open/close the valves

Open/Close the spools or the valves of outdoor unit with a hexagon spanner.

### 5.9 Thermal insulation

To process the thermal insulation for air side and liquid side piping. Please insulated the air side and liquid side piping completely, in the reason of during operate cooling mode the ambient temperature is very low.

- ◆ Thermal insulation at least 120°C material shall be applied for air side piping.
- ◆ Apply attached thermal insulation material to wrap the connective part of indoor piping tightly without gap.

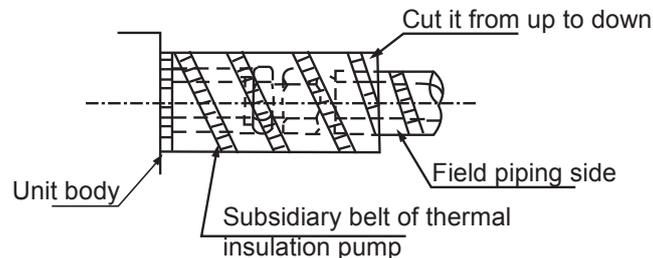

## 6. Electric wiring installation

Note:

- ◆ Special power shall be applied within rated voltage range. External circuit of this air conditioner must be grounded that means power cable of outdoor unit shall be jointed with external grounding wire reliable.
- ◆ Electric wiring must be done by professionals, and wiring according to the wiring label.
- ◆ Fixing circuit must be wired with an a11-poledisconnection device at least 3mm switching distance of contact.
- ◆ Setting the electrical leakage device according to national regulation.
- ◆ Power cables and signal wires shall be arranged orderly and be wired rational without mutual interfere, and connective pipes and body of valves without mutual contact among them.
- ◆ The attached connective wire is 10m, provided that the length were not long enough, you must replace it by an appropriate length connective wire in the same specification. In a normal circumstance, it is not allowed to overlapping the two wires, but welded fix and wrapped by insulation adhesive band is except.
- ◆ All electric wiring is finished, you could input power as long as confirm that all wires connect are correct and fix tightly.

## 6.1 Power supply specifications

The power supply cable specifications are as follows. In case power capacity is too low may result in over-heating of piping that would be burned out the unit.


Model \ Item	Power supply (V/Ph/Hz)	Power switch		Power supply cable		Signal wire
		Capacity (A)	Safety fuse (A)	Power wire	Ground wire	
MS02/N1-C	220-240/1/50~60	5	5	2×14AWG	1×14AWG	3-core shielded wire 20AWG
MS04/N1-C	220-240/1/50~60	5	5	2×14AWG	1×14AWG	3-core shielded wire 20AWG
MS06/N1-C	220-240/1/50~60	5	5	2×14AWG	1×14AWG	3-core shielded wire 20AWG
MS02E/N1-C	220-240/1/50~60	5	5	2×14AWG	1×14AWG	3-core shielded wire 20AWG
MS04E/N1-C	220-240/1/50~60	5	5	2×14AWG	1×14AWG	3-core shielded wire 20AWG

## 6.2 Wiring for the MS power wire and signal wire


1. Please use dedicated power supply different from the outdoor unit for the MS power.
2. The power, electrical leakage protectors and operation switches for each indoor unit connected to the same outdoor unit and the MS should be in common use.
3. The MS power wire should be connected to the terminals with the label “L, N”, and the MS signal wire should be connected to the terminals with the label “P, Q, E” and correspond to the “P, Q, E” wiring terminals for the outdoor and indoor units, which cannot be wrong connected. Please refer to the following figures.

### Wiring diagrams


#### MS02/N1-C

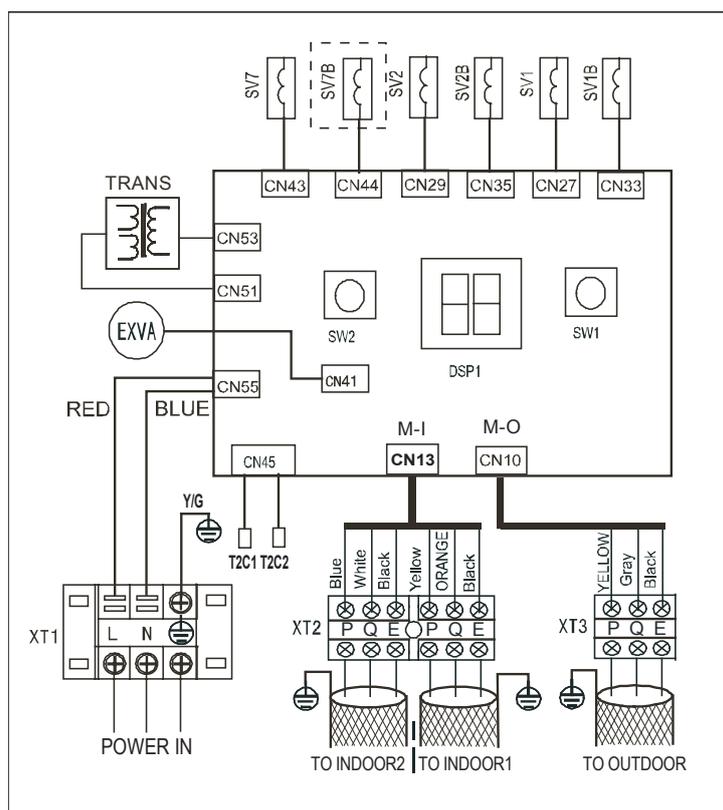


MS02/N1-C, MS02/N1-C

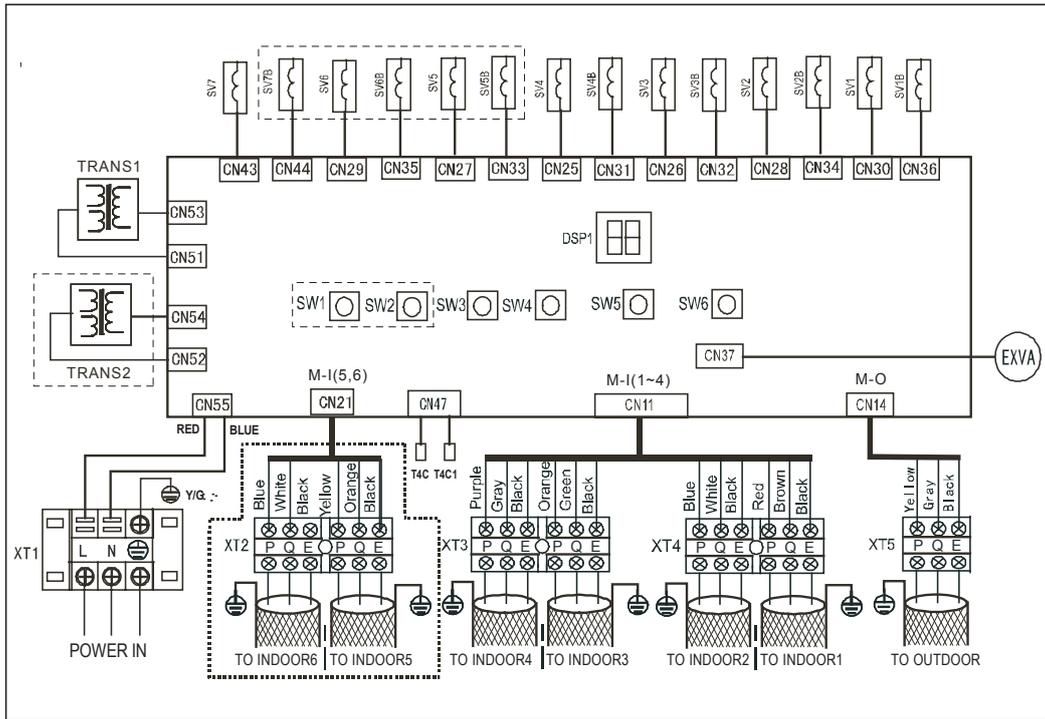

MS02E/N1-C

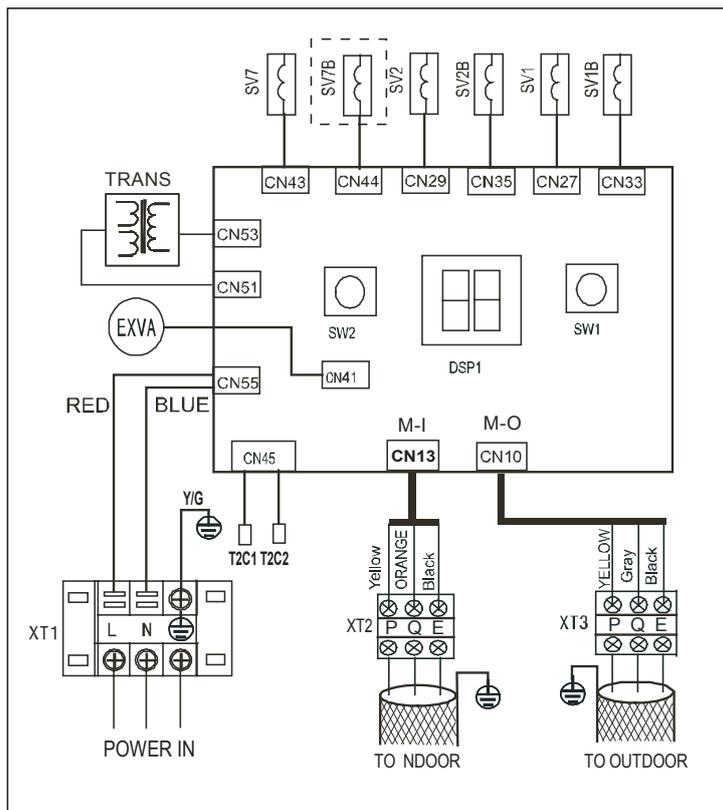


MS04E/N1-C

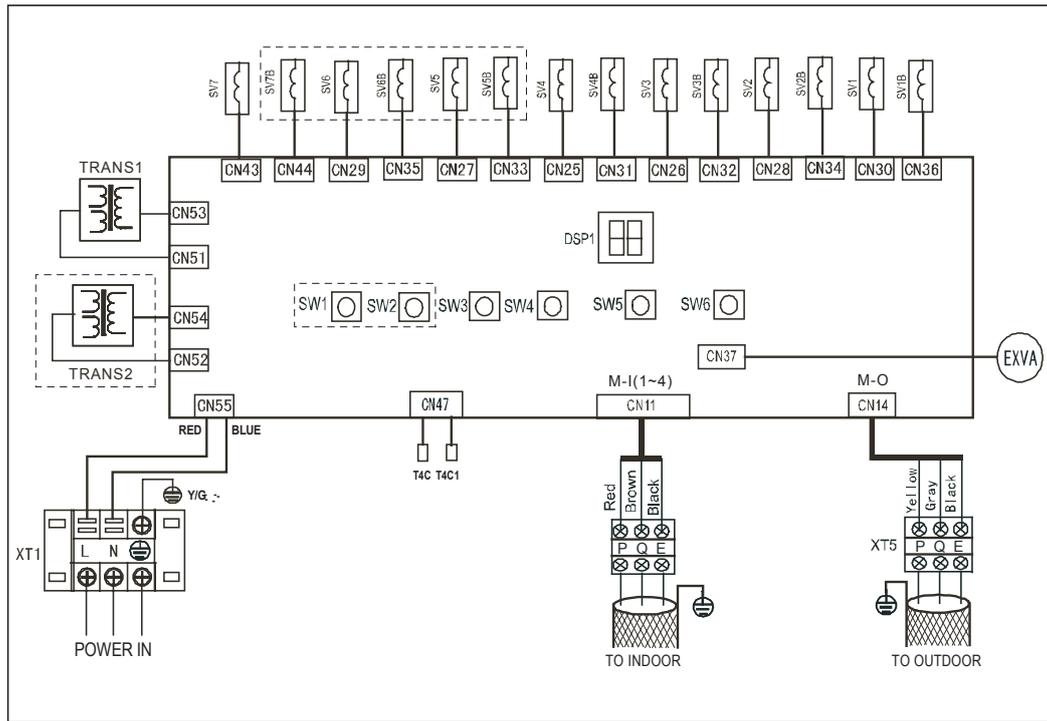


System wiring diagrams

MS02/N1-C, MS04/N1-C, MS06/N1-C

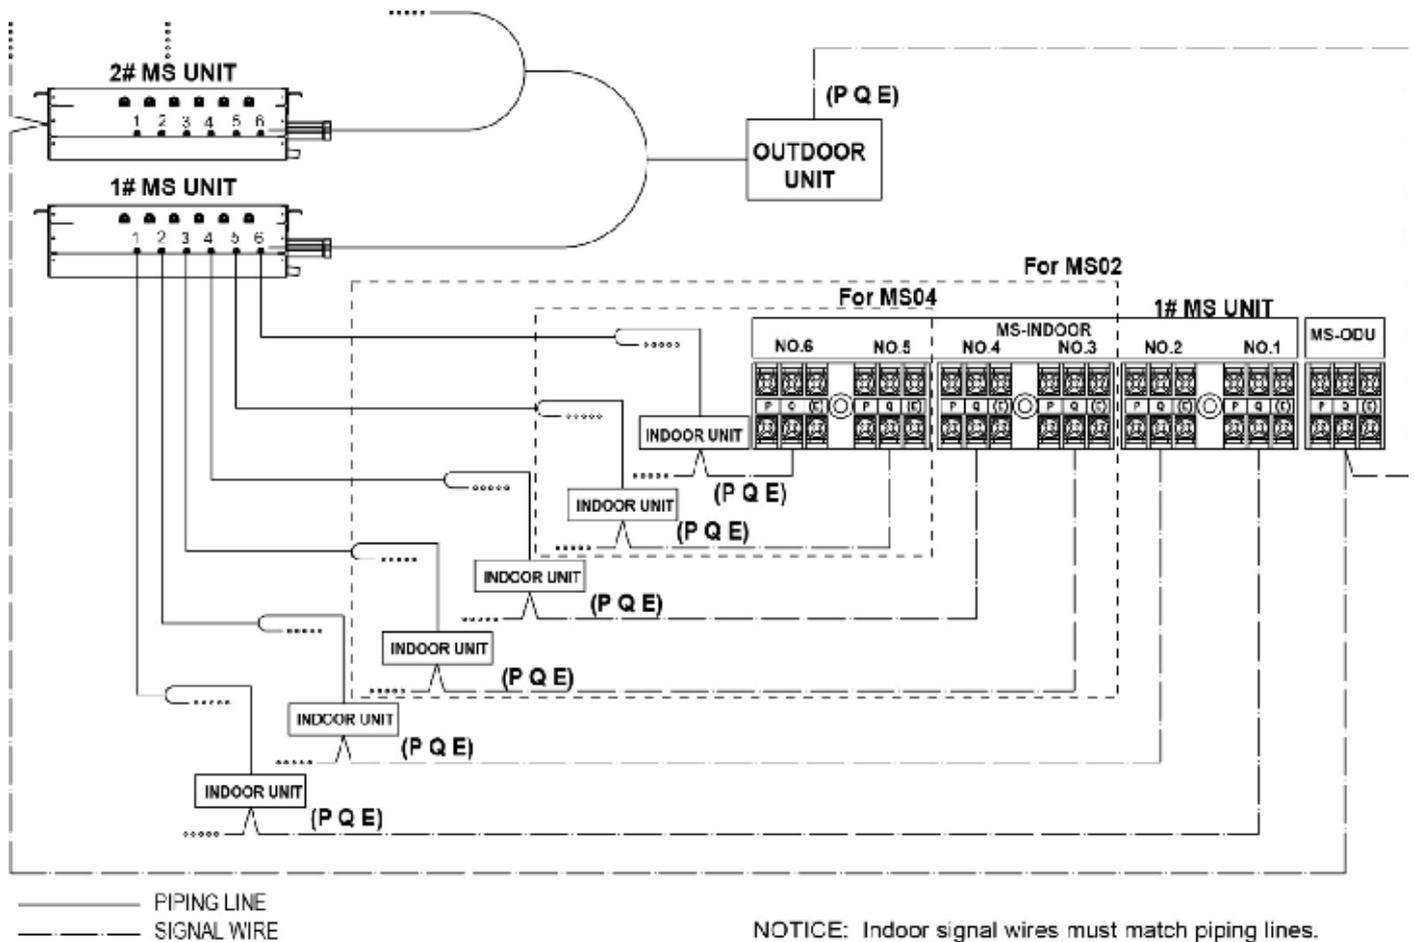

## MS02E/N1-C, MS04E/N1-C

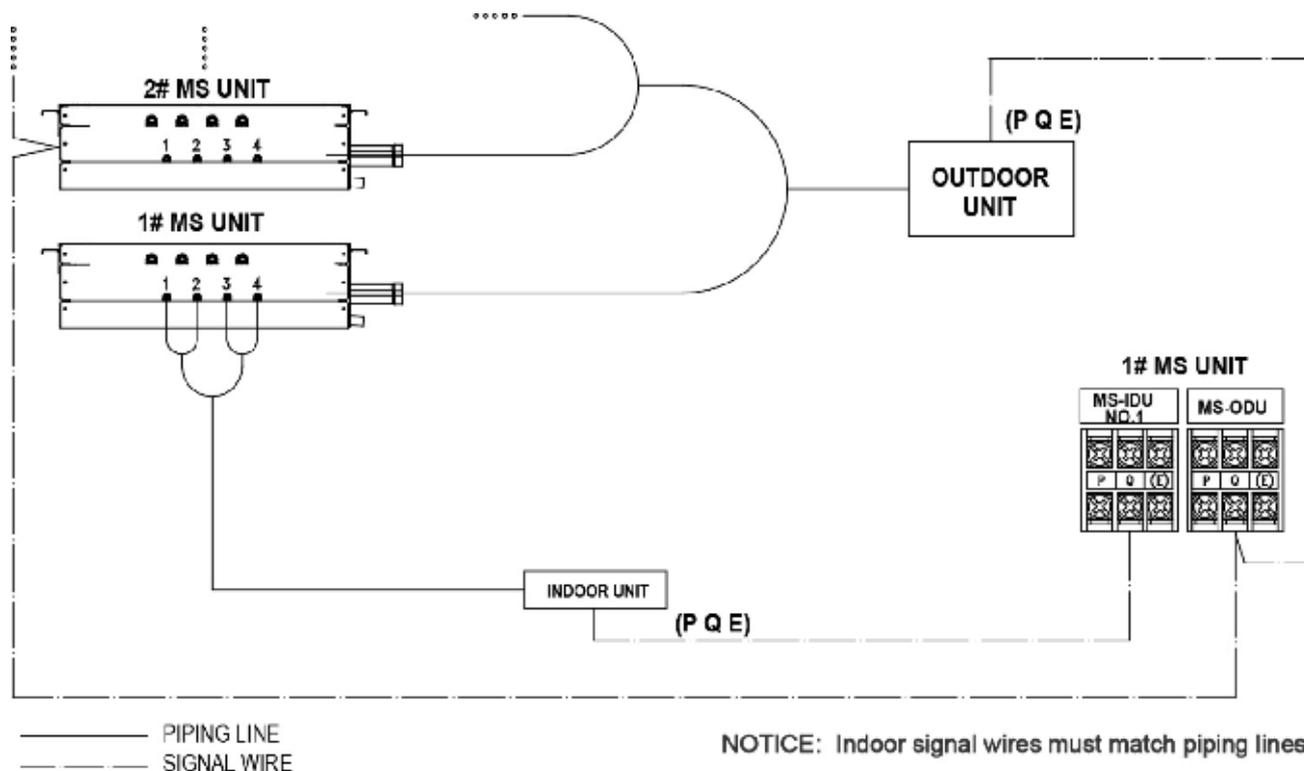

## Note:

1. The signal wire must use shielding wire. User other wires might cause signal interference and lead to malfunction.
2. All the shielding wires network should be interconnected, and finally connected together to the metal plate grounding.
3. Do not tie up the signal wire together with the refrigerant pipes and power wires etc. When parallel layout the power wire and signal wire, the distance should be over 300mm.
4. The signal wire cannot be a close loop.
5. The signal wire has polarity, please be careful during wiring.
6. Please use 3-core shielding wire for MS, indoor unit and outdoor unit signal wires (greater than or equal to 0.75mm<sup>2</sup>). The signal wire has polarity, it needs correct connection. The MS and outdoor signal wires only can be led out from the outdoor main unit.

**6.3 Check whether the MS and indoor unit signal wire is wired correctly or not.**

## Spot check:

1. Only power on the MS and indoor units which belong to No. n system;
2. Long press the MS spot check key which is correspond to No. n system for 6s, then No. n system will enter to spot check mode (MS02, MS04, MS06 has 2, 4, 6 spot check keys separately);
3. After enter spot check mode, the display panel will display "CH", when No. n system of MS detects the indoor unit communication signal, the No. n system will immediately operate the solenoid valve under this system as the following sequence: "SV(n)" ON 10s → "SV(n)-B" ON 10s → repeat the above steps for 3 times → "SV(n)" and "SV(n)-B" OFF;
4. If the valve didn't follow step 3 operation then means the No. n system communication has error, please check the signal wire connection between No. n system and indoor unit, and then repeat the step 1~3 to check the No. n system; if the valve followed step 3 operation then means the No. n system communication is normal, and then can repeat the step 1~3 to check other systems;

## Exit spot check:

1. No indoor unit signal is detected in 10 minutes;
2. MS power off;
3. Finish spot check operation.

## 6.4 Spot check instruction

MS Spot check keys SW1-SW6 are separately corresponded to No.1-6 system

No.	Content
1	The quantity of downstream indoor units of this MS
2	The operation mode of this MS
3	Subcooling inlet temperature (T1C2)
4	Subcooling outlet temperature (T1C1)
5	Total T2(B) average value back from outdoor unit
6	Indoor unit T2(B) value under this MS
7	The quantity of opened outdoor unit
8	The operation mode* of outdoor unit
9	Subcooling PMV opening degree
10	The quantity of opened indoor units of this MS
11	Chip version number
12	--

Operation mode:

0: OFF; 2: Cooling mode; 3: Heating mode; 4: Force cooling mode; 5: Main cooling mode; 6: Main heating mode.

## 6.5 LED lamp instruction

Phenomenon LED lamp	Normally ON	Slow flash	Flash
LED 1	Outdoor unit ON	Outdoor unit standby	Outdoor unit communication error
LED 2	Indoor unit ON of this MS	Indoor unit OFF of this MS	Indoor unit communication error

## 7. Running test

### 7.1 Confirm the following insure before operation

- 1) Whether the MS, indoor unit and outdoor unit are installed correctly;
- 2) Whether the tubing and wiring are correctly completed;
- 3) Whether check the leakage of refrigeration piping system;
- 4) Whether the drainage is unimpeded;
- 5) Whether the heating insulation works well;
- 6) Whether the ground wiring is connected correctly;
- 7) Whether recorded the pipe length and the refrigerant added amount;
- 8) Whether the power voltage fits the rated voltage of the unit;
- 9) Whether there is no obstacle at the air outlet and inlet;
- 10) Open the stop valves of low pressure gas pipe, high pressure gas pipe, and liquid pipe, air balance pipe and oil balance pipe;
- 11) Power on, pre-heat the unit;
- 12) Whether the connected indoor unit quantity is the same with the actual quantity under the spot check MS situation;
- 13) Whether the connected outdoor unit quantity is the same with the actual quantity.

## 8. Trial running

Use the wired controller to control the operation of the unit, check the following items according to the instruction. If there is error, check the error according to the instruction and solve them.

### 8.1 Indoor unit

- 1) Check whether the switch of the wired/remote controller is normal;
- 2) Check whether the functional keys of the wired/remote controller are normal;
- 3) Check whether the indoor temperature adjusts normally;
- 4) Check whether the indication lamp is normal;
- 5) Check whether the manual operation button is normal.
- 6) Check whether water draining normally;
- 7) Check whether has excessively noise and vibration during operation;

### 8.2 MS unit

- 1) Check whether water draining normally;
- 2) Check whether has excessively noise and vibration during operation and mode shifting;

### 8.3 Outdoor unit

- 1) Check whether has excessively noise and vibration during operation;
- 2) Check whether the wind, noise and condensed water affect neighbors;
- 3) Check whether refrigerant leakage.


# Part 6 Troubleshooting

1. Outdoor electric control box assembly instructions .....	148
2. Outdoor main control board instructions .....	150
3. Error code table .....	157
4. Troubleshooting.....	159


# 1. Outdoor electric control box assembly instructions

8/10/12HP

Bottom layer of electric control box

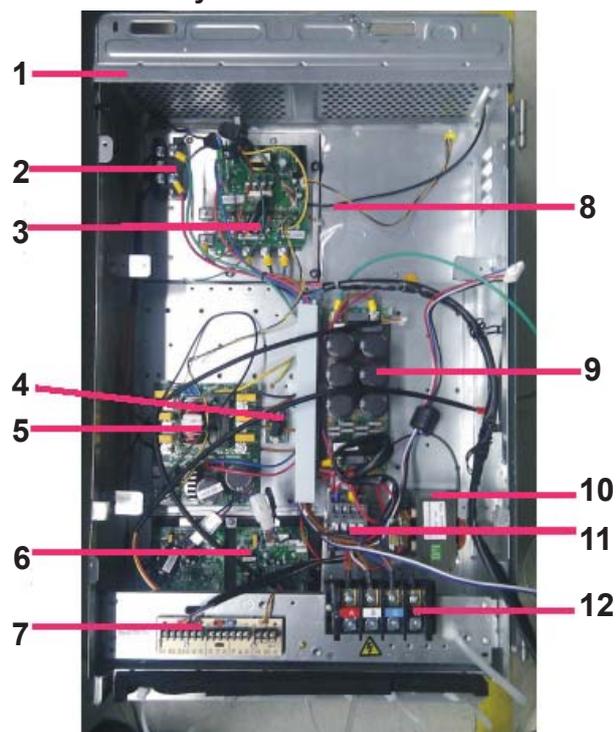


Top layer of electric control box

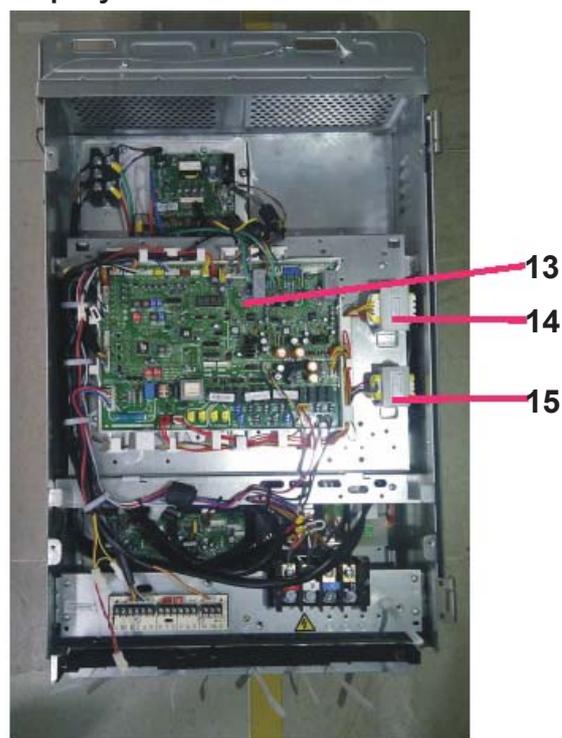


No.	Content
1	Electric control box assembly
2	Three phase bridge
3	Inverter module
4	Outdoor current detection board
5	Outdoor power supply board
6	DC fan module
7	Intermediate adapter board
8	Temperature sensor
9	Filter board
10	Reactor
11	Contactor
12	Terminal block, 4P
13	Main PCB
14	Power transformer
15	Power transformer

## 14/16HP

Bottom layer of electric control box

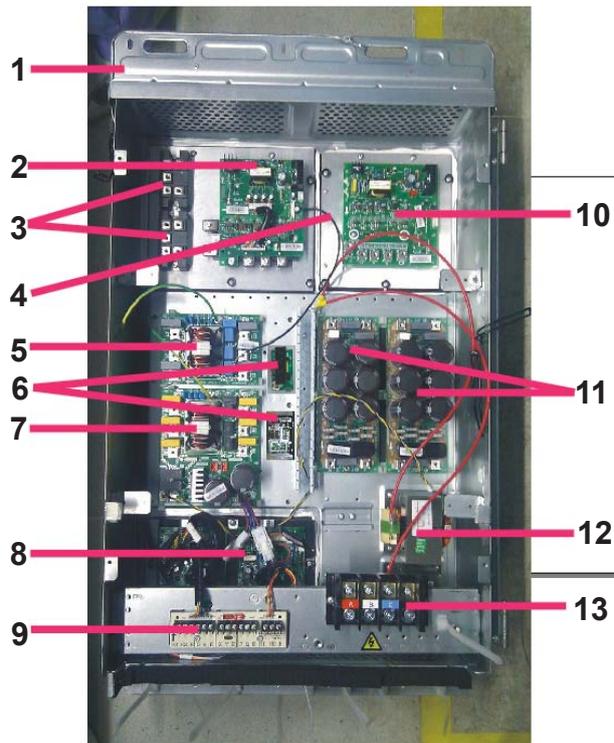


Top layer of electric control box

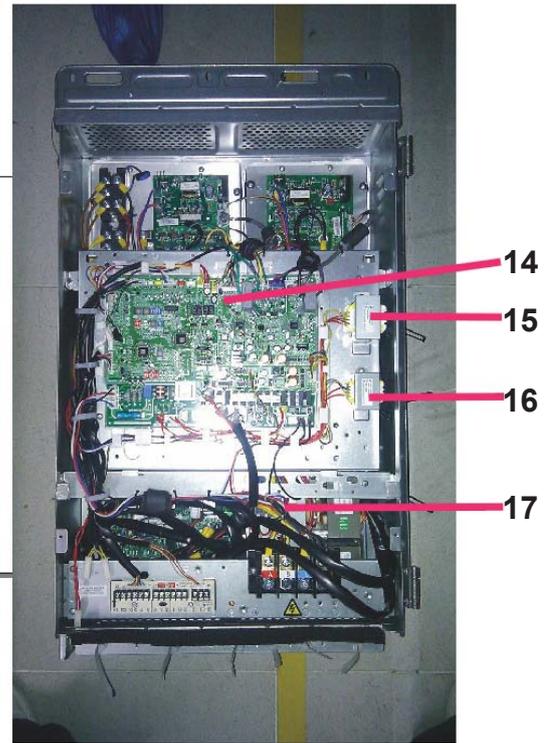

No.	Content
1	Electric control box assembly
2	Inverter module
3	Three phase bridge
4	Temperature sensor
5	Outdoor power supply board
6	Outdoor current detection board
7	Outdoor power supply board
8	DC fan module
9	Intermediate adapter board
10	Inverter module
11	Filter board
12	Reactor
13	Terminal block, 4P
14	Main PCB
15	Power transformer
16	Power transformer
17	Contactor

## 2. Outdoor main control board instructions


### 2.1 Main PCB ports instructions

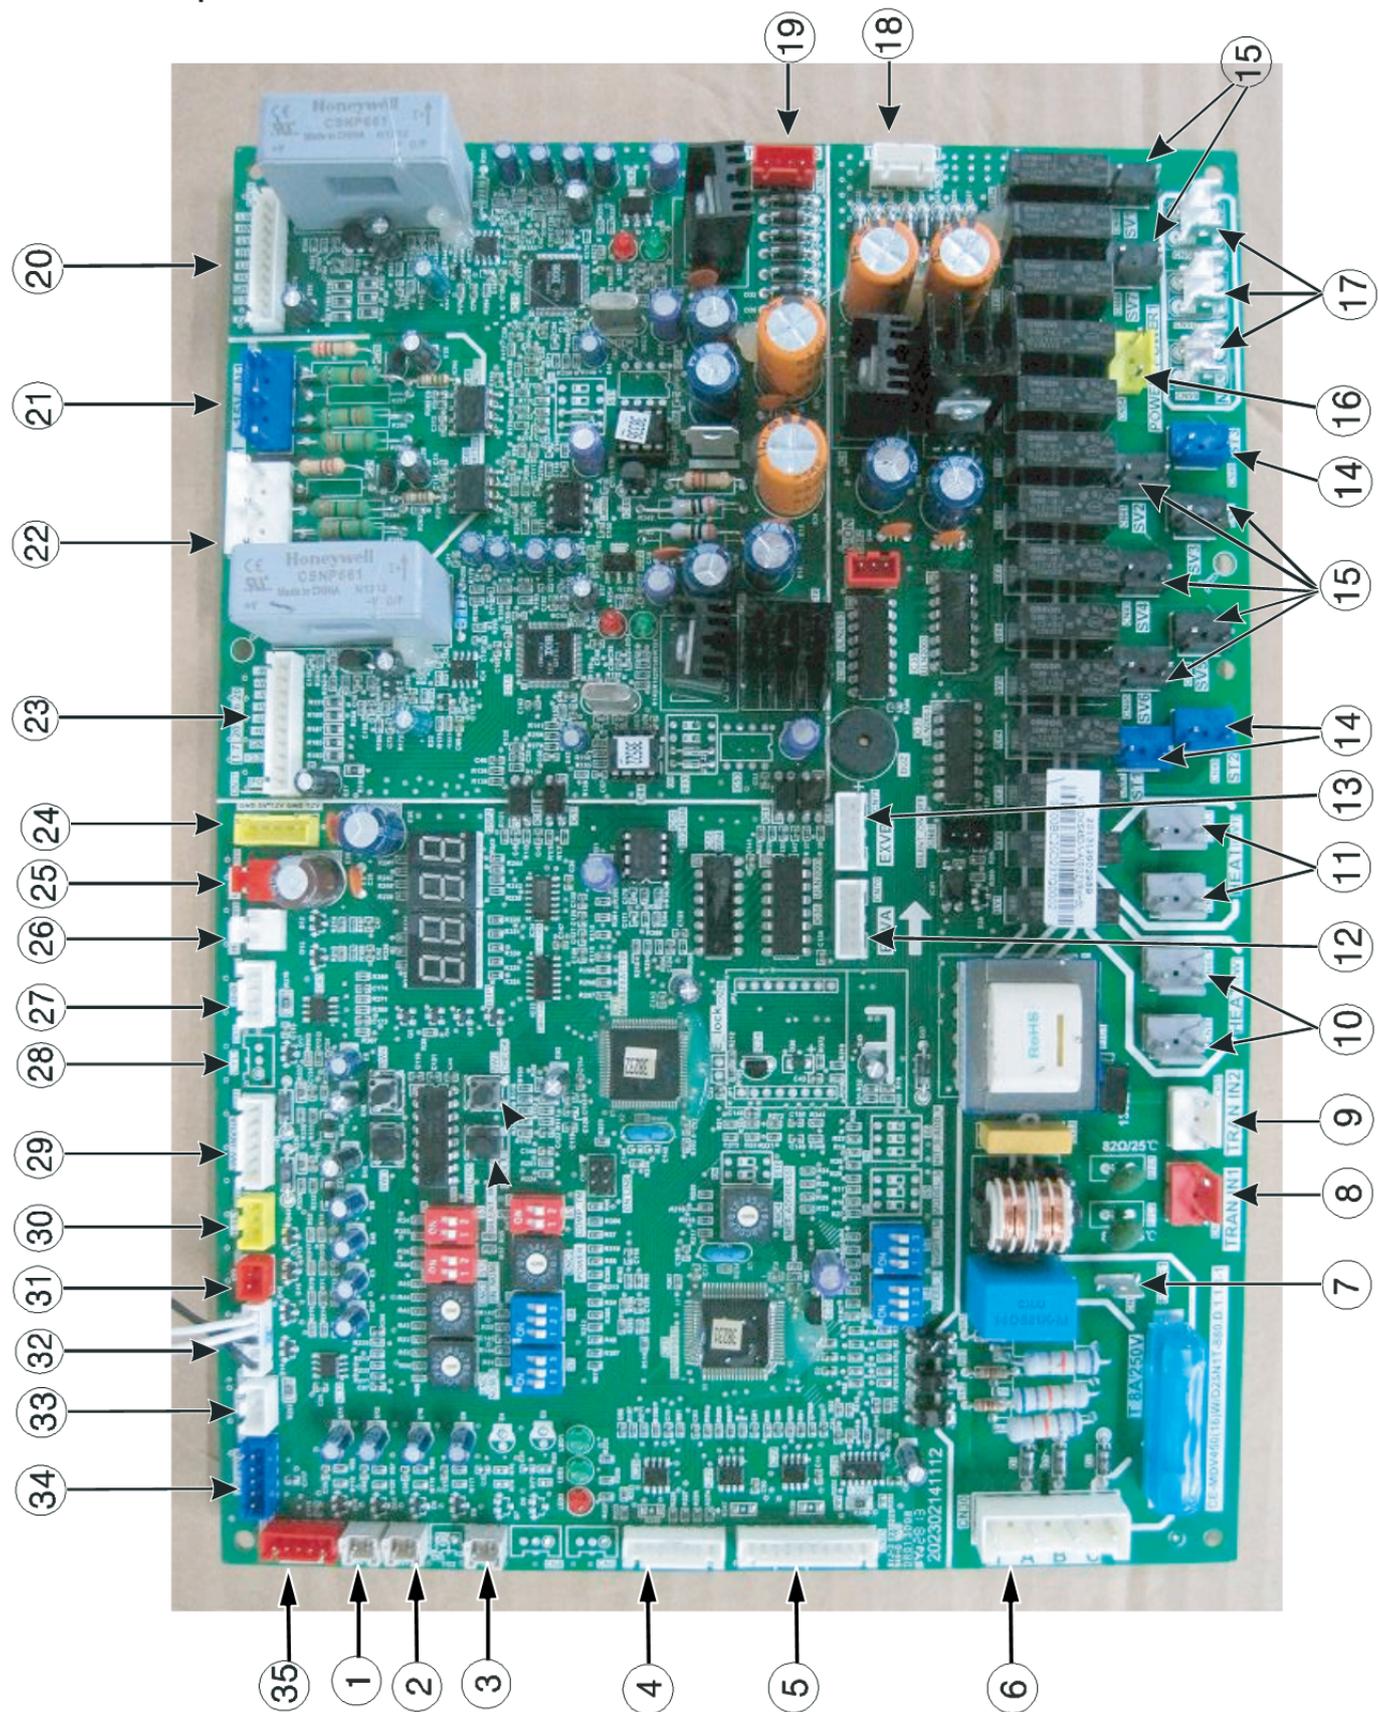

**Outdoor main PCB ports instructions**

No.	Port code	Content	Port voltage
1	CN10	Discharge temperature detection port of inverter compressor A	DC 0~5V (in dynamic change)
2	CN11	Discharge temperature detection port of inverter compressor B	DC 0~5V (in dynamic change)
3	CN4	Inverter module temperature detection port	DC 0~5V (in dynamic change)
4	CN26	Reserved	/
5	CN25	Wiring port for communication between indoor and outdoor units, indoor unit network, outdoor unit network and network accounting	DC 2.5~2.7V
6	CN30	Three-phase detection port	380V
7	CN80	Reserved	/
8	CN31	Power input of No.1 transformer	220V
9	CN33	Power input of No.2 transformer	220V
10	CN66	Heat output of inverter compressor A electrical heater	220V
11	CN67	Heat output of inverter compressor B electrical heater	220V
12	CN70	Driver port of EXV A	The first pin on left: DC 12V
13	CN71	Driver port of EXV B	The other four pins: in dynamic change
14	CN47-CN49	Four-way valve output port	220V
15	CN41-CN45	One-way valve output port	220V
16	CN54	Power output port	220V
17	CN57-CN59	Null line terminal	0
18	CN32	Power output of No.1 transformer	The voltage between upper tow pins: AC 13.5V; The voltage between under tow pins: AC 9V
19	CN34	Power output of No.2 transformer	The voltage between upper tow pins: AC 14.5V; The voltage between under tow pins: AC 14.5V
20	CN39	Activation port of inverter module B	The third pin on the left: DC3.3V
21	CN38	Voltage detection port of inverter module B	DC 540V, +15V, N
22	CN36	Voltage detection port of inverter module A	DC 540V, +15V, N
23	CN37	Activation port of inverter module A	The third pin on the left: DC3.3V
24	CN35	Power supply port of main PCB	GND, +5V, +12V, GND, 12V
25	CN19	ON/OFF signal input port for system low pressure detection	0 or 5V
26	CN18	ON/OFF signal input port for system high pressure detection	0 or 5V
27	CN28	Reserved	/
28	CN16	Reserved	/
29	CN15	Current detection port of inverter compressor A and B	AC 0~7.8V (in dynamic change)
30	CN17	Input port for system high pressure detection	DC 0~5V (in dynamic change)
31	CN2	Right condenser temperature detection port	DC 0~5V (in dynamic change)
32	CN1	Outdoor ambient temperature and left condenser temperature detection port	DC 0~5V (in dynamic change)
33	CN20	Outdoor units communication port	DC 2.5~2.7V
34	CN65	Control port of DC fan B	The first pin on left: DC 12V
35	CN64	Control port of DC fan A	The other four pins: in dynamic change

## 2.2 Main PCB parts instructions

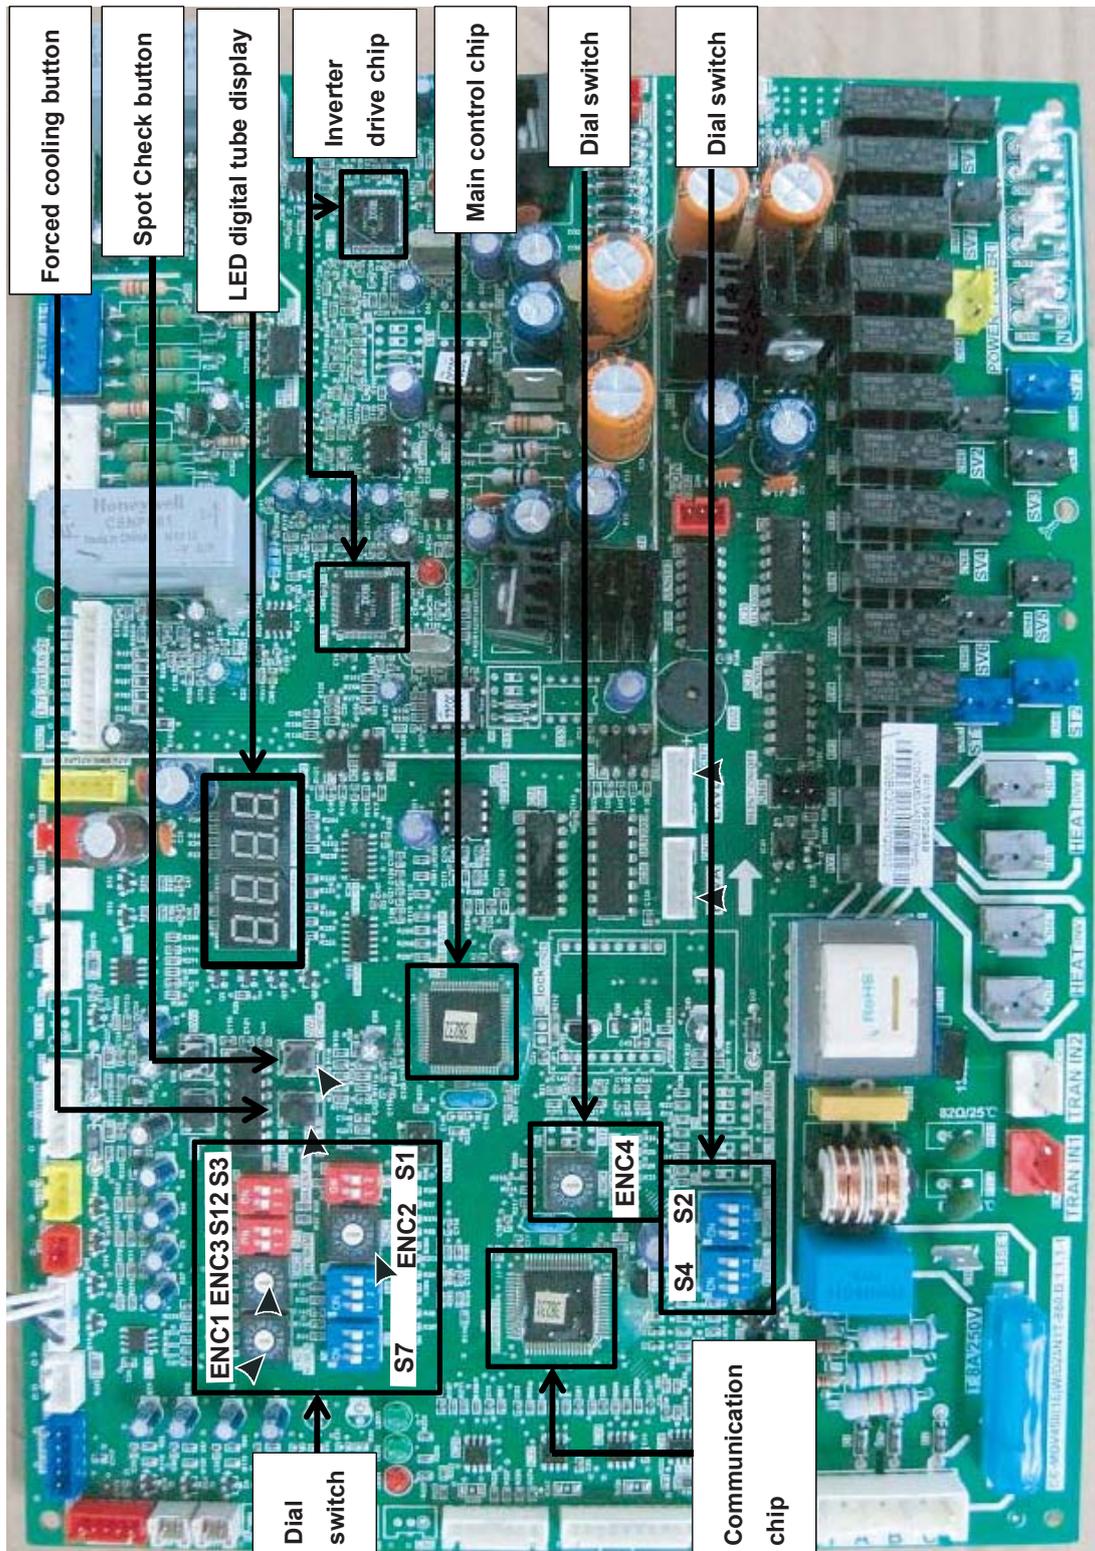

**2.2.1 Spot check content instructions**

No.	Normal display	Content (present frequency)	Note
1	0 --	Outdoor unit address	0, 1, 2, 3
2	1 --	Outdoor unit capacity setting	Refer to note 1
3	2 --	Outdoor unit quantity	Available for main outdoor unit
4	3 --	Running mode	Refer to note 2
5	4 --	Total capacity of outdoor units	Capacity requirement
6	5 --	Cooling capacity	Slave unit only display capacity of main mode
7	6 --	Heating capacity	Slave unit only display capacity of main mode
8	7 --	Ambient temperature revision of cooling capacity	Capacity requirements
9	8 --	Ambient temperature revision of heating capacity	Capacity requirements
10	9 --	Actual running capacity of this outdoor unit	Capacity requirement
11	10 --	Fan A speed	Refer to note 3
12	11 --	Fan B speed	Refer to note 3
13	12 --	T2 average temperature	Actual value=display value
14	13 --	T2B average temperature	Actual value=display value
15	14 --	T3 left pipe temperature	Actual value=display value
16	15 --	T5 right pipe temperature	Actual value=display value
17	16 --	T4 ambient temperature	Actual value=display value
18	17 --	Discharge temperature of inverter compressor A	Actual value=display value
19	18 --	Discharge temperature of inverter compressor B	Actual value=display value
20	19 --	Inverter module temperature	Actual value=display value
21	20 --	Discharge pressure corresponding to the saturation temperature	Actual value=display value-30
22	21 --	The minimum overheating temperature of discharge	Actual value=display value
23	22 --	Current of inverter compressor A	Actual value=display value
24	23 --	Current of inverter compressor B	Actual value=display value
25	24 --	State of the outdoor heat exchanger	Refer to note 4
26	25 --	EXVA opening degree	Pulsed value=display value×8
27	26 --	EXVB opening degree	Pulsed value=display value×8
28	27 --	Discharge pressure value	Actual value=display value×0.1MPa
29	28 --	Indoor units quantity	Actual value=display value
30	29 --	Cooling indoor units quantity	Cooling indoor units quantity
31	30 --	Heating indoor units quantity	Cooling indoor units quantity
32	31 --	Reserved	/
33	32 --	Silent mode	Refer to note 5
34	33 --	Static pressure mode	Refer to note 6
35	34 --	DC voltage A	Actual value=display value×10
36	35 --	DC voltage B	Actual value=display value×10
37	36 --	Reserved	/
38	37 --	Reserved	/
39	38 --	The last error or protection code	Display 000 if it has no error or protection
40	39 --	--	Over

Note:

When the outdoor unit is in standby, the first two numbers on LED digital tube will display the address of the outdoor unit, and the last two numbers display the indoor unit's quantity which can communicate with outdoor unit. When the outdoor unit is operating, it will display the rotation frequency of the compressor.

1. Outdoor unit capacity setting: 0: 8HP; 1: 10HP; 2: 12HP; 3: 14HP; 4: 16HP
2. Running mode: 0—closed; 2—cooling mode; 3—heating mode; 4—forced cooling mode.
3. Fan speed: 0—closed; 1~15—fan speed increase in sequence.
4. State of the outdoor heat exchanger: 0-close/condenser; 1-All evaporator; 2-Left evaporator/right condenser; 3-Left evaporator/close.
5. Silent mode: 0—nighttime silent mode; 1—silent mode; 2—super silent mode; 3—no silent mode.
6. Static pressure mode: 0—no static pressure; 1—low static pressure; 2—medium static pressure; 3—high static pressure.


### 2.2.2 Dial switch setting

<b>S1: Starting time setting</b>	
	Starting time is 10 minutes
	Starting time is 12 minutes (default)
<b>S2: Night silent time setting</b>	
	Night silent time is 6h/10h (default)
	Night silent time is 6h/12h
	Night silent time is 8h/10h
	Night silent time is 8h/12h
<b>S3: Silent mode selection</b>	
	Night silent mode (default)
	Silent mode
	Super silent mode.
	None silent mode.
<b>S4: Static pressure mode selection</b>	
	None static pressure(default)
	Low static pressure mode (reserved, can be customized)
	Medium static pressure mode (reserved, can be customized)
	High static pressure mode (reserved, can be customized)

**Dial switch setting**

<b>ENC3+S12: Indoor unit quantity setting</b>		
		The quantity of indoor unit is 0-15
		The quantity of indoor unit is 16-31
		The quantity of indoor unit is 32-47
		The quantity of indoor unit is 48-63
<b>ENC1: Outdoor unit address setting</b>		
	Only 0, 1, 2, 3 are available. 0 is for main unit; 1, 2, 3 are for slave units	
<b>ENC2: Outdoor unit capacity setting</b>		
	Only 0, 1, 2, 3, 4 are available. 0: 8HP; 1: 10HP; 2: 12HP; 3: 14HP; 4: 16HP	
<b>ENC4: Network address setting</b>		
	Only 0, 1, 2, 3, 4, 5, 6, 7 are available.	

## 2.3 LED on main control board instructions

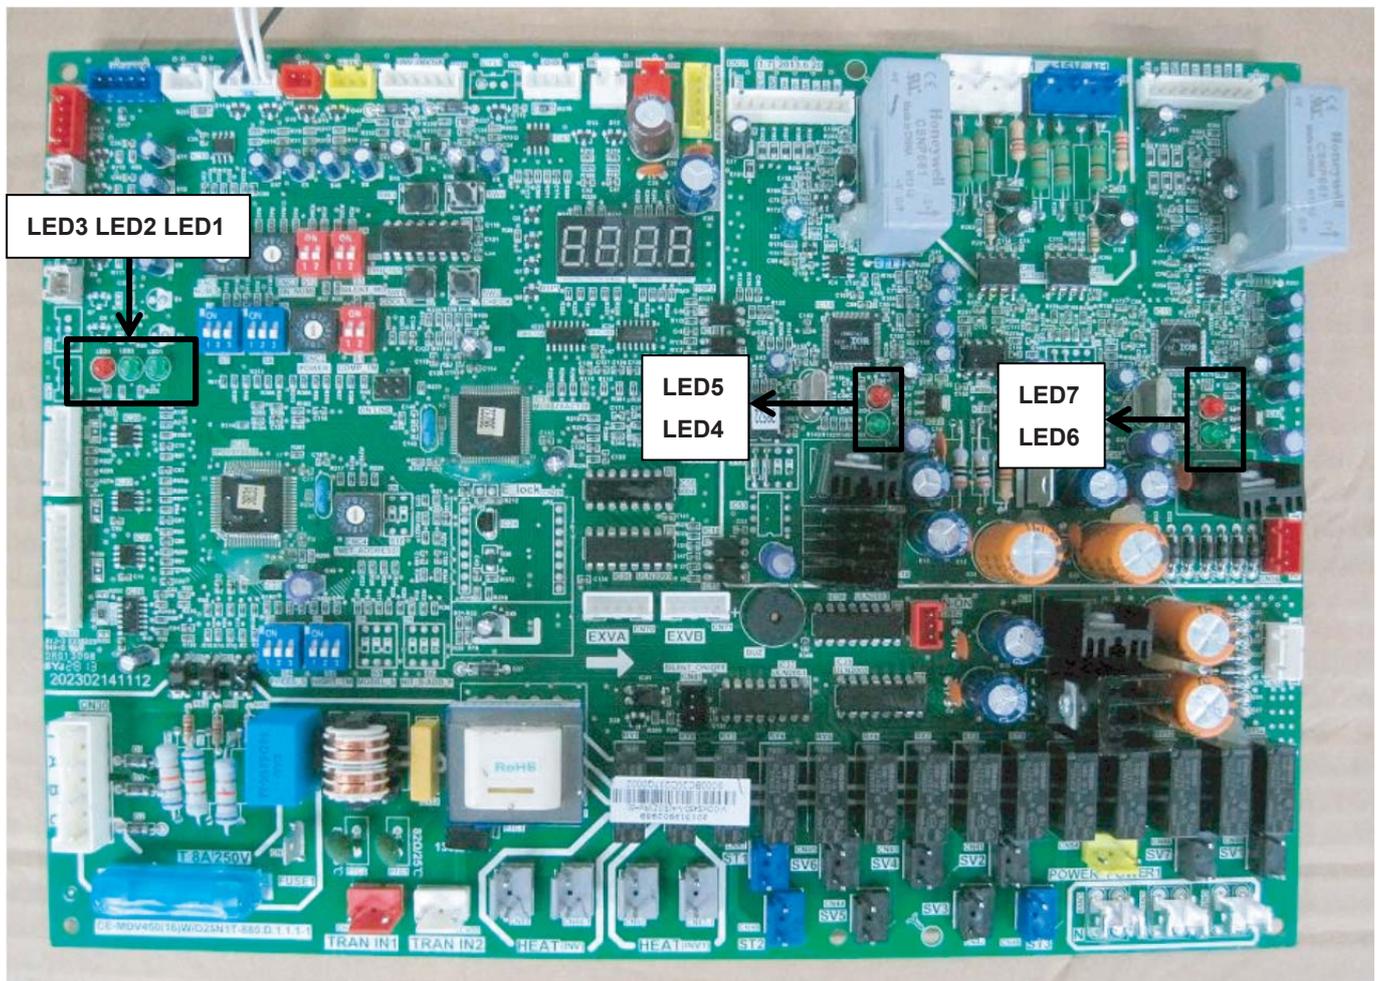

**LED1:** Power supply indicator lamp. The lamp will be on if the power supply is normal.

**LED2:** Running indicator lamp. The lamp will be on if the system running is normal.

**LED3:** Malfunction indicator lamp of network centralized control chip. The lamp will flash in three-phase phase sequence protection.

**LED4:** Running indicator lamp of inverter module. The lamp will be on if the compressor is running.

**LED5:** Malfunction indicator lamp of inverter module. The lamp will flash if the inverter module is faulty and the error code will display on digital tube.

**LED6:** Running indicator lamp of inverter module. The lamp will be on if the compressor is running.

**LED7:** Malfunction indicator lamp of inverter module. The lamp will flash if the inverter module is faulty and the error code will display on digital tube.

### 3. Error code table


Error code	Content	Note
E0	Communication error between outdoor units	Only display on the faulty slave unit, all the ODUs are in standby.
E1	Phase sequence error	Display on the faulty unit, all the ODUs are in standby.
E2	Communication error between indoors and the master unit.	Only display on the master unit, all the ODUs are in standby.
E4	Outdoor ambient temperature sensor (T4) and condenser pipe temperature sensor (T3/T5) error	Display on the faulty unit, all the ODUs are in standby.
E5	Power voltage error	Display on the faulty unit, all the ODUs are in standby.
E7	Discharge temp sensor error	Display on the faulty unit, all the ODUs are in standby.
E8	Outdoor unit address is wrong	Only display on the faulty slave unit, all the ODUs are in standby.
XE9	Driver model is mismatching	When X is 1, it means A system; 2 means B system
H0	Communication error between main control chip and inverter driver chip	Display on the faulty unit, all the ODUs are in standby.
H1	Communication error between main control chip and communication chip	Display on the faulty unit, all the ODUs are in standby.
H2	Quantity of outdoor unit decreased	Only display on the master unit, all the ODUs are in standby.
H3	Quantity of outdoor unit increased	Only display on the master unit, all the ODUs are in standby.
H4	P6 protection appears three times in 60 minutes	Display on the faulty unit, all the ODUs are in standby. Cannot be recovered until re-power on.
H5	P2 protection appears three times in 60 minutes	Display on the faulty unit, all the ODUs are in standby. Cannot be recovered until re-power on.
H6	P4 protection appears three times in 100 minutes	Display on the faulty unit, all the ODUs are in standby. Cannot be recovered until re-power on.
H7	Quantity of indoor unit decreased	Only display on the master unit, all the ODUs are in standby.
H8	High pressure sensor error	The discharge pressure $P_c \leq 0.3\text{MPa}$
H9	P9 protection appears three times in 60 minutes	Display on the faulty unit, all the ODUs are in standby. Cannot be recovered until being power on again.
xHd	Slave units malfunction	X stands for corresponding slave unit
C7	PL protection appears three times in 100 minutes	Display on the faulty unit, all the ODUs are in standby. Cannot be recovered until re-power on.
P1	High pressure protection	Display on the faulty unit, all the ODUs are in standby.
P2	Low pressure protection	Display on the faulty unit, all the ODUs are in standby.
XP3	Over current protection of inverter compressor	Display on the faulty unit, all the ODUs are in standby.
P4	Compressor discharge temp protection	Display on the faulty unit, all the ODUs are in standby.
P5	Condenser high temperature protection	Display on the faulty unit, all the ODUs are in standby.
XP6	Inverter module protection	When X is 1, it means A inverter module; 2 means B inverter module
P9	Fan module protection	Display on the faulty unit, all the ODUs are in standby.
PL	Temperature protection of main inverter module	
L0	Inverter module error	Display after P6 displaying for one minute

L1	DC generatrix low voltage error	Display after P6 displaying for one minute
L2	DC generatrix high voltage error	Display after P6 displaying for one minute
L3	Reserved	-
L4	MCE error/ synchronization/ closed loop	Display after P6 displaying for one minute
L5	Zero speed protection	Display after P6 displaying for one minute
L6	Reserved	-
L7	Phase sequence error	Display after P6 displaying for one minute
L8	Frequency difference in one second more than 15Hz protection	Display after P6 displaying for one minute
L9	Frequency difference between the real and the setting frequency more than 15Hz protection	Display after P6 displaying for one minute

## 4. Troubleshooting

### 4.1 E0: Communication error between outdoor units


The error only display on faulty slave unit, all the ODU will be standby.

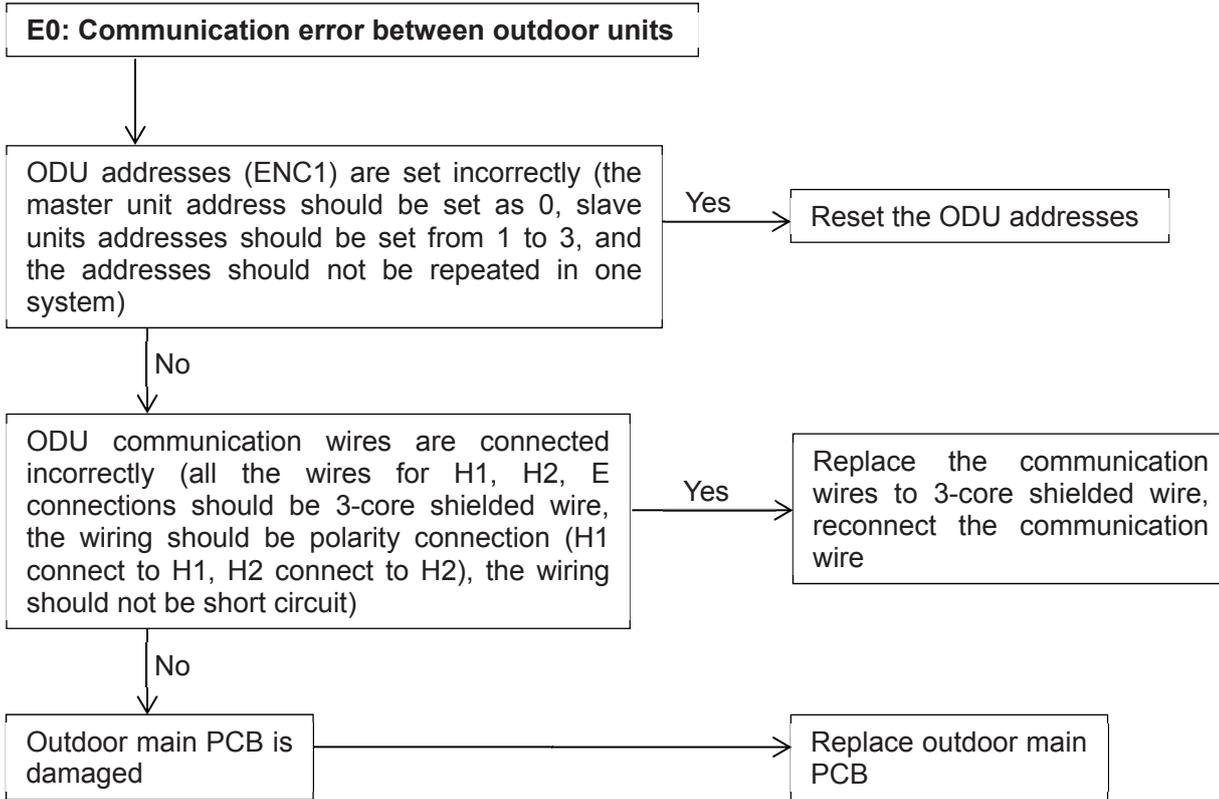

2-core shielded wire (✗)




3-core shielded wire (✓)



## 4.2 E1: Phase sequence error

The error only display on faulty unit, all the ODU will be standby.

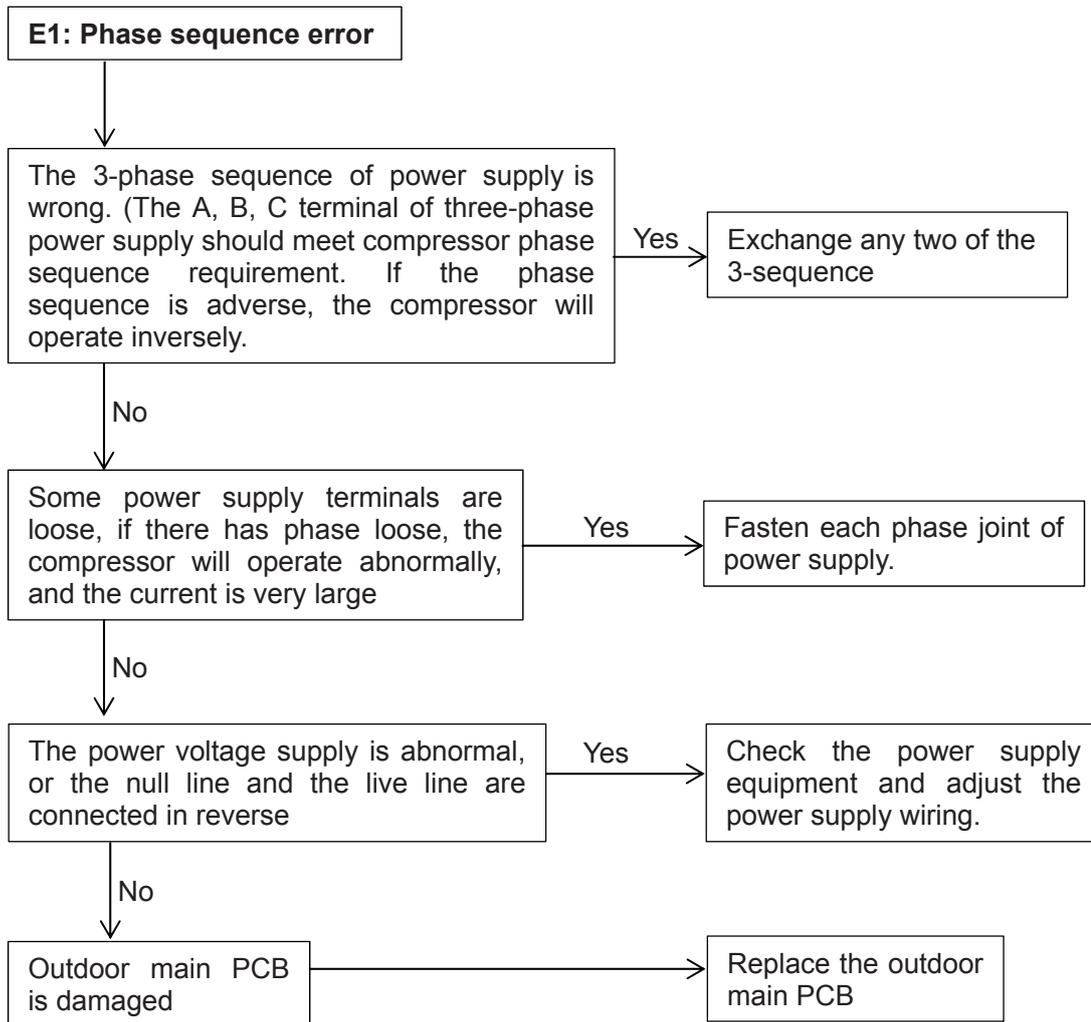


Note:

If the wiring connection of each outdoor unit is according to A, B, C phase sequence, when the quantity of outdoor units is large, the current difference between C phase and A, B phase will be very large for the power supply load of each outdoor unit is on C phase, it is very easy to lead to air switch break and wiring terminal burnout. So when the quantity of outdoor units is large, the phase sequence should be staggered, then the current can be distributed to the three phases equally.

### 4.3 E2: Communication error between indoors and the master unit

The error only display on faulty slave unit, all the ODU will be standby.

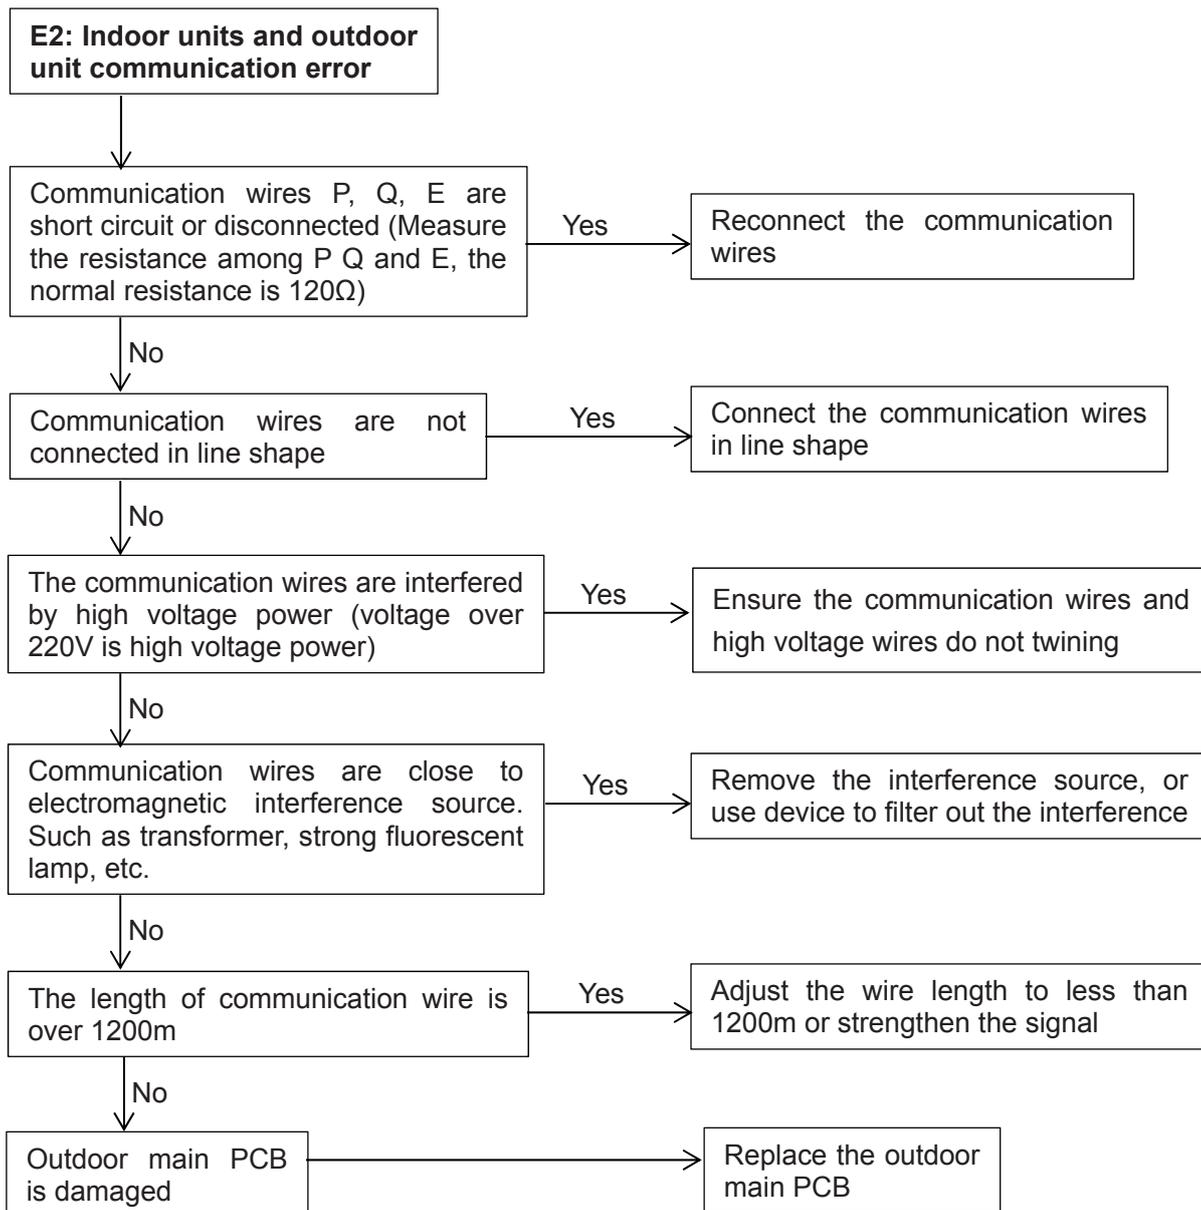

Note:

1. Press the manual button on display board of indoor unit for 5 seconds, the communication address code of indoor unit will display;



Codes are as follows:

Indicator light	Running	Timer	Fan/defend cold fan	Warning
Code	8	4	2	1

Buzzer	Communication address	Four LED display
Not warning	00---15	Normally on
Not warning	16---31	Flash
Warning	32---47	Normally on
Warning	48---63	Flash

For example:

Press the manual button for 5 seconds:

- If the “Operation”, “Timer” and “DEF./FAN” lights are normally on and the buzzer is not warning, that means the address code is  $14=(8+4+2)$
- If the four LED lights are flash and the buzzer isn't warning, the address code should plus 16, that means the address code is  $30=16+(8+4+2)$
- If the “Operation”, “Timer” and “DEF./FAN” lights are normally on and the buzzer is warning, that means the address code is  $46=32+(8+4+2)$
- If the four LED lights are flash and the buzzer is warning, that means the address code is  $62=48+(8+4+2)$

2. Press the manual button on display board of indoor unit for 10 seconds, the capacity code of indoor unit will display;

Dial code	Capacity (×100W)	Capacity (Btu/h)	Capacity (HP)
0	22	7510	0.8
1	28	9550	1.0
2	36	12280	1.2
3	45	15350	1.6
4	56	19110	2.0
5	71	24230	2.5
6	80	27300	3.0
7	90	30710	3.2
8	112	38210	4.0
9	140	47770	5.0
A	160	54590	6.0
B	160	54590	6.0
C	160	54590	6.0
D	160	54590	6.0
E	160	54590	6.0
F	160	54590	6.0

For example

Pressing continued the manual button for 10 seconds:


- If all the LED lights turn off, that means the capacity code is 0 and the capacity of indoor units is  $22 \times 100\text{W}$  (7510Btu/h);
- If the “Timer” and “Alarm” lights are normally on, that means the capacity code is  $5=(4+1)$  and the capacity of indoor unit is  $71 \times 100\text{W}$  (24230Btu/h);
- If the “Operation” and “Alarm” lights are normally on, that means the capacity code is  $9=(8+1)$  and the capacity of indoor unit is  $140 \times 100\text{W}$  (47770Btu/h);
- If all the LED lights turn on, that means the capacity code is  $F=(8+4+2+1)$  and the capacity of indoor unit is  $160 \times 100\text{W}$  (54590Btu/h).

The above basic principle just applies to single PCB, if the indoor unit has more than one PCB, or one PCB can achieve a virtual multi blocks function, you must use the basic principle to Calculate the achievable capacity of single PCB at first, then add all the value as the capacity of the indoor unit .

For example

- The high static pressure duct have capacity of 20kW(68240Btu/h), 25kW(85300Btu/h), 28kW(95540Btu/h) and larger capacity of 40kW(136480Btu/h), 45kW(153540Btu/h), 56kW(191070Btu/h).
- The “Operation” light is normally on, that means the capacity code is 8 and the achievable capacity of single PCB is  $112 \times 100\text{W}$  (38210Btu/h), then add the value of two PCB, so the capacity of indoor unit is  $200 \times 100\text{W}$  (68240Btu/h);
- The “Operation” and “Alarm” lights are normally on, that means the capacity code is  $9=(8+1)$  and the achievable capacity of single PCB is  $140 \times 100\text{W}$  (47770Btu/h), then add the value of two PCB, so the capacity of indoor unit is  $280 \times 100\text{W}$  (95540Btu/h);
- The “Operation” light is normally on, that means the capacity code is 8 and the achievable capacity of single PCB is  $112 \times 100\text{W}$  (38210Btu/h), then add the value of four PCB, so the capacity of indoor unit is  $450 \times 100\text{W}$  (153540Btu/h);
- The “Operation” and “Alarm” lights are normally on, that means the capacity code is  $9=(8+1)$  and the achievable capacity of single PCB is  $140 \times 100\text{W}$  (47770Btu/h), then add the value of four PCB, so the capacity of indoor unit is  $560 \times 100\text{W}$  (191070Btu/h).

3. If the signal is weak, connect a  $120\Omega$  resistor between P and Q of the farthest indoor unit, or connect a 0.5-1.5uF capacitor between P and Q of outdoor unit. Installation refers to the following picture:

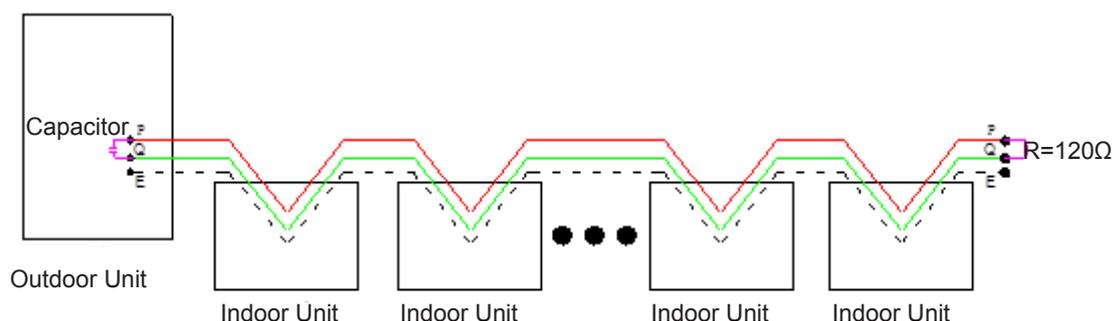


Note:

Communication wires should be shield wire and indoor units should be connected in series.


**4.4 E4: Temperature sensor (ambient temperature sensor T4, pipe temperature sensor T3/T5)****E7: Discharge temperature sensor error**

The error only display on faulty unit, all the ODU will be standby.

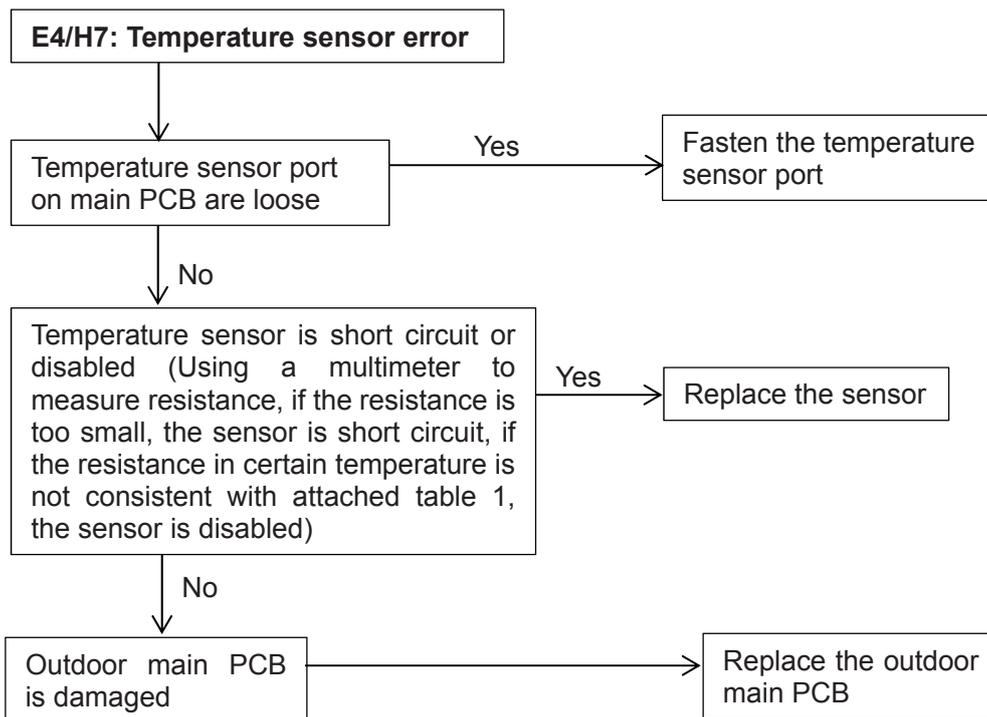

## 4.5 E5: Voltage error

The error only display on faulty unit, all the ODU will be standby.

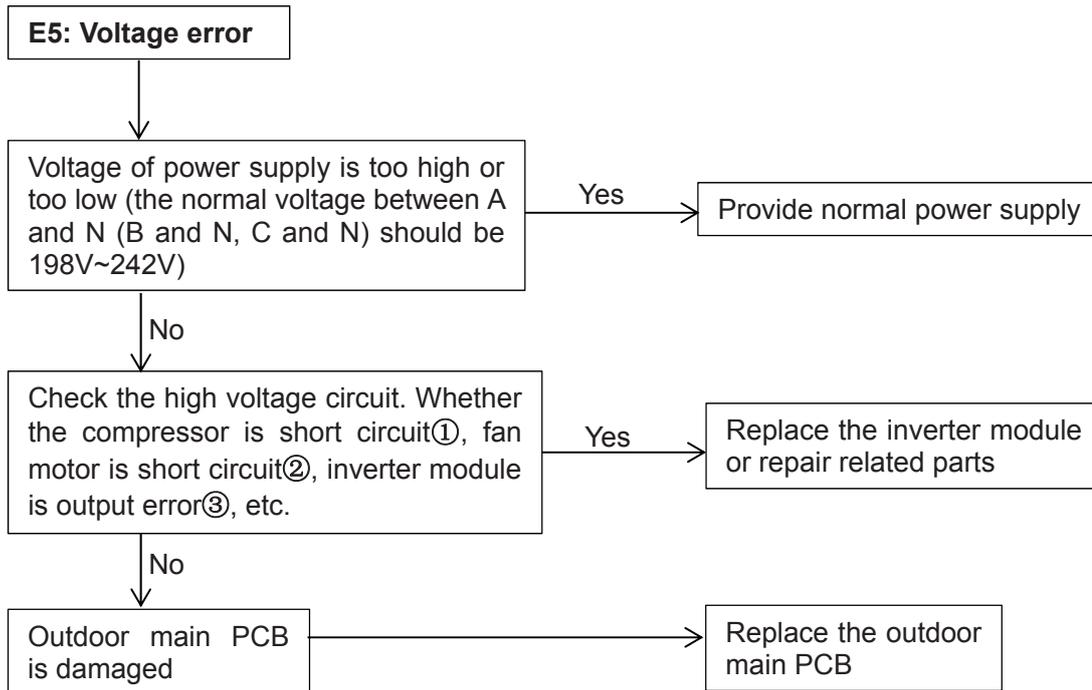

### Note:

#### 1. How to check whether the compressor is short circuit①:

The normal resistance value of inverter compressor among U V W is 0.7~1.5Ω, and infinity to earth. If the resistance value is out of the range, the compressor is abnormal.

#### 2. How to check whether the fan motor is short circuit②:



The normal value of DC fan motor coil among U V W is less than 10Ω, and the value of AC fan motor coil is from a few ohm to hundreds of ohm for different fan motor model. If the measured value is 0Ω, the fan motor is short circuit.

#### 3. How to check whether the inverter module is output error③:

Let PN and U V W of inverter module short circuit, then dial multimeter to buzzer file, if the multimeter is ring, the inverter module is output error.

**4.6 E8: Outdoor unit address is wrong**


The error only display on faulty slave unit, all the ODU will be standby.

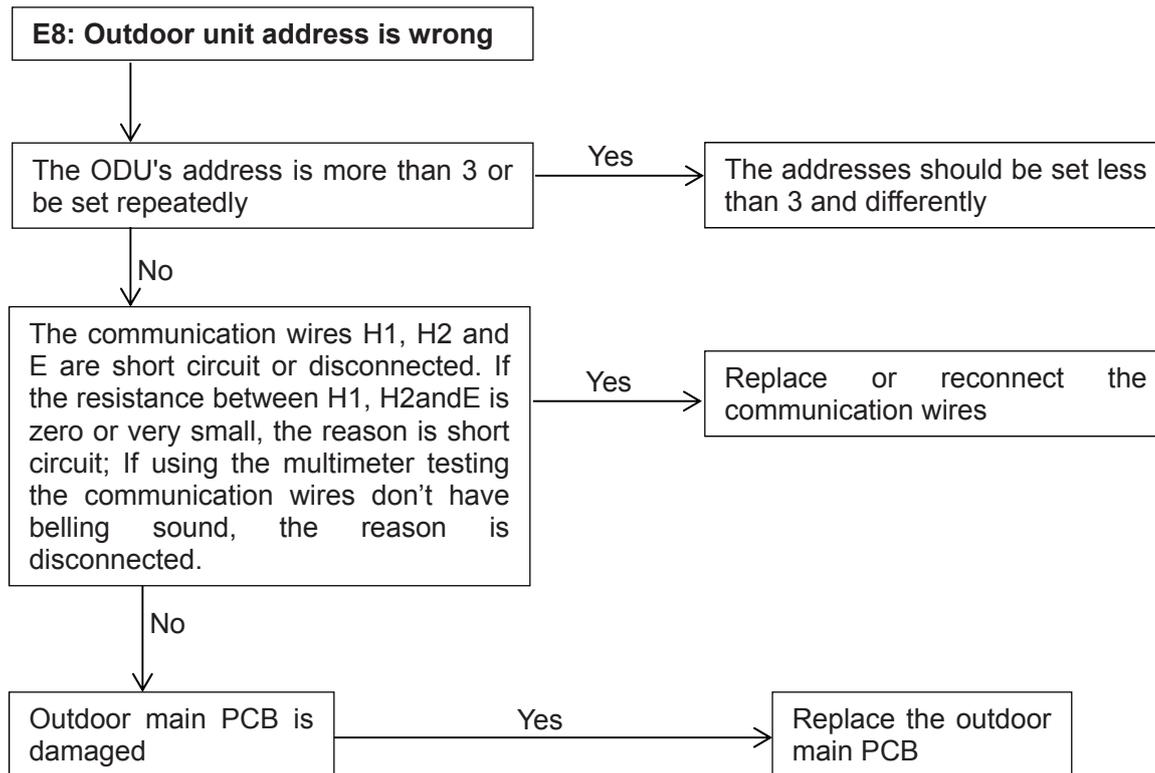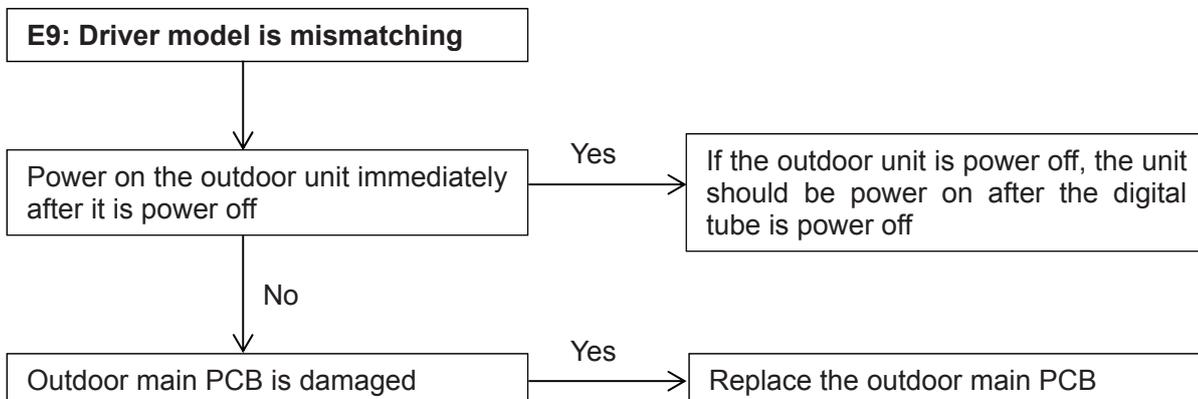**4.7 XE9: Driver model is mismatching (When X is 1, it means A system; 2 means B system)**

## 4.8 H0: Communication error between main control chip and inverter driver chip

### H1: Communication error between main control chip and communication chip

The error only display on faulty unit, all the ODU will be standby.

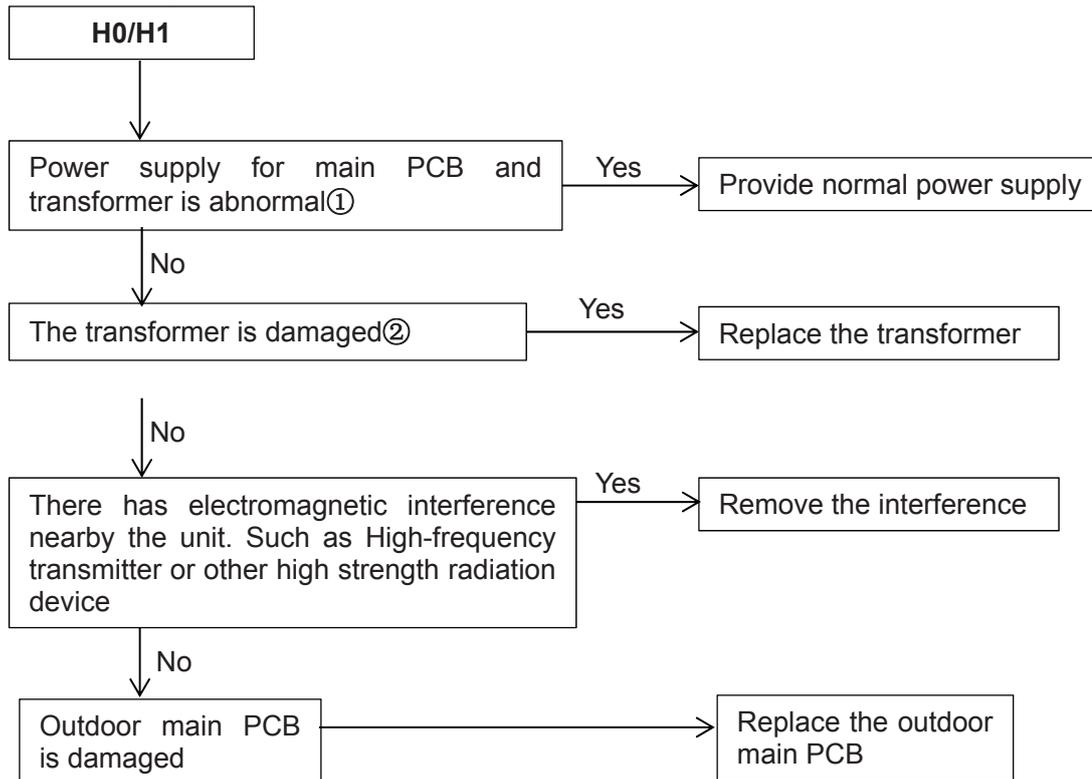


#### Note:

#### 1. How to check whether power supply for transformer is abnormal①

Check the voltage of 8(CN31), 9(CN33) and 24(CN35) terminals. The normal voltage of 8(CN31) and 9(CN33) terminals should be 220V, the voltage between “GND” and “5V” of 24(CN35) terminal should be 5V, the voltage between “GND” and “12” of 24(CN35) terminal should be 12. If the voltage is out of the range, the power supply for main PCB and transformer is abnormal.


#### 2. How to check whether the transformer is disabled②

The voltage between upper tow pins of 18(CN32) terminal is AC 13.5V; the voltage between under tow pins of 18(CN32) terminal is AC 9V. The voltage between upper tow pins of 19(CN34) terminal is AC 14.5V; the voltage between under tow pins of 19(CN34) terminal is AC 14.5V

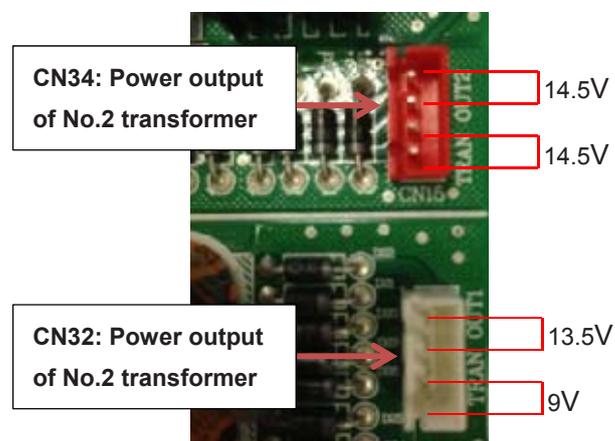

**4.9 H2: Quantity of outdoor unit decreased; H3: Quantity of outdoor unit increased**


The error only display on master unit, all the ODU will be standby.

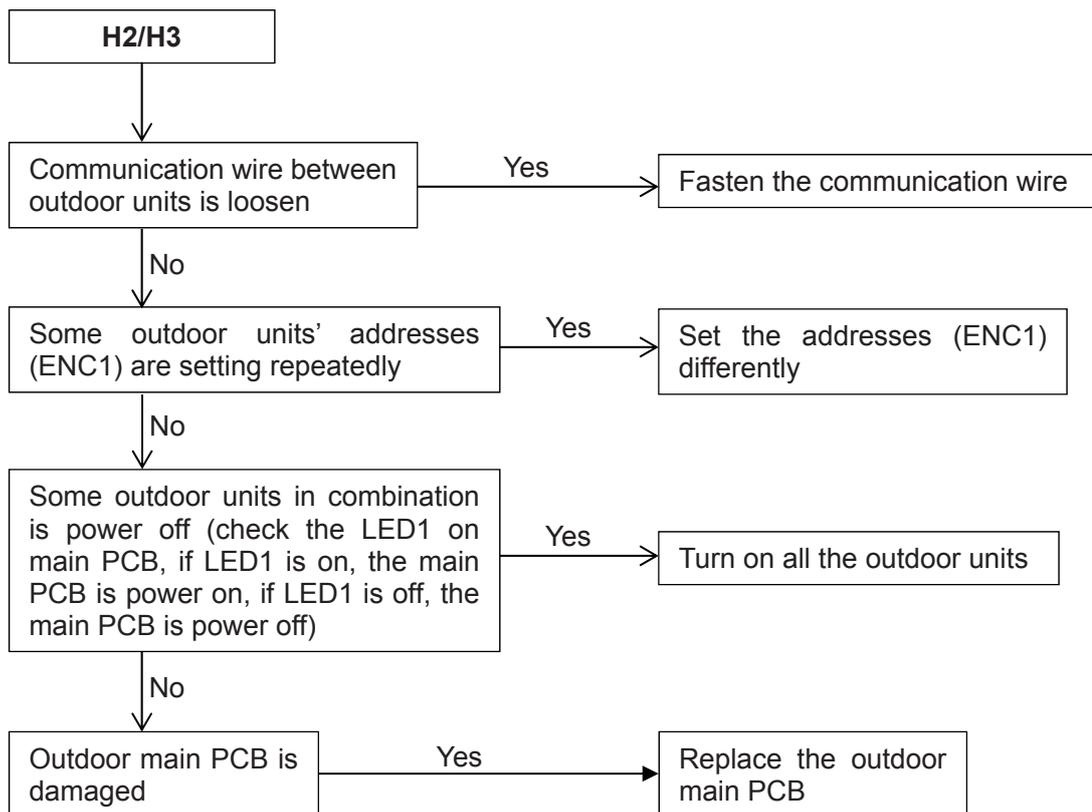

Note: All the outdoor units should be unified power supply. If the outdoor units are not unified power supply, once some outdoor unit is power off, other outdoor units are still running, it may cause system unbalance and damage devices.

#### 4.10 H7: Quantity of indoor units decrease error

The error only display on master unit, all the ODU will be standby. It will display when the quantity of indoor units decrease above 3 minutes.

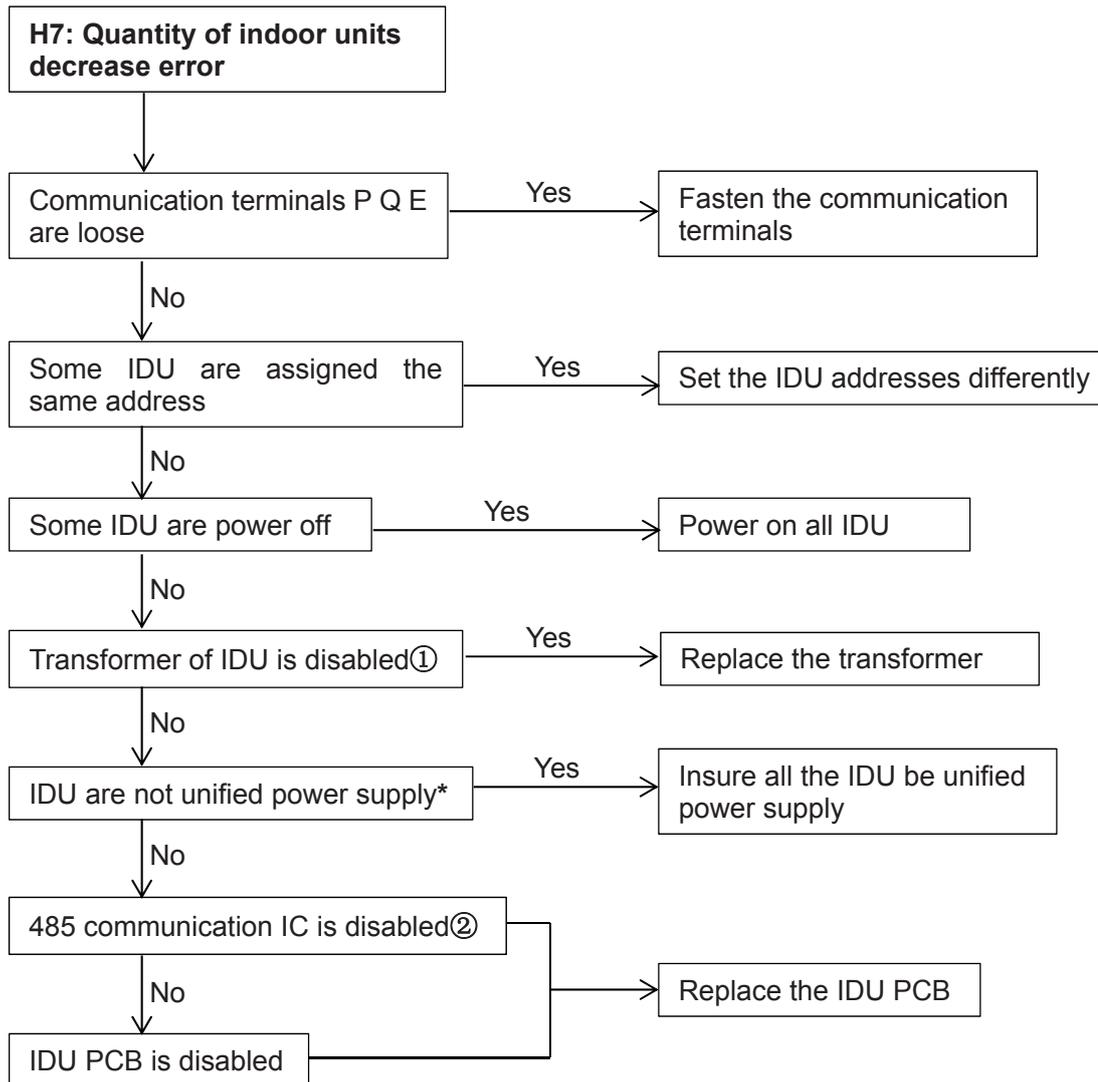


**Note:**

**1. How to check whether the transformer of IDU is disabled①**

The voltage input for IDU transformer is 220V, the voltage output of is AC9V (yellow-yellow) and AC13.5V (brown-brown)

**2. How to check whether the 485 communication IC is disabled②**


The normal voltage between "P" and "GND" is DC2.5~2.7V, between "Q" and "GND" is DC2.5~2.7V. If the voltage is out of the normal range, the 485 communication IC is disabled.

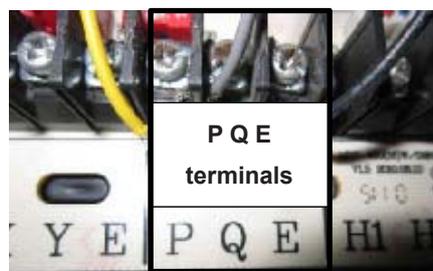

\* Indoor units should be unified power supply, which can prevent compressor from liquid hammer caused by dropped indoor units with EXV unclosed.

#### 4.11 H8: High pressure sensor error

When the discharge pressure is lower than 0.3MPa, the system will display H8 error, the ODU in standby. When the discharge pressure is back to normal, H8 disappears and normal operation resumes.

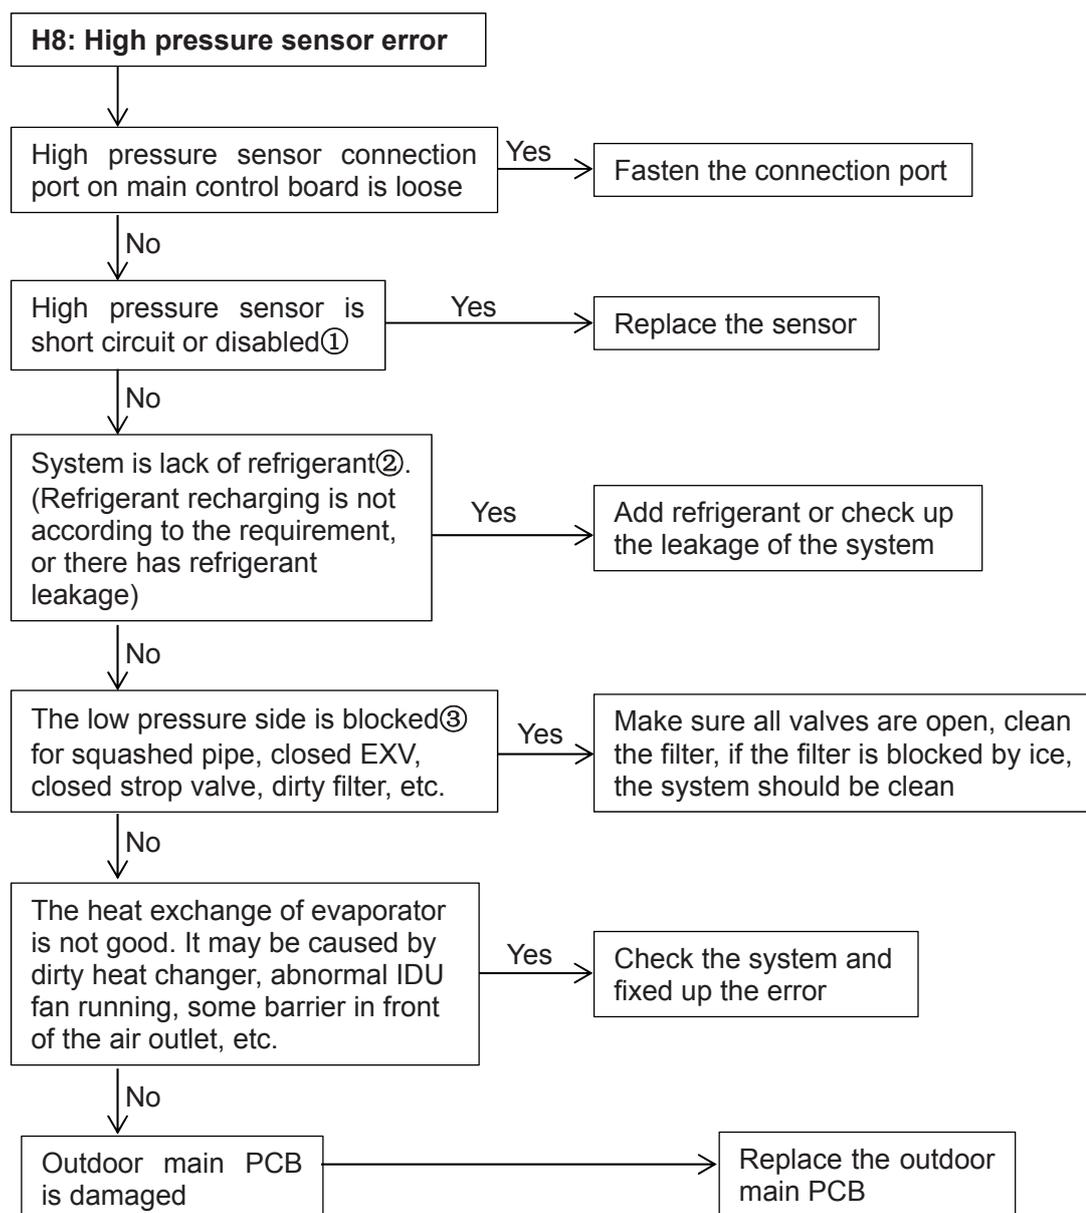

#### Note:

##### 1. How to check whether the high pressure sensor is short circuit or disabled①

Measure the resistance among the three terminals of the pressure sensor, if the resistance value is megohm or infinite, the pressure sensor is disabled, otherwise, it may be normal.

##### 2. The phenomenon of lack of refrigerant②:

Top temperature and discharge temperature of all compressors are higher than normal value, discharge pressure and suction pressure are both lower than normal value, current is lower than normal value, suction pipe may be frosting. All the phenomenon will disappear after recharging refrigerant.

##### 3. The phenomenon of the low pressure side is blocked③:

The discharge temperature is higher than normal value\*, low pressure is lower than normal value\*, current is lower than normal value\* and suction pipe may be frosting.


\*The normal system running parameters please refer to attached table 3.

#### 4.12 XHd: Slave units malfunction (X stands for corresponding slave unit)

XHd is only displayed on master unit. X stands for corresponding slave unit. If X is 1, it means no.1 slave unit has problem, then you should check no.1 slave unit.

#### 4.13 P1: High pressure protection

When the pressure is over 4.4MPa, the system will display P1 protection, the ODU in standby. When the pressure is lower than 3.2MPa, P1 disappears and normal operation resumes.

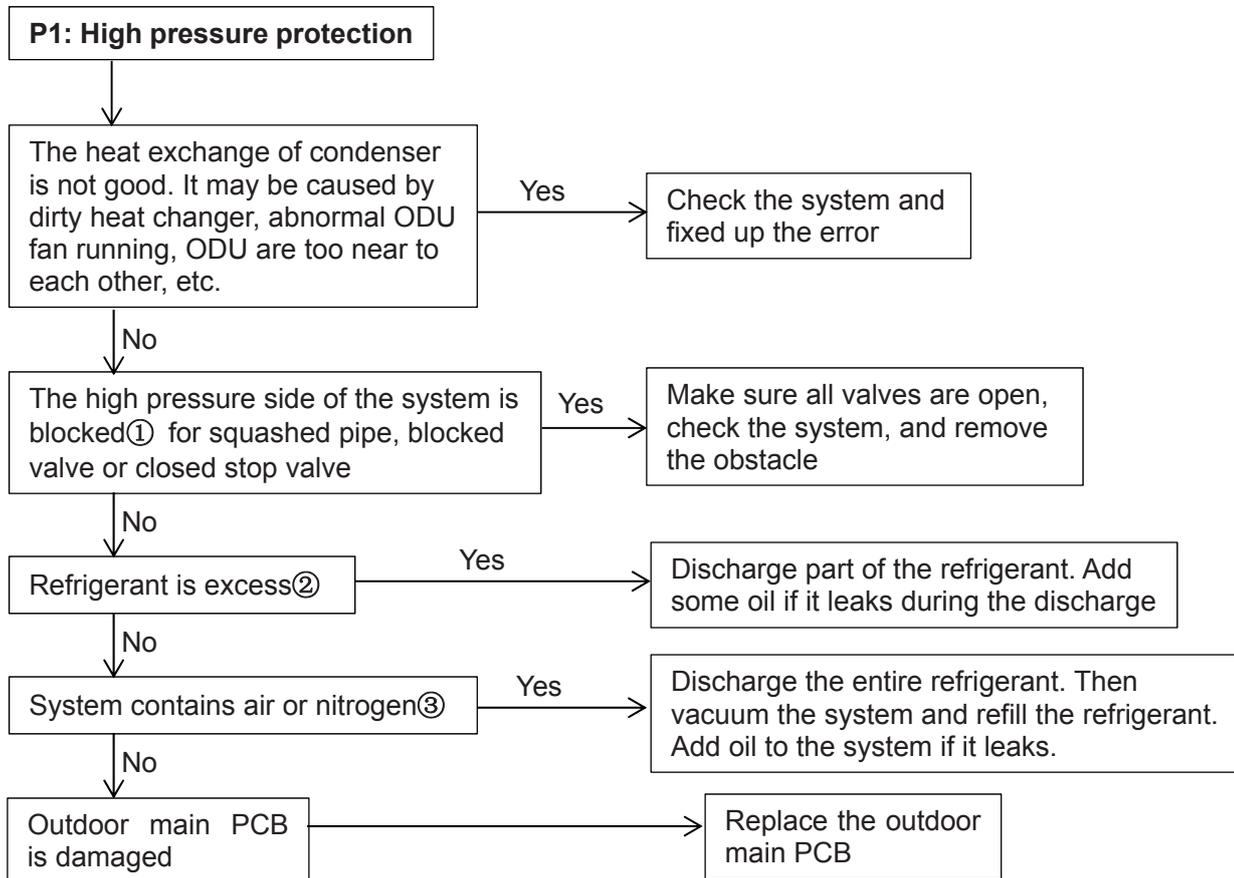

#### Note:

##### 1. The phenomenon of The high pressure side of the system is blocked①:

The high pressure is higher than normal value, the low pressure is lower than normal value, and the discharge temperature is higher than normal value.

##### 2. The phenomenon of the refrigerant is excess②:

The high pressure is higher than normal value, the low pressure is higher than normal value, and the discharge temperature is lower than normal value.

##### 3. The phenomenon of the system contains air or nitrogen③:

The high pressure is higher than normal value, current is larger than normal value, discharge temperature is higher than normal value, compressor makes noise, pressure meter do not display steady.

\*The normal system running parameters please refer to attached table 3.


\*If the system install three-phase protector, and the three-phase protector connect with high pressure switch in series connection, the system will display P1 protection when fist power on, and P1 protection will disappear after system is steady.

\*If the system install three-phase protector, and the three-phase protector connect with low pressure switch in series connection, the system will display P2 protection when fist power on, and P2 protection will disappear after system is steady.

#### 4.14 P2/H5: Low pressure protection

When the pressure is lower than 0.05MPa, the system will display P2 protection, the ODU in standby. When the pressure is higher than 0.15MPa, P2 disappears and resumes normal operation.

H5 error will display when system appear 3 times P2 protection in 60 minutes, it cannot resume automatically, and it can resume only by restarting the machine.

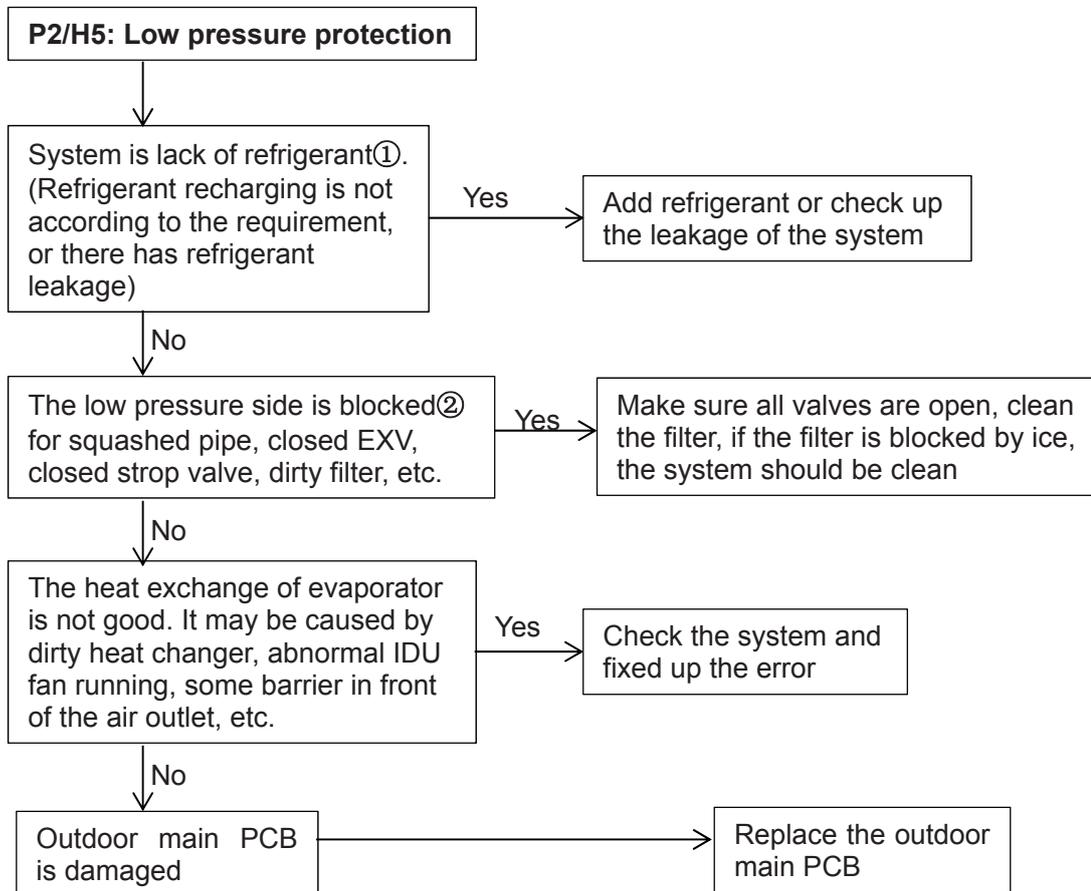

#### Note:

##### 1. The phenomenon of lack of refrigerant①:

Top temperature and discharge temperature of all compressors are higher than normal value, discharge pressure and suction pressure are both lower than normal value, current is lower than normal value, suction pipe may be frosting. All the phenomenon will disappear after recharging refrigerant.

##### 2. The phenomenon of the low pressure side is blocked②:

The discharge temperature is higher than normal value\*, low pressure is lower than normal value\*, current is lower than normal value\* and suction pipe may be frosting.


\*The normal system running parameters please refer to attached table 3.

\*If the system install three-phase protector, and the three-phase protector connect with high pressure switch in series connection, the system will display P1 protection when fist power on, and P1 protection will disappear after system is steady.

\*If the system install three-phase protector, and the three-phase protector connect with low pressure switch in series connection, the system will display P2 protection when fist power on, and P2 protection will disappear after system is steady.

### 4.15 XP3: Current protection of inverter compressor (When X is 1, it means A compressor; 2 means B compressor)

**P3:** When the current of inverter compressor is over 12A, the system will display P3 protection, the ODU in standby. When the current goes back to normal range, P3 disappears and normal operation resumes.

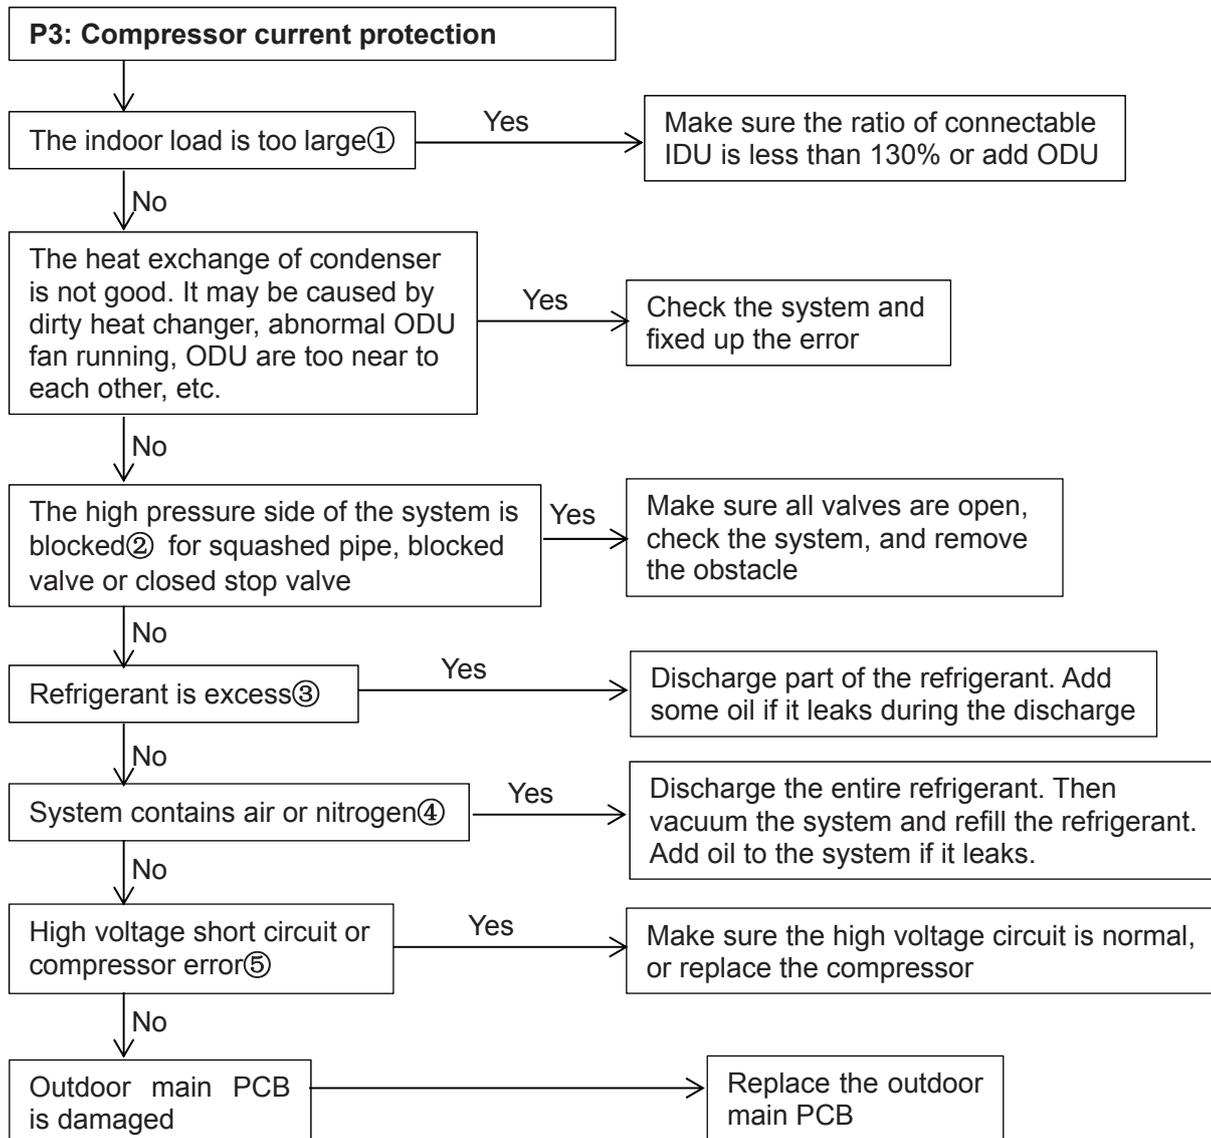

#### Note:

##### 1. The phenomenon of the indoor load is too large ①:

The suction temperature and discharge temperature are both higher than normal value.

##### 2. The phenomenon of The high pressure side of the system is blocked ②:

The high pressure is higher than normal value, the low pressure is lower than normal value, and the discharge temperature is higher than normal value.

##### 3. The phenomenon of the refrigerant is excess ③:

The high pressure is higher than normal value, the low pressure is higher than normal value, and the discharge temperature is lower than normal value.

##### 4. The phenomenon of the system contains air or nitrogen ④:


The high pressure is higher than normal value, current is larger than normal value, discharge temperature is higher than normal value, compressor makes noise, pressure meter do not display steady.

##### 5. How to check whether compressor is error ⑤:

Measure the resistance between two terminals among the three terminals of compressor. The resistance between two terminals is 2-5Ω, the resistance between each terminal and ground is infinity, if the resistance is out of the normal range, the compressor is error.

**4.16 P4: Discharge temperature protection; H6: P4 protection appears three times in 100 minutes**

The error only display on faulty unit, all the ODU will be standby. H6 error cannot resume automatically, and it can resume only by restarting the machine.

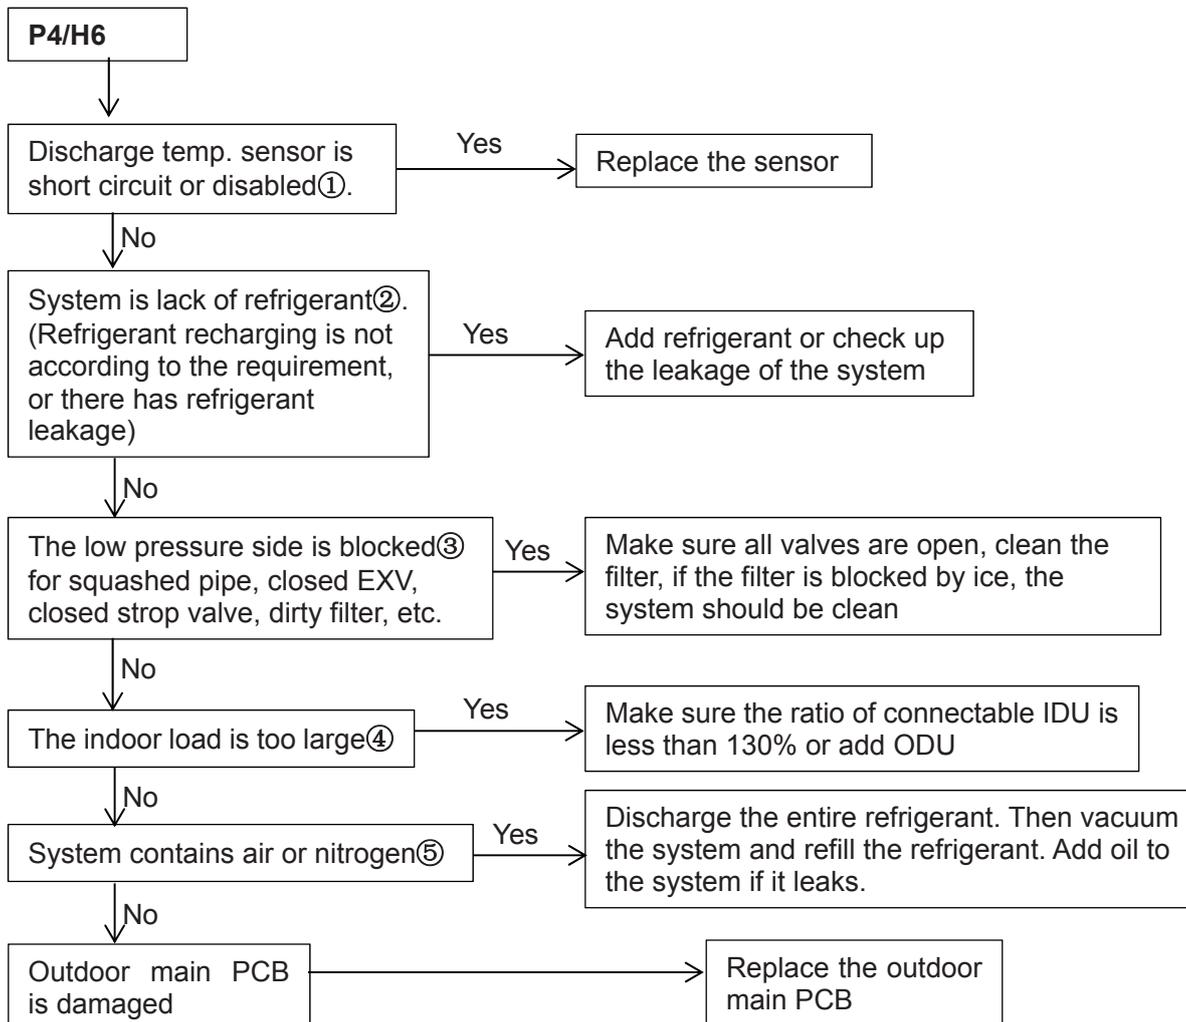**Note:****1. How to check whether the discharge temperature sensor is short circuit or disabled①:**

Using a multimeter to measure resistance, if the resistance is too small, the sensor is short circuit, if the resistance in certain temperature is not consistent with attached table 2, the sensor is disabled

**2. The phenomenon of lack of refrigerant②:**

Top temperature and discharge temperature of all compressors are higher than normal value, discharge pressure and suction pressure are both lower than normal value, current is lower than normal value, suction pipe may be frosting. All the phenomenon will disappear after recharging refrigerant.

**3. The phenomenon of the low pressure side is blocked③:**

The discharge temperature is higher than normal value\*, low pressure is lower than normal value\*, current is lower than normal value\* and suction pipe may be frosting.

**4. The phenomenon of the indoor load is too large④:**

The suction temperature and discharge temperature are both higher than normal value.


**5. The phenomenon of the system contains air or nitrogen⑤:**

The high pressure is higher than normal value, current is larger than normal value, discharge temperature is higher than normal value, compressor makes noise, pressure meter do not display steady.

\*The normal system running parameters please refer to attached table 3.

#### 4.17 P5: Condenser temperature protection

When condenser temperature is over 65°C, the system will display P5 protection, the ODU in standby. When the temperature goes back to normal range, P5 disappear and normal operation resumes.

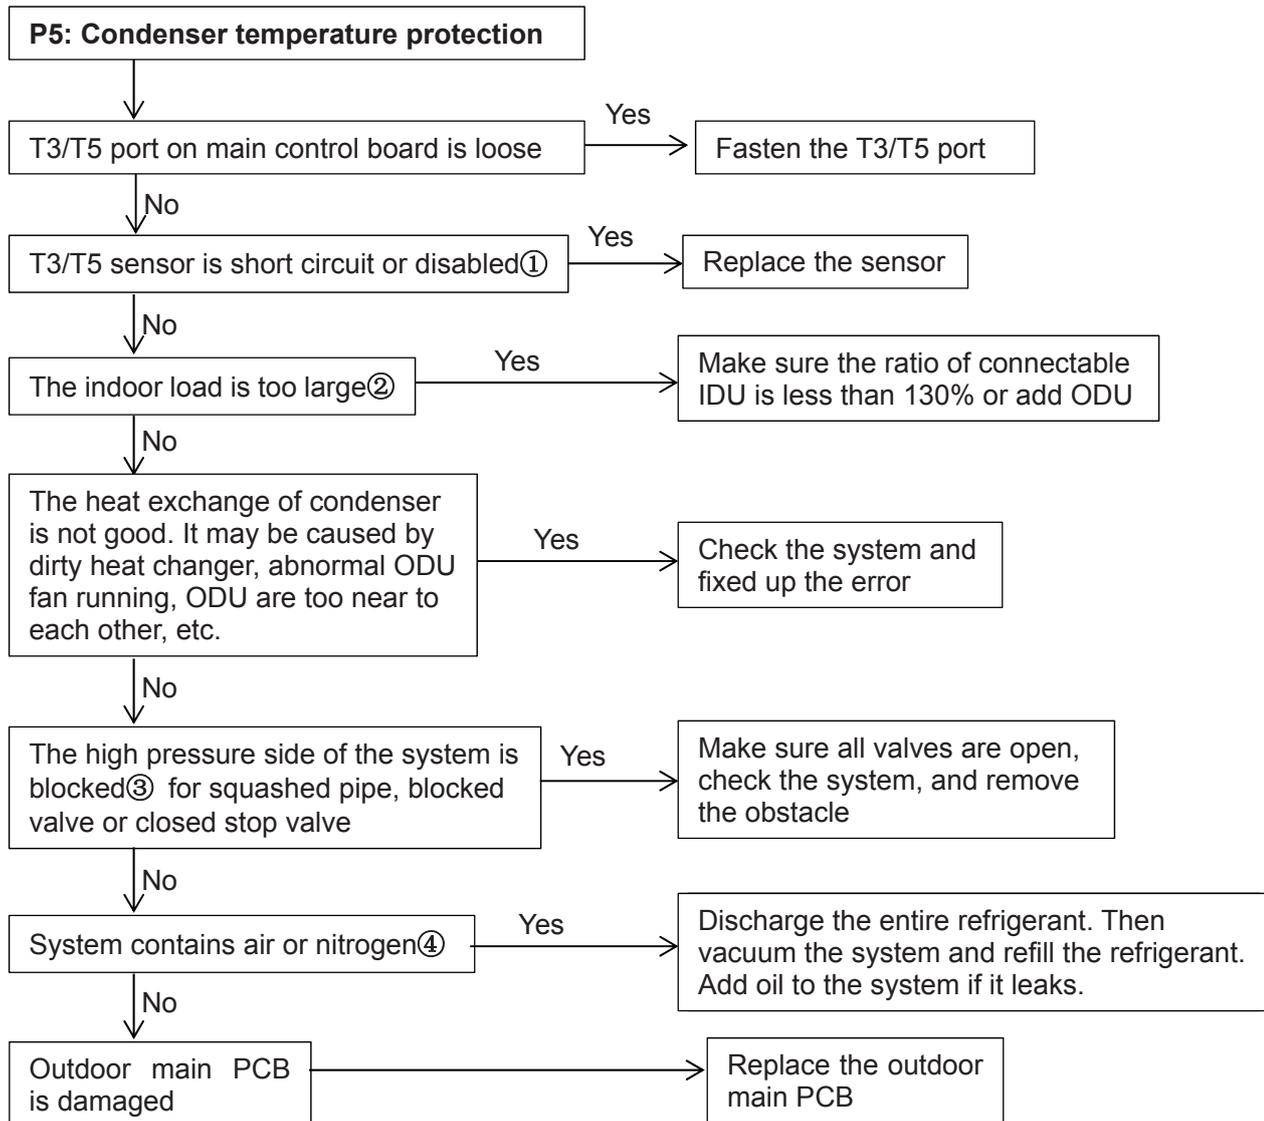

#### Note:

##### 1. How to check whether the T3/T5 sensor is circuit or disabled①:

Using a multimeter to measure resistance, if the resistance is too small, the sensor is short circuit, if the resistance in certain temperature is not consistent with attached table 1, the sensor is disabled

##### 2. The phenomenon of the indoor load is too large②:

The suction temperature and discharge temperature are both higher than normal value.

##### 3. The phenomenon of The high pressure side of the system is blocked③:

The high pressure is higher than normal value, the low pressure is lower than normal value, and the discharge temperature is higher than normal value.


##### 4. The phenomenon of the system contains air or nitrogen④:

The high pressure is higher than normal value, current is larger than normal value, discharge temperature is higher than normal value, compressor makes noise, pressure meter do not display steady.

#### 4.18 XP6: Inverter module protection (When X is 1, it means A inverter module; 2 means B inverter module)

##### H4: P6 protection appears three times in 60 minutes

When the system displays H4 error code, the system can resume only by restarting the machine. At this time, malfunction should be disposed promptly to avoid further damage.

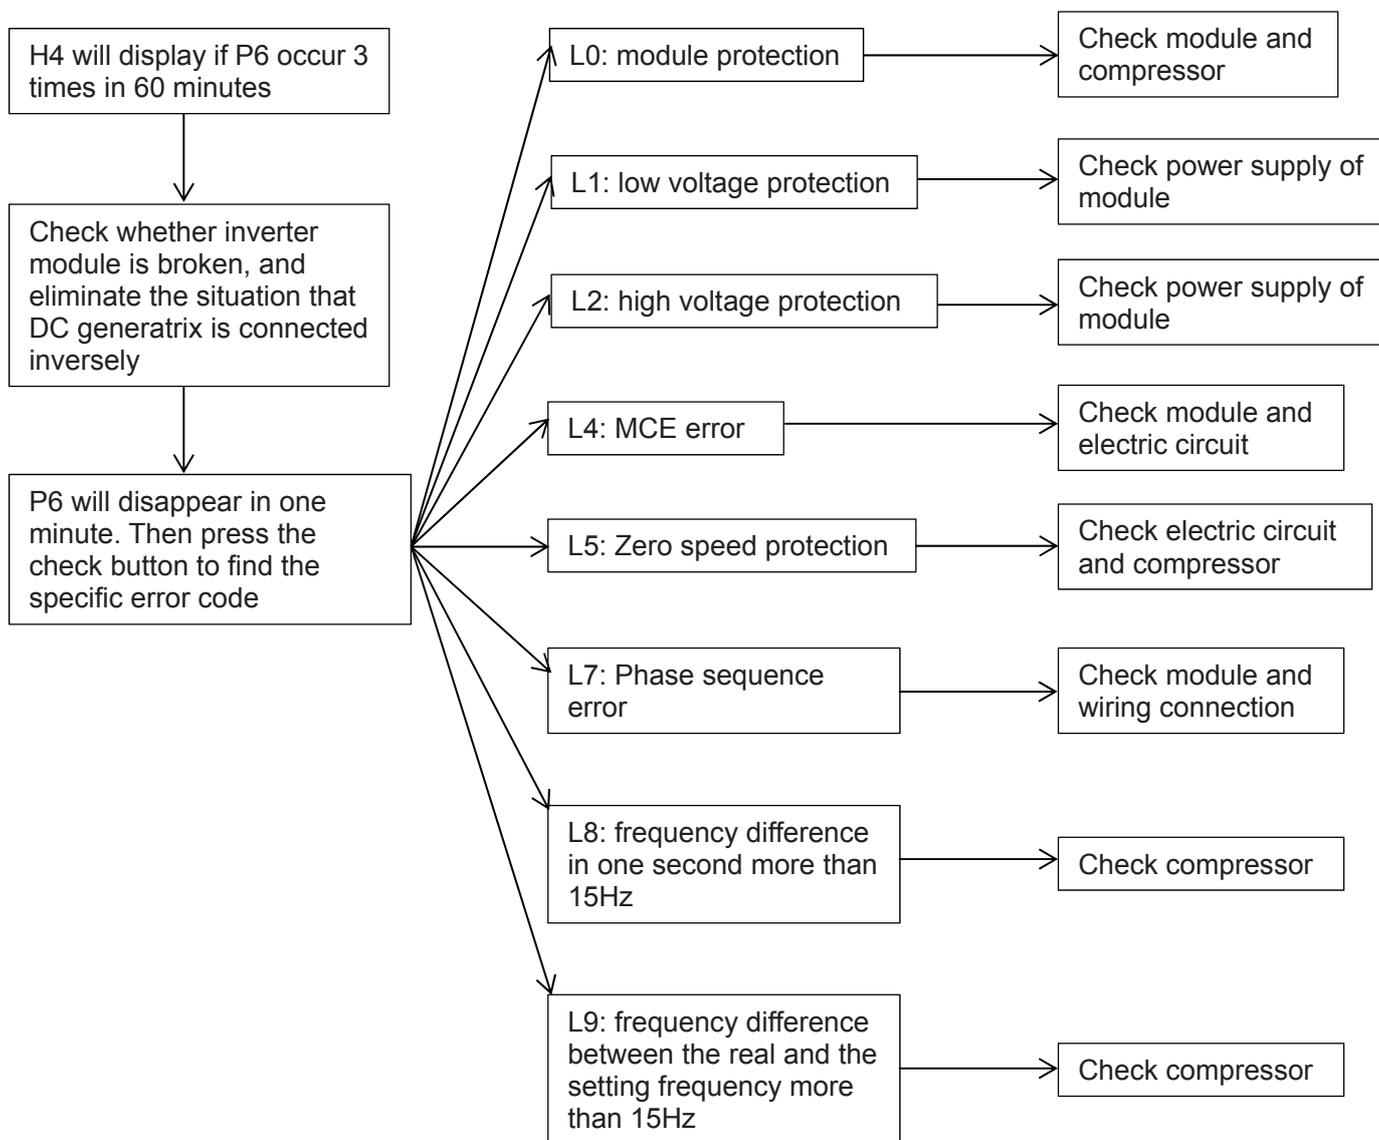

## 1) L0 troubleshooting

### Step 1: Compressor check

Measure the resistance between each two of U, V, W terminals of the compressor, all the resistance should be the same and equal to 0.9~5 Ohms. (Fig. A and Fig. B)

Measure the resistance between each of U, V, W terminals of the compressor to ground (Fig. C), all the resistance should trend to infinity (Fig. D), otherwise the compressor has been malfunction, needs to be replaced.



Fig. A



Fig.B




Fig.C



Fig.D

If the resistance value are normal, then go to step 2.

### Step 2: Module check

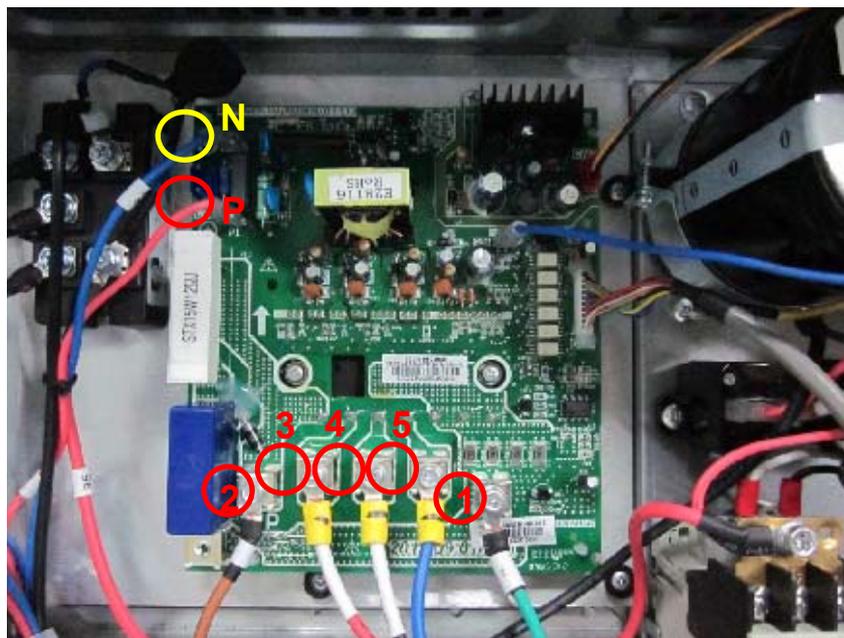


- 1) DC voltage between terminal P and terminal N should be 1.41 times of the local power supply voltage.
- 2) DC voltage between terminal 1 and 2 should be 510V~580V.
- 3) Disconnect the terminal 3, 4, and 5 from inverter compressor. Measure the resistance between any two terminals among terminal 1, 2, 3, 4, 5. All the values should be infinity. If any of the value approximates to 0, the inverter module is damaged and should be replaced.

After replaced the inverter module, if the system is still abnormal, then go to step3.


### Step 3: DC generatrix check

Direction of the current in DC supply wire which is running through the inductor should be the same as the direction of arrow marked on the inductor.

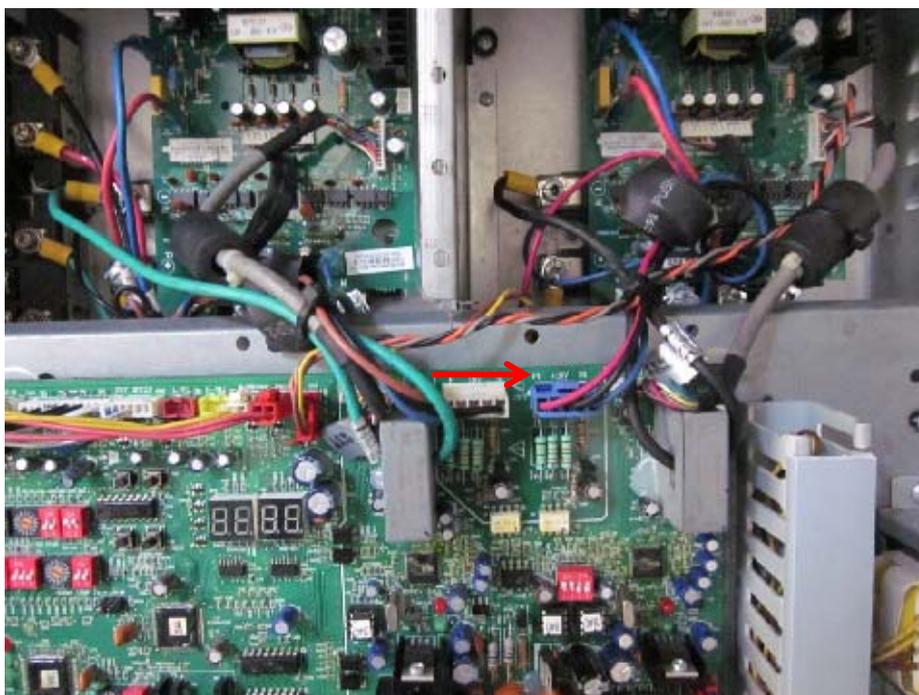

## 2) L1/L4 troubleshooting


Step 1: Check the DC voltage between 1 and 2 terminal, the normal value should be 510V~580V, if the voltage is lower than 510V, go to step 2.

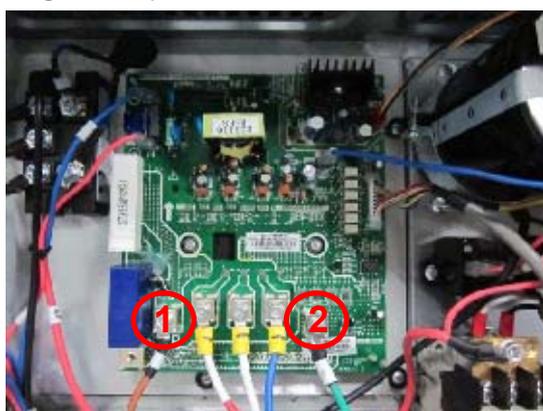


Step 2: Check whether the wires of rectifier circuit are loose or not. If wires are loosen, fasten the wires. If wires are OK, replace the main PCB.

### 3) L2 troubleshooting

Step 1: Check the DC voltage between 1 and 2 terminal, the normal value should be 510V~580V, if the voltage is higher than 580V, go to step 2.

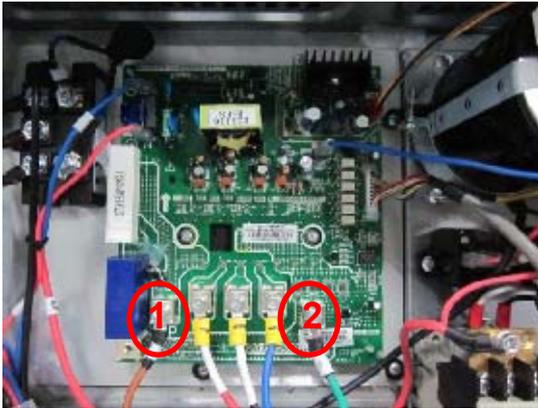

Step 2: Check the voltage between the two electrolytic capacitors, the normal value should be 510V~580V.

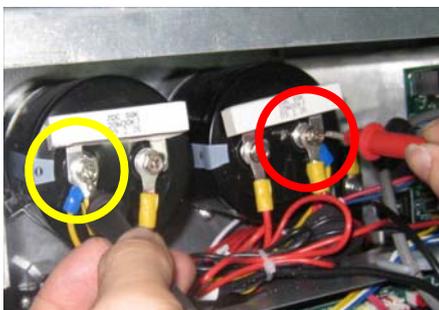

Turn the measure range of the meter to 1kV, measure the voltage between two electrolytic capacitors



If the value is not in the range, that means the power supply for electrolytic capacitors has problem, you should check the power supply, whether the voltage is too high and whether the voltage is stable.

If the voltage value is normal, then the main PCB has malfunction, it needs to be replaced.

### 4) L8/L9 troubleshooting

#### Step 1: Compressor check

Measure the resistance between each two of U, V, W terminals of the compressor, all the resistance should be the same and equal to 0.9~5 Ohms. (Fig. A and Fig. B)

Measure the resistance between each of U, V, W terminals of the compressor to ground (Fig. C), all the resistance should trend to infinity (Fig. D), otherwise the compressor has been malfunction, needs to be replaced.



Fig. A

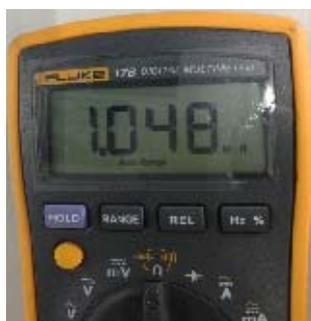


Fig. B



Fig. C



Fig. D

If the resistance value are normal, then go to step 2.

**Step 2:** Disconnect the power wiring from the compressor(named compressor A) of the faulted system(named system A).


**If there is a system running normally nearby(named system B):**

Extend the power line of the inverter compressor of system B, connect compressor A to the control box of

system B, make sure that the U, V, W terminals are connected in right order, then start system B.

If compressor A can start normally, that means compressor is OK, the control box of system A is malfunction, then replace the main PCB of system A with correct wire connection.

If compressor A can not start normally, that means compressor A is damaged, needs to be replaced.

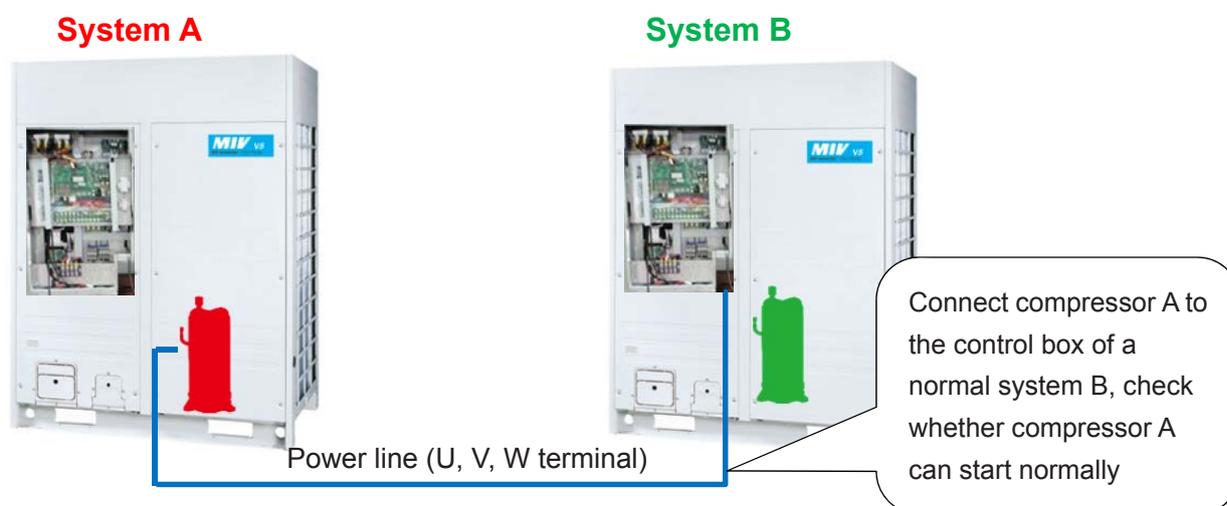

#### If there is not a normal system nearby:

Replace the main PCB of system A with correct connection, if compressor A can start normally, it means the main PCB which is replaced is damaged. If compressor A still can't start normally, replace the compressor.

#### 5) Guide for compressor replacement

**Step 1:** Take out the compressor from the faulted outdoor unit, pour out the oil from the compressor according to the method illustrated. Normally the oil will outflow from the discharge pipe of the compressor.



#### Step 2: check the oil of the system

Normally the oil is clear and transparent, if it is a little yellowing, it is also OK. However, if the oil is become black, feculent, or even there is impurity in the oil, that means the system has problems and the oil has gone


bad, the oil need to be replaced.

The oil is black, it has been carbonized

The oil is a little yellowing, but it is clear and transparent, the quality is OK



The oil is still transparent, but there is impurity in the oil, the impurity may clog the filter

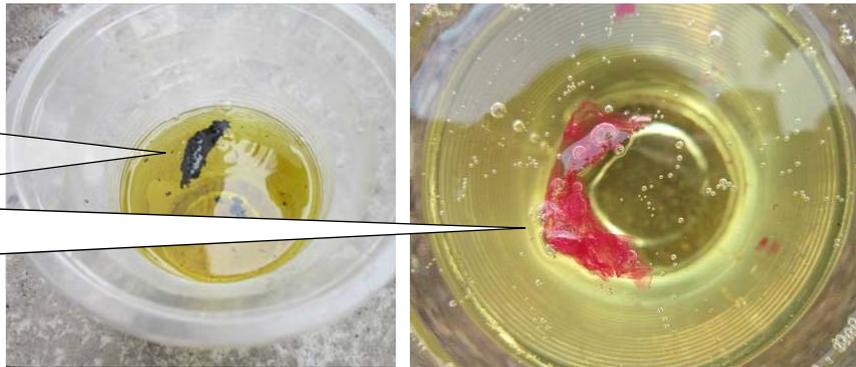


The oil becomes cloudy and gray

The oil contains a lot of copper scrap



**If the oil has gone bad:**

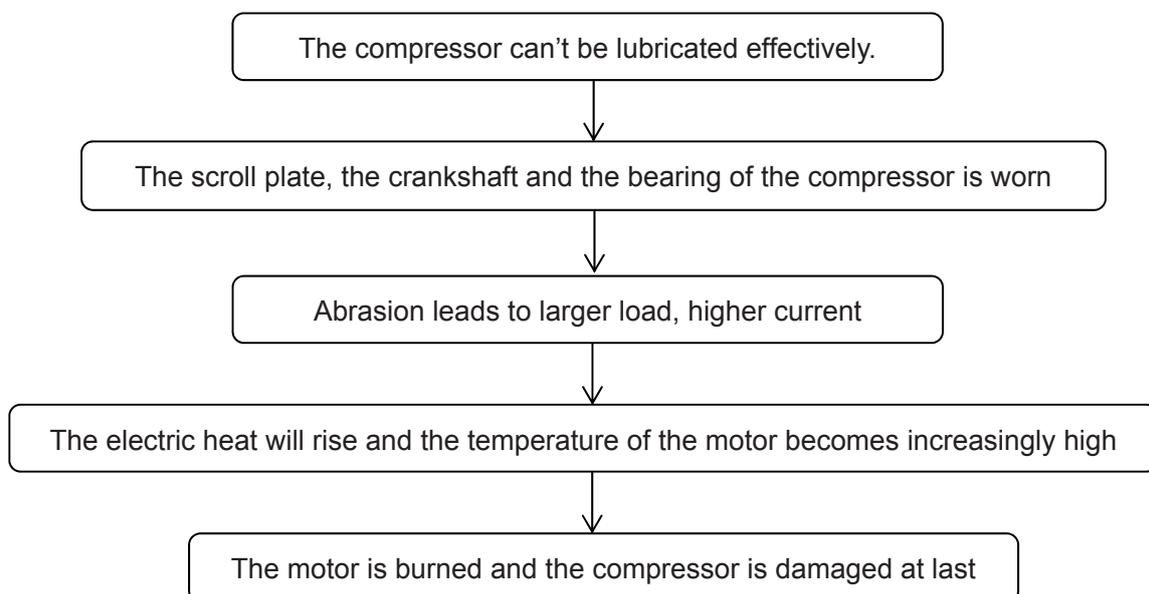




The crankshaft is worn.



The scroll plate is worn.



A normal bearing of the compressor

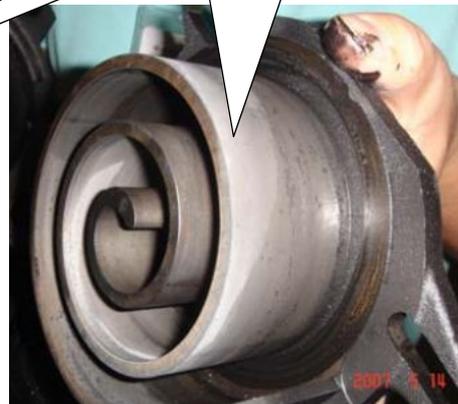


The bearing is worn seriously, it is damaged completely




A clean filter (on the suction pipe of the system)




The filter is blocked by impurity, the suction of the compressor will be abnormal

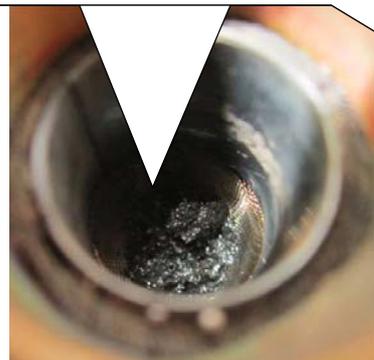

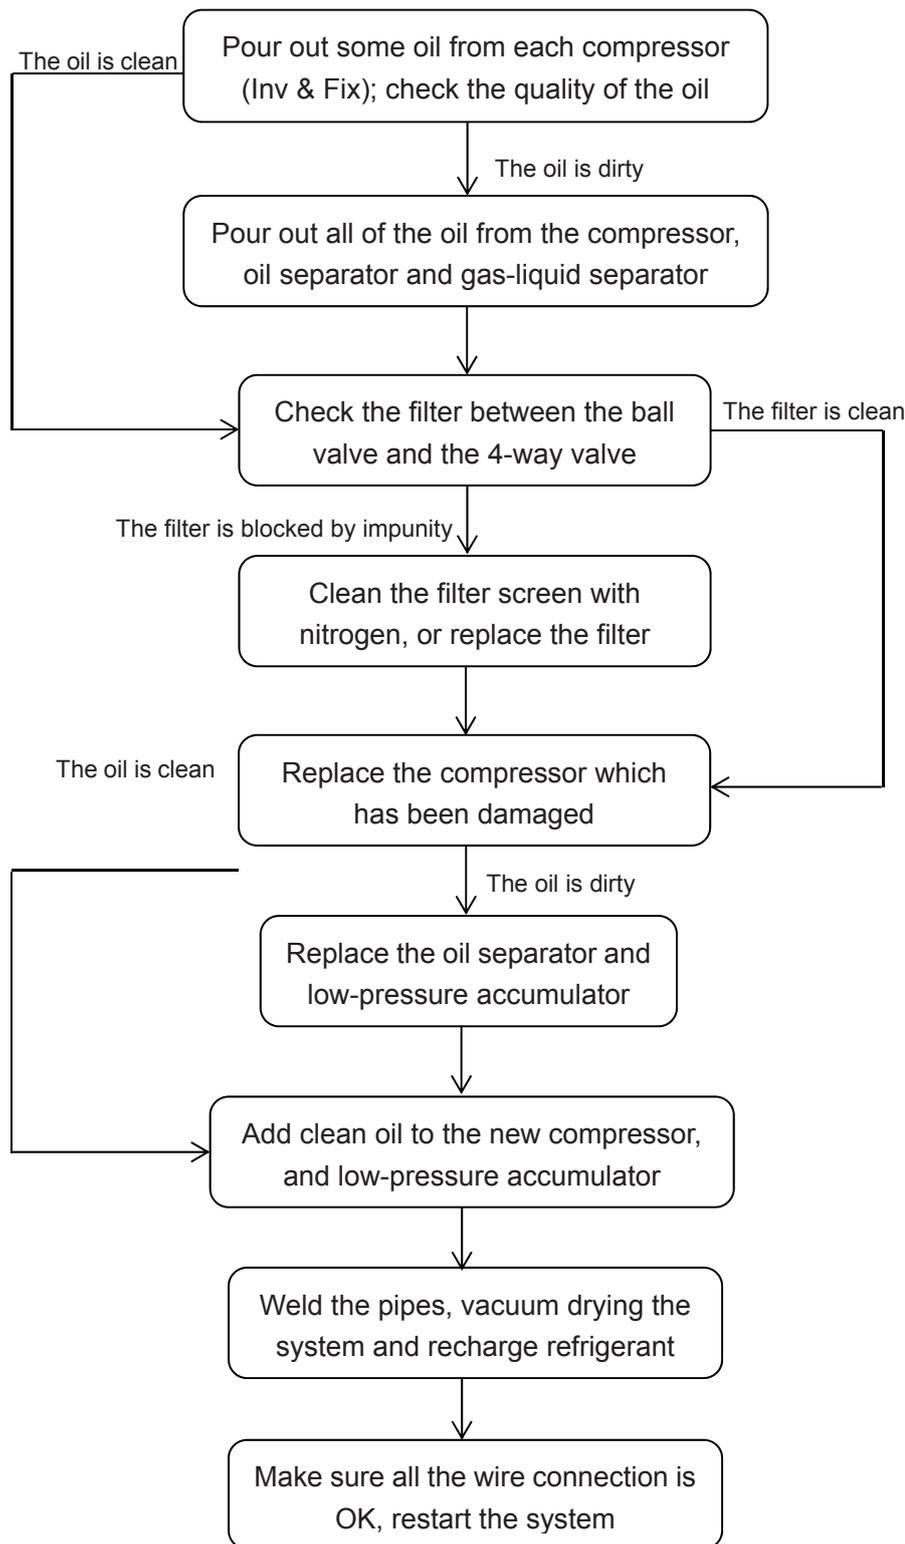**Step 3: Replace the compressor****Note:**

1. Before dumping the oil, shake the compressor, oil separator and gas-liquid separator first, because impurity may deposit at the bottom of the tank.
2. If the oil of the inverter compressor is clean, there's no need to check the oil of fixed compressors. If the oil of the inverter compressor has gone bad, check the oil of fixed compressors is necessary. If all the oil of an outdoor unit needs to be replaced, after adding oil to the compressors, the rest oil should be charged to the low-pressure accumulator.


3. Add oil to the compressor from the **discharge pipe**.

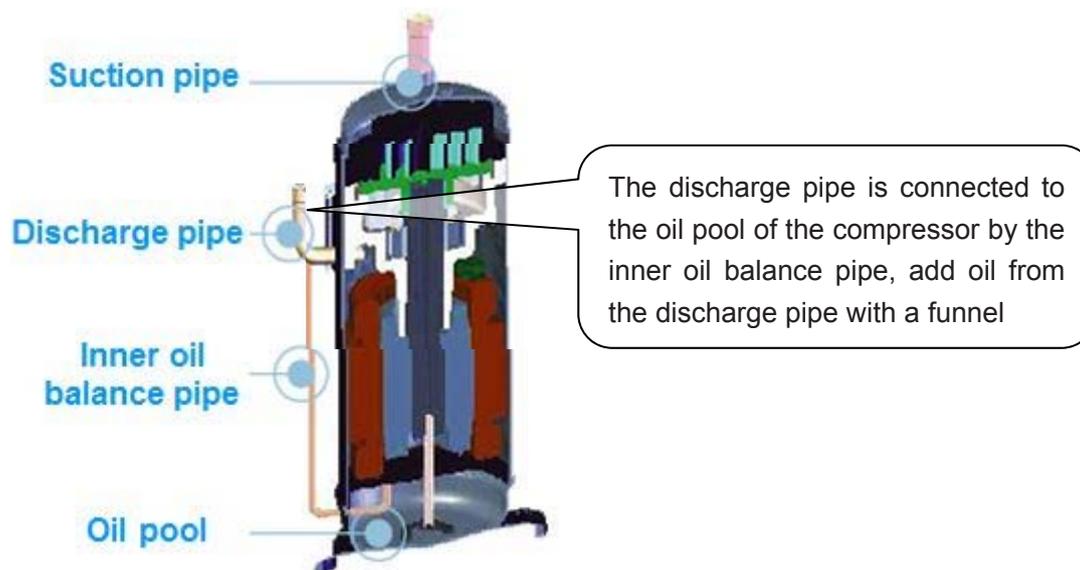


4. The type of the oil is FVC-68D, make sure the type of the oil is right because different compressor need different type of oil, if the type is wrong there will be various kinds of problems.

### 4.19 P9/H9: DC fan module protection

If the system display three times P9 protection in 60 minutes, the system will stop and display H9 error code. When the system displays H9 error code, the system can resume only by restarting the machine. At this time, malfunction should be disposed promptly to avoid further damage.

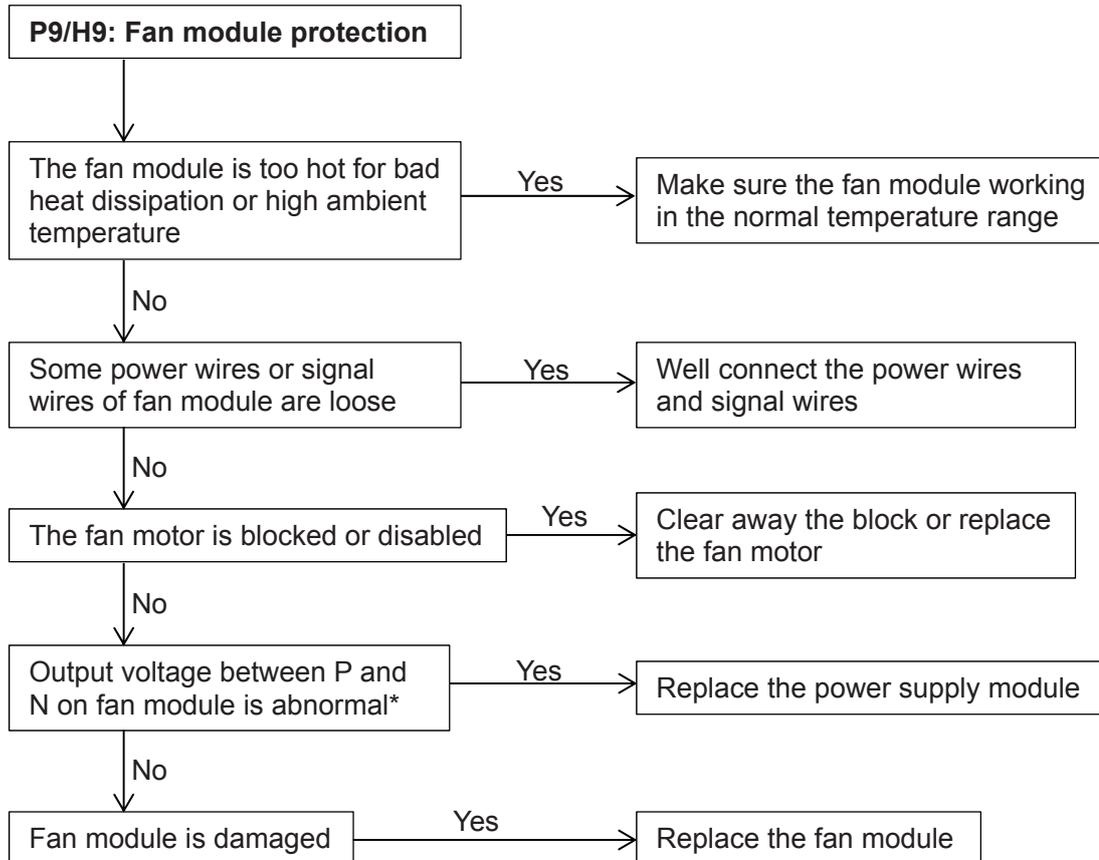

#### Fan module instruction

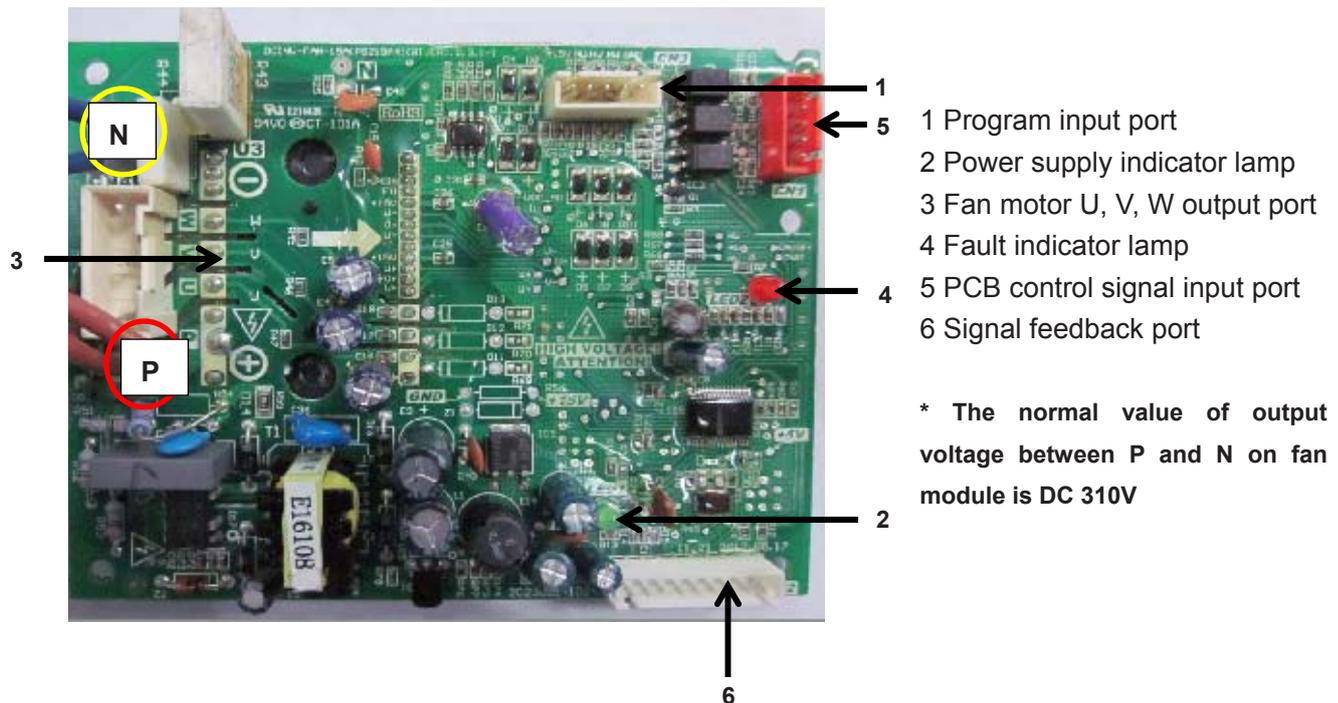

## P9 protection analysis


Conditions	Fault indicator lamp of fan module	Power supply indicator lamp of fan module	Digital tube display	Malfunction analysis
Power on	Off	Off	Quantity of IDU or "0"	Check the power supply circuit for fan module. Check whether there has power supply for lightning protection plate, whether the protective tube is broken, whether the voltage after rectification is normal, whether the bridge rectifier is broken.
Power on	Off	Flicker	Quantity of IDU or "0"	Power supply of fan module has problem, needs to replace the fan module.
When fan motor start	At first the lamp is on then the lamp is off	On	P9/H9	Check whether the drive port and signal feedback port is loose, whether the fan module and fan motor is installed firmly. If above conditions are all OK, it needs to replace the fan module.
When fan motor start	At first the lamp is on then the lamp flicker	On	P9/H9	Check whether the transformer in lightning protection plate is open circuit, whether the relay is broken. If occurs above problem, it needs to replace the lightning protection plate.
Fan motor running several minutes	On	On	P9/H9	Check whether the capacity setting from dial switch is accordance with actual ODU capacity, whether the capacity from spot check is accordance with actual ODU capacity. If occurs above problem, it needs to adjust the capacity setting. If above conditions are both OK, it needs to replace the main control board.

#### 4.20 PL/C7: Temperature protection of main inverter module

When the temperature of inverter module is over 80°C, it will display PL protection.

If the system display three times PL protection in 100 minutes, the system will stop and display C7 error code.

When the system displays C7 error code, the system can resume only by restarting the machine.

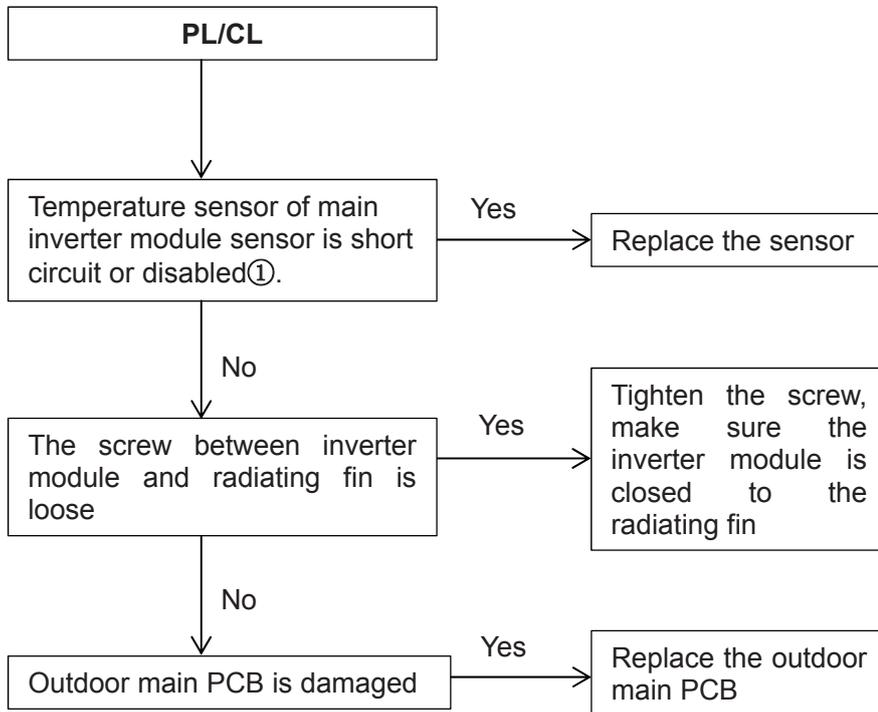

##### 1. How to check whether the temperature sensor is short circuit or disabled①:

Using a multimeter to measure resistance, if the resistance is too small, the sensor is short circuit, if the resistance in certain temperature is not consistent with attached table 2, the sensor is disabled

**Attached table 1: Resistance value of ambient temperature and pipe temperature sensor**

Temperature °C(°F)	Resistance value (kΩ)						
-20(-4)	115.266	20(68)	12.6431	60(140)	2.35774	100(212)	0.62973
-19(-2.2)	108.146	21(69.8)	12.0561	61(141.8)	2.27249	101(213.8)	0.61148
-18(-0.4)	101.517	22(71.6)	11.5	62(143.6)	2.19073	102(215.6)	0.59386
-17(1.4)	96.3423	23(73.4)	10.9731	63(145.4)	2.11241	103(217.4)	0.57683
-16(3.2)	89.5865	24(75.2)	10.4736	64(147.2)	2.03732	104(219.2)	0.56038
-15(5)	84.219	25(77)	10	65(149)	1.96532	105(221)	0.54448
-14(6.8)	79.311	26(78.8)	9.55074	66(150.8)	1.89627	106(222.8)	0.52912
-13(8.6)	74.536	27(80.6)	9.12445	67(152.6)	1.83003	107(224.6)	0.51426
-12(10.4)	70.1698	28(82.4)	8.71983	68(154.4)	1.76647	108(226.4)	0.49989
-11(12.2)	66.0898	29(84.2)	8.33566	69(156.2)	1.70547	109(228.2)	0.486
-10(14)	62.2756	30(86)	7.97078	70(158)	1.64691	110(230)	0.47256
-9(15.8)	58.7079	31(87.8)	7.62411	71(159.8)	1.59068	111(231.8)	0.45957
-8(17.6)	56.3694	32(89.6)	7.29464	72(161.6)	1.53668	112(233.6)	0.44699
-7(19.4)	52.2438	33(91.4)	6.98142	73(163.4)	1.48481	113(235.4)	0.43482
-6(21.2)	49.3161	34(93.2)	6.68355	74(165.2)	1.43498	114(237.2)	0.42304
-5(23)	46.5725	35(95)	6.40021	75(167)	1.38703	115(239)	0.41164
-4(24.8)	44	36(96.8)	6.13059	76(168.8)	1.34105	116(240.8)	0.4006
-3(26.6)	41.5878	37(98.6)	5.87359	77(170.6)	1.29078	117(242.6)	0.38991
-2(28.4)	39.8239	38(100.4)	5.62961	78(172.4)	1.25423	118(244.4)	0.37956
-1(30.2)	37.1988	39(102.2)	5.39689	79(174.2)	1.2133	119(246.2)	0.36954
0(32)	35.2024	40(104)	5.17519	80(176)	1.17393	120(248)	0.35982
1(33.8)	33.3269	41(105.8)	4.96392	81(177.8)	1.13604	121(249.8)	0.35042
2(35.6)	31.5635	42(107.6)	4.76253	82(179.6)	1.09958	122(251.6)	0.3413
3(37.4)	29.9058	43(109.4)	4.5705	83(181.4)	1.06448	123(253.4)	0.33246
4(39.2)	28.3459	44(111.2)	4.38736	84(183.2)	1.03069	124(255.2)	0.3239
5(41)	26.8778	45(113)	4.21263	85(185)	0.99815	125(257)	0.31559
6(42.8)	25.4954	46(114.8)	4.04589	86(186.8)	0.96681	126(258.8)	0.30754
7(44.6)	24.1932	47(116.6)	3.88673	87(188.6)	0.93662	127(260.6)	0.29974
8(46.4)	22.5662	48(118.4)	3.73476	88(190.4)	0.90753	128(262.4)	0.29216
9(48.2)	21.8094	49(120.2)	3.58962	89(192.2)	0.8795	129(264.2)	0.28482
10(50)	20.7184	50(122)	3.45097	90(194)	0.85248	130(266)	0.2777
11(51.8)	19.6891	51(123.8)	3.31847	91(195.8)	0.82643	131(267.8)	0.27078
12(53.6)	18.7177	52(125.6)	3.19183	92(197.6)	0.80132	132(269.6)	0.26408
13(55.4)	17.8005	53(127.4)	3.07075	93(199.4)	0.77709	133(271.4)	0.25757
14(57.2)	16.9341	54(129.2)	2.95896	94(201.2)	0.75373	134(273.2)	0.25125
15(59)	16.1156	55(131)	2.84421	95(203)	0.73119	135(275)	0.24512
16(60.8)	15.3418	56(132.8)	2.73823	96(204.8)	0.70944	136(276.8)	0.23916
17(62.6)	14.6181	57(134.6)	2.63682	97(206.6)	0.68844	137(278.6)	0.23338
18(64.4)	13.918	58(136.4)	2.53973	98(208.4)	0.66818	138(280.4)	0.22776
19(66.2)	13.2631	59(138.2)	2.44677	99(210.2)	0.64862	139(282.2)	0.22231

**Attached table 2: Resistance value of compressor discharge temperature sensor**

Temperature °C(°F)	Resistance value (kΩ)						
-20(-4)	542.7	20(68)	68.66	60(140)	13.59	100(212)	3.702
-19(-2.2)	511.9	21(69.8)	65.62	61(141.8)	13.11	101(213.8)	3.595
-18(-0.4)	483	22(71.6)	62.73	62(143.6)	12.65	102(215.6)	3.492
-17(1.4)	455.9	23(73.4)	59.98	63(145.4)	12.21	103(217.4)	3.392
-16(3.2)	430.5	24(75.2)	57.37	64(147.2)	11.79	104(219.2)	3.296
-15(5)	406.7	25(77)	54.89	65(149)	11.38	105(221)	3.203
-14(6.8)	384.3	26(78.8)	52.53	66(150.8)	10.99	106(222.8)	3.113
-13(8.6)	363.3	27(80.6)	50.28	67(152.6)	10.61	107(224.6)	3.025
-12(10.4)	343.6	28(82.4)	48.14	68(154.4)	10.25	108(226.4)	2.941
-11(12.2)	325.1	29(84.2)	46.11	69(156.2)	9.902	109(228.2)	2.86
-10(14)	307.7	30(86)	44.17	70(158)	9.569	110(230)	2.781
-9(15.8)	291.3	31(87.8)	42.33	71(159.8)	9.248	111(231.8)	2.704
-8(17.6)	275.9	32(89.6)	40.57	72(161.6)	8.94	112(233.6)	2.63
-7(19.4)	261.4	33(91.4)	38.89	73(163.4)	8.643	113(235.4)	2.559
-6(21.2)	247.8	34(93.2)	37.3	74(165.2)	8.358	114(237.2)	2.489
-5(23)	234.9	35(95)	35.78	75(167)	8.084	115(239)	2.422
-4(24.8)	222.8	36(96.8)	34.32	76(168.8)	7.82	116(240.8)	2.357
-3(26.6)	211.4	37(98.6)	32.94	77(170.6)	7.566	117(242.6)	2.294
-2(28.4)	200.7	38(100.4)	31.62	78(172.4)	7.321	118(244.4)	2.233
-1(30.2)	190.5	39(102.2)	30.36	79(174.2)	7.086	119(246.2)	2.174
0(32)	180.9	40(104)	29.15	80(176)	6.859	120(248)	2.117
1(33.8)	171.9	41(105.8)	28	81(177.8)	6.641	121(249.8)	2.061
2(35.6)	163.3	42(107.6)	26.9	82(179.6)	6.43	122(251.6)	2.007
3(37.4)	155.2	43(109.4)	25.86	83(181.4)	6.228	123(253.4)	1.955
4(39.2)	147.6	44(111.2)	24.85	84(183.2)	6.033	124(255.2)	1.905
5(41)	140.4	45(113)	23.89	85(185)	5.844	125(257)	1.856
6(42.8)	133.5	46(114.8)	22.89	86(186.8)	5.663	126(258.8)	1.808
7(44.6)	127.1	47(116.6)	22.1	87(188.6)	5.488	127(260.6)	1.762
8(46.4)	121	48(118.4)	21.26	88(190.4)	5.32	128(262.4)	1.717
9(48.2)	115.2	49(120.2)	20.46	89(192.2)	5.157	129(264.2)	1.674
10(50)	109.8	50(122)	19.69	90(194)	5	130(266)	1.632
11(51.8)	104.6	51(123.8)	18.96	91(195.8)	4.849		
12(53.6)	99.69	52(125.6)	18.26	92(197.6)	4.703		
13(55.4)	95.05	53(127.4)	17.58	93(199.4)	4.562		
14(57.2)	90.66	54(129.2)	16.94	94(201.2)	4.426		
15(59)	86.49	55(131)	16.32	95(203)	4.294	B(25/50)=3950K	
16(60.8)	82.54	56(132.8)	15.73	96(204.8)	4.167		
17(62.6)	78.79	57(134.6)	15.16	97(206.6)	4.045	R(90°C)=5KΩ+ -3%	
18(64.4)	75.24	58(136.4)	14.62	98(208.4)	3.927		
19(66.2)	71.86	59(138.2)	14.09	99(210.2)	3.812		

**Attached table 3: Commissioning and operating parameters of refrigerant system**

**Conditions 1:** Make sure outdoor unit can detect all the indoor units, the quantity of indoor units display steadily and be equal to actual quantity of installed indoor units.

**Conditions 2:** Make sure all the valves in outdoor unit are open, indoor units EXV have connected to indoor PCB.

**Conditions 3:** The ratio of connectable indoor units is 100%. When ambient temperature is high, operate the system in cooling mode and set the temperature 17°C. When ambient temperature is low, operate the system in heating mode and set the temperature 30°C. Then get the parameters after system running normally more than 30 minutes.

**Outdoor unit cooling parameters table**

Ambient temperature (T4)	°C	20-27	27-33	33-38	38-45
Discharge pressure (spot check)	MPa	2.1-2.3	2.8-3.1	3.3-3.5	3.7-3.9
Pressure of high pressure valve	MPa	1.8-2.0	2.4-2.7	2.8-3.0	3.2-3.5
Pressure of low pressure valve	MPa	0.7-0.9	0.8-1.0	1.0-1.2	1.2-1.4
Discharge temperature (spot check)	°C	50-65	70-85	70-90	80-90
DC inverter compressor current (spot check)	A	4-5	6-7	7~8	9-11
Average temperature of evaporator outlet T2B	°C	8-9	12-15	16-17	20

**Outdoor unit heating parameters table**

Ambient temperature (T4)	°C	-15--5	-5-5	5-12	12-18
Discharge pressure (spot check)	MPa	2.0-2.2	2.2-2.7	3.0-3.1	2.6-2.7
Pressure of high pressure valve	MPa	1.7-1.8	1.8-2.4	2.6-2.8	2.1-2.4
Pressure of low pressure valve	MPa	2.0-2.2	2.2-2.6	3.0-3.1	2.5-2.7
Discharge temperature (spot check)	°C	50-70	60-70	60-85	60-70
DC inverter compressor current (spot check)	A	5	5-6	6-8	5-6
Average temperature of condenser outlet T2	°C	33	33-40	46-50	39-41