

## Address Book of Branch Offices in China

<p><b>Liaoning(Dalian) Branch Office</b> Address:Room 09, F27, District B, No. 38, Ruyi Street, Sha Hehou Zone, Dalian City Tel:0411-39711299 Fax:0411-39711266 P.C.:116021 E-mail:dalian@dl-sanyo.cn</p>	<p><b>Shandong(Qingdao) Branch Office</b> Address:District C, F11, Huanhai Building, No. 2, East Sea Middle Road, Qingdao City Tel:0532-5053015 5053093 Fax:0532-5053693 P.C.:266071 E-mail:qingdao@dl-sanyo.cn</p>	<p><b>Gansu (Lanzhou) Branch Office</b> Address:Room 2202, F22, JJ Sun Hotel, No.589, Dong gang West Road, Lanzhou City. Tel:0931-8819198 Fax:0931-8819198 P.C.:830000 E-mail:lanzhou@dl-sanyo.cn</p>
<p><b>Liaoning(Shenyang) Branch Office</b> Address:District C, Floor 10, Huaxin International Tower, No. 219, Youth Street Shenyang City Tel:024-23964183 23964186 23963305 Fax:024-23964186 P.C.:110016 E-mail:shenyang@dl-sanyo.cn</p>	<p><b>Henan(Zhengzhou) Branch Office</b> Address:Room 1955, Floor 16, Weilai Building, No. 69, Weilai Road, Zhengzhou City Tel:0371-65618355 65618396 65618516 Fax:0371-65618516 P.C.:450003 E-mail:zhengzhou@dl-sanyo.cn</p>	<p><b>Xinjiang(Urumchi) Branch Office</b> Address:Room 503, Yinda Hotel, No. 39, Northwest Road, Urumchi City Tel:0991-4580503 4539888-80503 Fax:0991-4580036 P.C.:830000 E-mail:xinjiang@dl-sanyo.cn</p>
<p><b>Jilin(Changchun) Branch Office</b> Address:Room 807, Zhongjian Hotel, No. 2066, Puyang Street, Changchun City Tel:0431-5806597 5806598 Fax:0431-5806598 P.C.:130051 E-mail:changchun@dl-sanyo.cn</p>	<p><b>Jiangsu(Nanjing) Branch Office</b> Address:District C2, F26, Shangmao Century Squar, No. 49, Zhongshan South Road, Nanjing City Tel:025-86893908 86893907 Fax:025-86893908 P.C.:210005 E-mail:nanjing@dl-sanyo.cn</p>	<p><b>Chongqing Branch Office</b> Address:Room 1601, Daduhui Business Building, No. 68, Zhuzhong Road, Yuzhong District, Chongqing City Tel:023-63740752 63702848 Fax:023-63740752 P.C.:400010 E-mail:chongqing@dl-sanyo.cn</p>
<p><b>Heilongjiang(Harbin) Branch Office</b> Address:Room 907, SINOWAY Hotel, No.2, Yuyuan Street, Harbin, China Tel:0451-5366555 Fax:0451-5366557 P.C.:150001 E-mail:haerbin@dl-sanyo.cn</p>	<p><b>Jiangsu(Suzhou) Branch Office</b> Address:District C, Floor 10, Wansheng Building, No. 120, Sanxian Road, Suzhou City Tel:0512-48651831 Fax:0512-48651831 P.C.:215004 E-mail:suzhou@dl-sanyo.cn</p>	<p><b>Sichuan(Chengdu) Branch Office</b> Address:Room 318, Julong Business Building, No. 90, Babao Street, Chengdu City Tel:028-86693131 Fax:028-86693131 P.C.:610031 E-mail:chengdu@dl-sanyo.cn</p>
<p><b>Beijing Branch Office</b> Address:Room 1015, East district, Hanwei Plaza, No. 7, Guanghua Road, Chaoyang District, Beijing City Tel:010-65010369 65010370 65010366 Fax:010-65610139 P.C.:100004 E-mail:beijing@dl-sanyo.cn</p>	<p><b>Anhui(Hefei) Branch Office</b> Address:Room 2401, District B, Anhui International Business centre, No.182, Jinsai Road, Hefei City. Tel:0551-3600981 3600982 Fax:0551-3600980 P.C.:230022 E-mail:hefei@dl-sanyo.cn</p>	<p><b>Hubei(Wuhan) Branch Office</b> Address:Room 2902, Jianyan Building, No. 709, Jiasheng Road, Wuhan City Tel:027-45486898 85486858 85486818 Fax:027-85486818 P.C.:430015 E-mail:wuhan@dl-sanyo.cn</p>
<p><b>Tianjin Branch Office</b> Address:Room 3508, District A, Tianjin Yuanyang Buidng, No. 1, Yuanyang Square, Hebe District, Tianjin City Tel:022-24207170 24207171 Fax:022-24207171 P.C.:300010 E-mail:tianjin@dl-sanyo.cn</p>	<p><b>Shanghai Branch Office</b> Address:Room 708, Shanghai Qingsongcheng Hotel, No. 777, Zhaoliang Road, Shanghai City Tel:021-64431287 64438939 Fax:021-64430776 P.C.:200032 E-mail:shanghai@dl-sanyo.cn</p>	<p><b>Hunan(Changsha) Branch Office</b> Address:District E, F7, Yada Epoch Building, No. 68, Wuyi Road, Changsha City Tel:0731-4565331 4585631 Fax:0731-4565931 P.C.:410011 E-mail:changsha@dl-sanyo.cn</p>
<p><b>Hebei(Shijiazhuang) Branch Office</b> Address:Room 2006, Yanguang Building, No. 35, Ping an South Street, Shijiazhuang City Tel:0311-8625083 8625762 Fax:0311-8625083 P.C.:050011 E-mail:shijiazhuang@dl-sanyo.cn</p>	<p><b>Zhejiang(Hangzhou) Branch Office</b> Address:District B, F7, Tianhong Hotel, No. 333, Meganshan Road, Hangzhou City Tel:0571-89803060 8980303 89803062 Fax:0571-88803062 P.C.:310005 E-mail:hangzhou@dl-sanyo.cn</p>	<p><b>Jiangxi(Nanchang) Branch Office</b> Address:Room 1304, International Trade Squar, No. 6, Hong Cheng Road, Nanchang City Tel:0791-6496732 6496730 Fax:0791-6496730 P.C.:330002 E-mail:nanchang@dl-sanyo.cn</p>
<p><b>Hebei(On Huangdao) Branch Office</b> Address:Room 704, F10, Changfeng Mansions, No. 5 Building, Sun City, Seaport Zone, On Huangdao City. Tel:0531-4033110 8212101 Fax:0531-4033110 P.C.:030002 E-mail:taiyuan@dl-sanyo.cn</p>	<p><b>Zhejiang(Ningbo) Branch Office</b> Address:Room 2317, Century Squar, No. 118, Dalian Street, Haishu District, Ningbo City Tel:0574-87307167 Fax:0574-87307167 P.C.:315000 E-mail:ningbo@dl-sanyo.cn</p>	<p><b>Guizhou (Guiyang) Branch Office</b> Address:Room 1508, Guaxiang Hotel, No.150, Ruijin North Road, Guiyang City. Tel:0851-8665311 Fax:0851-8665311 P.C.:330002 E-mail:guiyang@dl-sanyo.cn</p>
<p><b>Shanxi(Taiyuan) Branch Office</b> Address:Room 601, Shanxi Dongmin Business Building, No. 86, Luxiangnan Road, Taiyuan City Tel:0351-4033110 8212101 Fax:0351-4033110 P.C.:030002 E-mail:taiyuan@dl-sanyo.cn</p>	<p><b>Shandong(Jinan) Branch Office</b> Address:Room 1918, Huaneng Building, No. 17, Quansheng Road, Jinan City Tel:0531-6080258 6080159 6080258 Fax:0531-6080258 P.C.:250011 E-mail:jinan@dl-sanyo.cn</p>	<p><b>Guangdong(Guangzhou) Branch Office</b> Address:Room 1621, Sanyu Hotel, No. 23, Nonglin Xia Road, Dongshan District, Guangzhou City Tel:020-87618510 8756888-1621 Fax:020-87618510 P.C.:510006 E-mail:guangzhou@dl-sanyo.cn</p>
<p><b>Shanxi(Xian) Branch Office</b> Address:Room E, F16, District A, International Olympic Center Squar, No. 14, Chang an North Road, Xian City Tel:029-85590281 85590282 Fax:029-85590282 P.C.:710061 E-mail:xian-sanyo@163.com</p>		

Headquarters: No.118, Huaihe West Road, Dalian Economic & Technology Development Zone, China  
Tel: 0086-411-87307139 87310357 87311883 87308779 87300892  
Fax: 0086-411-87316276 P.C.:116600

The data will be modified without notice for technique improvement.

<http://www.dl-sanyo.com>

E-mail: sales@dl-sanyo.cn (domestic sale)

world@dl-sanyo.cn (export sales)

No.1210A2BGHE01

# Panasonic

## DG-H Series

## G series direct-fired LiBr absorption chiller/heater



China • Dalian Sanyo Refrigeration Co.,Ltd.

# Sanyo LiBr absorption chiller/heater DG-H series

## Business scope:

Designs, productions, manufactures, sales, installations, and after-sale services for chillers featuring environmental protection and energy-integrated utilization, for air-conditioning machinery, and for related environmental protection machinery, etc.

## Product kinds:

- Central air-conditioning equipment: absorption chiller/heater — sole refrigeration or refrigeration and heating (70~23256kW), Steam-fired, direct-fired, hot water-fired, modular type, packaged type, heat pump type, etc.  
Electric refrigeration screw chiller — air conditioning refrigeration and ice storage (281~2461kW).
- Commercial air-conditioning equipment: GHP gas heat pump and chiller unit — refrigeration and heating (10HP-60HP).  
VRF variable refrigerant flow unit — refrigeration and heating (8HP-60HP).
- Heating equipment: vacuum boiler — heating and hot water supplying (80,000~6,000,000kcal/h).

## Application:

- Central air-conditioning equipment: mainly provide heating and cooling source for large scale central air conditioning system and other places needing chilled or hot water, widely applied in building, hotel, department store, cinema, stadium, factory and oil field, etc.
- Commercial air-conditioning equipment: widely applied in places needing air conditioning equipments, such as small and middle scale department store, hotel, building, entertainment place, hospital, factory, dormitory, residence, school, etc.
- Heating equipment: widely applied in hotel, department store, residence, villa, bath house, advanced swimming pool, etc., where needing heating and hot water, used with absorption chiller, it will be ideal for cooling, heating and hot water supplying.



## Dalian Sanyo G Series Enhancement Model Energy saving nonesuch · Safe guarantee

### Advantages

#### ★ Brand advantage

International well-known brand, create the new epoch that China LiBr absorption chiller technology develop.

#### ★ Technology advantage

It is the accumulation that Japan Sanyo's technology, design, manufacturing and quality in the past 50 years.

#### ★ Quality advantage

The unique enterprise in the industry that have the honor to get "National Quality Management Surpassing Enterprise" award, which is the approval of quality management and the guarantee of high quality for Sanyo products, and only have nine enterprises to get this honor in China.

#### ★ Service advantage

Super express after-sales service mode. Preventive service instead of previous emergency service.



Absorption chiller/heater flow diagram .....	P2
Energy saving technology new nonesuch .....	P3
Safe and reliable running mode .....	P4
Unique H.T. Generator design ·	
High precision intelligent control .....	P5
Specification .....	P6
Order scope .....	P8
Supply scope .....	P9
Overall dimension · Base diagram .....	P10
Heat/cooling insulation area .....	P17
Moving dimension .....	P18
Combustion system scheme .....	P19
Control panel .....	P20
Accessory equipment electric circuit essential .....	P21
Electric wiring diagram .....	P22
Piping system diagram .....	P23
Cooling water management essential .....	P24
Note before order .....	P25

### Characteristics


- High efficiency & Energy saving
- Run economy
- Environment friendly
- Safe and reliable
- Intelligent design
- Network management



ISO9001 Quality Control System Certificate ISO14001 Environment Control System Certificate GB/T28001 Occupation Health Safety Certificate	CRAA Certificate	ASME Certificate	UL Certificate	CE Certificate	JIS B 8622 Technical Standard	PED Certificate
JIS B 8622-2002 Technical Standard	China Mechanical Safety Certificate	China Environment Mark	National new hi-tech corporation	Core member of China Coalitions for Decentralized Energy	National quality management surpassing enterprise	National customer satisfactory product
					Postdoctoral scientific effort station	Energy-saving products in government procurement list

**Strong Technology and Quality Guarantee**

## Cooling operation

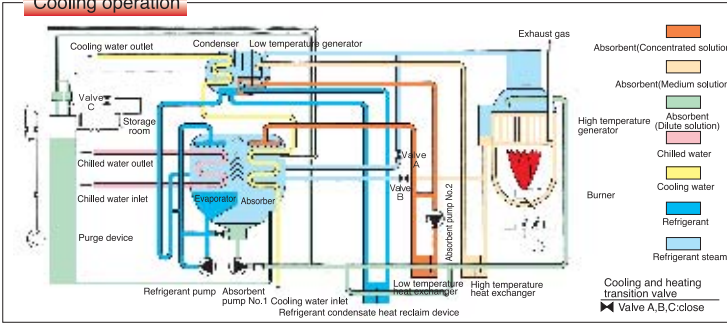


Our G series direct-fired LiBr absorption chiller/heater is made of evaporator, absorber, condenser, low temperature generator, high temperature generator, refrigerant condensate heat reclaim device heat exchanger, solution pump and refrigerant pump etc.

Principle of operation: chilled water is cooled in evaporator by low temperature refrigerant which has been decompressed and throttled from condenser, and the refrigerant is turned into vapour after absorbing the heat of chilled water, then is absorbed into absorber where the concentrated solution is turned into dilute solution.

The dilute solution in the absorber is pumped through refrigerant condensate heat reclaim device, low temperature heat exchanger, high temperature heat exchanger where the solution temperature goes up, to the high temperature generator at last, where the dilute solution is heated and condensed into medium solution.

The medium solution flows through high temperature heat exchanger, into low temperature generator where the medium solution is heated by the refrigerant vapour which from high temperature generator and turned into final concentrated solution. The concentrated solution flows through low temperature heat exchanger where the temperature goes down, then into the absorber and is sprayed on the cooling water tubes where it absorbs the refrigerant vapour from evaporator and is turned into dilute solution. On the other hand, the vapour in the high temperature generator produced by heating lithium-bromide solution, floats into low temperature generator where it heats the medium solution and itself is coagulated into refrigerant through the refrigerant condensate heat reclaim device where the temperature goes down. Then the refrigerant floats into condenser with refrigerant vapour from low temperature generator and is cooled into refrigerant after being decompressed and throttled in the condenser. After that, the refrigerant flows into evaporator where it is sprayed on the condensed coils, cool the chilled water in the evaporator. Above process circles again and again for producing chilled water continuously.

## Heating operation

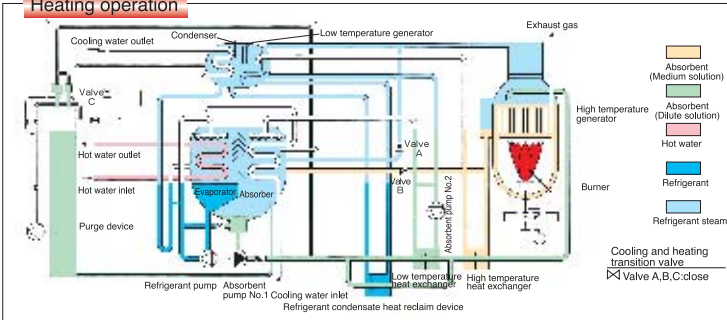

Diluted absorbent is reheated in high temperature generator and becomes refrigerant vapour. Refrigerant vapour goes to evaporator and absorber and exchange heat in evaporator to get hot water. And, medium absorbent goes into absorber and mixes with refrigerant and is diluted. Then it passes refrigerant condensate heat reclaim device, low, high temperature heat exchanger and goes back to high temperature generator.

Above process circles again and again for producing hot water continuously.

Inside of the upper shell is installed the vacuum thermal insulating layer to decrease inside loss

Adopt new style high efficient heat exchange tube


Evaporator: Enlarge heat exchange area, strengthen heat exchange effect, and increase the heat efficiency by 10%



Absorber: Strengthen the external absorbing of pipe and increase turbulent disturbance in the pipe to prevent scaling.



Adopt new style patent refrigerant condensate heat reclaim device




- Fully utilize the heat quantity of refrigerant condensate to increase the heat efficiency by 10% and decrease the heat load of cooling water.
- Increase the dilute solution temperature of the low temperature heat exchanger outlet to make solution circuit far from crystal area, so make sure the machine operation is more safe and reliable.

Adopt new style high efficient heat exchanger


- Low temperature heat exchanger adopts plate-type heat exchanger to increase the heat efficiency of the machine.
- High temperature heat exchanger adopts new style multipaths heat exchanger to increase the heat exchange greatly.

H.T. generator cold-state regeneration technology. Temperature is low and heat exchange efficiency is high

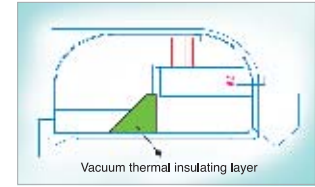


Internal refrigerant self-adapting cold storage device

- Adapt change in load and supply the refrigerant of evaporator automatically.
- "Cold storage", save energy running farthest.
- Shorten the starting time of machine.
- Shorten the duration running time.
- Adapt the more lower cooling water inlet temperature.
- Prevent "cavitation" of the refrigerant pump to prolong the pump operating life.

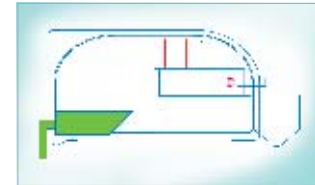


Design tailored for partial load, the machine realizing high efficient energy saving operation


Suits low load operation of 40-80%, adopts new frequency conversion control system, internal refrigerant self-adjusting cooling storage device, quick heat state balance circulation technology, obviously saves partial load and start time energy consumption, Integrated Partial Load Value (IPLV) rises greatly.

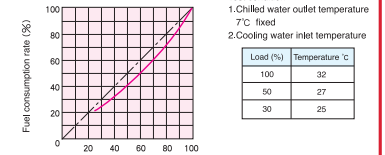

## Multi crystallization prevention safety control




Micro-computer monitors and calculates the solution concentration automatically to make the solution circuit far from crystal area, and adjust solution flowrate and fuel volume automatically to prevent crystallization completely. High temperature generator cold-state regenerator technology, Temperature is low and running is safe. Adopt new style patent refrigerant condensate heat reclaim device to increase the dilute solution temperature of the low temperature heat exchanger to make solution circuit far from crystal area, so make sure the machine operation is more safe and reliable.

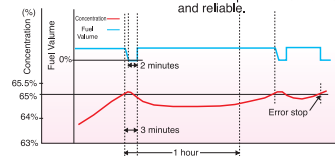


## Overall anti-corrosion safety design

- Adopt Sanyo patent LiBr solution
- Adopt lithium molybdate as inhibitor

Lithium molybdate inhibitor is safe and no harm to environment, and form protection film on the surface of copper tube and steel plate and not easily resolved even in high temperature condition.

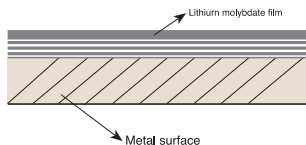


- Material processing use Sanyo patent Pachuca technology Remove the grease and rusty spot of material surface completely to form compact and uniform safety film through eighteen different procedure.




## New bow wave spray Ag-Pd automatic purge device

### Five vacuum keeping design

- Bow wave type spiral spray nozzle.
- New patented upper/down shell fractional pressure gas/steam separator, utilizing lowering pressure de-air technology.
- Ag-Pd tube automatic exhaust.
- Storage room lowering-pressure to enlarge capacity design.
- Upper/down shell two purge system.



Spray nozzle structure



Ag-Pd tube working principle


## H.T.Generator adopts more capacity splitter design to prevent refrigerant pollution

## Cooling water safe operation scope is more extensive

Micro-computer monitors the cooling water temperature to adjust the fuel consumption and solution circulation automatically, which make the cooling water operate even in the temperature range of 15~34°C.


## Cross limit exhaust temperature design

Chiller's exhaust lowers to combine operation cost and life of machine and system in a best way.

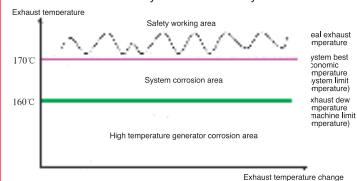


## Adopt special structure to lower exhaust temperature

- Adopt new combustion mode to raise heat exchange affect and lower NOx exhaust.
- Tailored burner design, modulation and self-diagnosis function.
- Adopts shaped flat smoke tube which makes heat exchange area two times larger than conventi

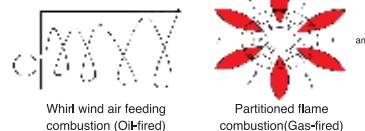

- Adopt new uneven spacing spoiler to enhance exhaust vibration and heat exchange



## Unique high temperature generator process, safe and reliable operation


- Use negative pressure fixing resistant steel to prevent high temperature generator sinking down.
- Smoke tube is treated by Parca process to resist corrosion.
- Smoke tube is welded from both sides to prevent effectively electric-chemical corrosion.

## New speed type PID control, accuracy much higher


Replace the original position-type PID control to make the accuracy much more higher and can be quick responsive to sudden load change.

## Self-diagnosis professional function on the machine


### ① Cooling water system heat transfer tube fouling state

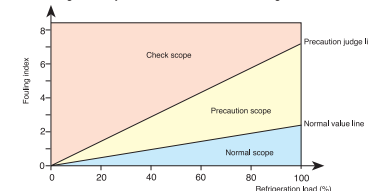

### ② Absorbent concentration up trend

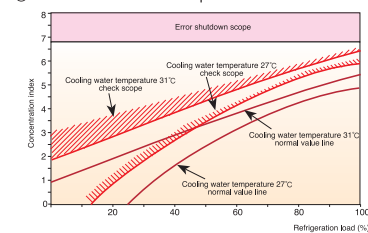

### ③ Vacuum state time monitor

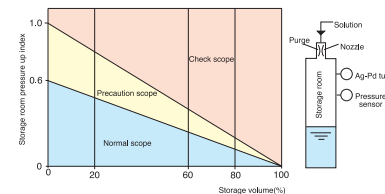

### ④ Sweeping signal of combustion room

According to exhaust temperature of combustion room, precast whether there is necessary to sweep burning system of high temperature generator.

## Intelligent micro-computer control system

Adopt Japan Sanyo patent micro-computer intelligent control system, which broke through the traditional control system. Sanyo is the first enterprise that introduces the fuzzy control and expert control technology to the LiBr absorption central air-conditioning control system, which include many intelligent softwares, such as automatic load regulator, self-diagnosis, maintenance precognition, expert save energy software, etc.

# Specification

Model		DG-E11H	DG-E12H	DG-E13H	DG-E14H	DG-E21H	DG-E22H	DG-E23H	DG-E24H	DG-E31H				
Refrigeration capacity	USRT	100	120	150	180	210	240	280	320	360				
	kW	352	422	527	633	738	844	985	1,125	1,266				
Heating capacity		kW	294	353	441	530	618	706	824	941	1,059			
Chilled water system	Inlet/Outlet temperature: °C		12→7											
	Flow rate	m³/h	60.5	72.6	90.7	109	127	145	169	194	218			
	Pressure drop	mH <sub>2</sub> O	8.5	8.7	11.1	11.6	10.4	11.0	7.4	7.9	8.4			
	Inlet/outlet connection		A	100	100	100	100	125	125	150	150			
Hot water system	Inlet/Outlet temperature: °C		55.8→60											
	Flow rate	m³/h	60.5	72.6	90.7	109	127	145	169	194	218			
	Pressure drop	mH <sub>2</sub> O	8.5	8.7	11.1	11.6	10.4	11.0	7.4	7.9	8.4			
	Inlet/outlet connection		A	100	100	100	100	125	125	150	150			
Cooling water system	Inlet/Outlet temperature: °C		32→37.5 (Gas)				32→37.6 (Oil)							
	Flow rate	m³/h	93.5	112	140	168	196	224	262	299	337			
	Pressure drop	mH <sub>2</sub> O	4.2	4.7	6.5	7.5	5.7	6.3	11.5	12.4	9.5			
	Inlet/outlet connection		A	125	125	125	150	150	200	200	200			
Power 3φ, 380V, 50Hz	Total electric current		Oil	A	14.7	14.7	20.3	20.3	20.4	21.8	24.7	27.6	27.6	
			Gas	A	12.4	12.4	15.7	15.7	17.3	17.3	20.2	21.5	21.5	
	Wire area		Oil	mm²	3.5	3.5	5.5	5.5	5.5	5.5	5.5	5.5	5.5	
			Gas	mm²	3.5	3.5	3.5	3.5	3.5	3.5	5.5	5.5	5.5	
	Power consumption		Oil	kVA	11.7	11.7	16.3	16.3	16.4	17.5	19.9	22.3	22.3	
			Gas	kVA	9.8	9.8	12.5	12.5	13.8	13.8	16.2	17.2	17.2	
Motor	No.1 absorbent pump		kW(A)	1.3(3.5)	1.3(3.5)	2.5(6.8)	2.5(6.8)	2.5(6.8)	2.5(6.8)	3.4(9.1)	3.4(9.1)	3.4(9.1)		
	No.2 absorbent pump		kW(A)	1.1(3.9)	1.1(3.9)	1.1(3.9)	1.1(3.9)	1.3(4)	1.3(4)	1.3(4)	1.3(4)	1.3(4)		
	Refrigerant pump		kW(A)	0.2(1.3)	0.2(1.3)	0.2(1.3)	0.2(1.3)	0.2(1.3)	0.2(1.3)	0.4(1.8)	0.4(1.8)	0.4(1.8)		
	Purge pump		kW(A)	0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)		
	Blower		Oil	kW(A)	0.75(1.7)	0.75(1.7)	1.5(3.3)	1.5(3.3)	2.2(4.7)	2.2(4.7)	3.7(7.6)	3.7(7.6)		
			Gas	kW(A)	0.75(1.7)	0.75(1.7)	1.5(3.2)	1.5(3.2)	1.5(3.2)	2.2(4.5)	2.2(4.5)			
	Oil pump (oil)		kW(A)	*****	*****	*****	*****	*****	*****	*****	*****	*****		
	Oil preheater (oil)		kW(A)	1.5(2.3)	1.5(2.3)	2.0(3.0)	2.0(3.0)	2.0(3.0)	2.0(3.0)	2.0(3.0)	2.0(3.0)	2.0(3.0)		
	Length		mm	2,670	2,670	3,690	3,690	3,710	3,710	4,760	4,760	4,830		
	Width		mm	1,810	1,810	1,910	1,910	2,070	2,070	2,090	2,090	2,280		
Height		mm	1,960	1,960	1,960	1,960	2,160	2,160	2,160	2,160	2,390			
Overall dimension		Operation weight	ton	5.1	5.4	6.5	7.0	8.2	8.7	10.0	10.6	13.1		
		Max. moving weight	ton	4.7	5.0	6.0	6.4	7.5	7.9	9.1	9.6	11.9		
		Total weight	ton	4.7	5.0	6.0	6.4	7.5	7.9	9.1	9.6	11.9		
		Moving state												
		One-section												
Fuel		Consumption	Refrigeration	Light oil	kg/h	23.3	27.9	34.9	41.9	48.9	55.8	65.2	74.5	83.8
				City gas	Nm³/h	60.2	72.4	90.3	108.6	126.5	144.7	168.9	192.8	217.1
				Natural gas	Nm³/h	20.8	25.0	31.2	37.5	43.7	50.0	58.3	66.6	75.0
		Heating	Light oil	kg/h	26.0	31.2	38.9	46.7	54.5	62.3	72.7	83.1	93.5	
				City gas	Nm³/h	70.9	85.4	106.5	127.9	149.1	170.5	198.9	227.2	255.9
				Natural gas	Nm³/h	24.5	29.5	36.8	44.2	51.5	58.9	68.7	78.5	88.4
Fuel connection size		Oil	A	15 × 2	15 × 2	15 × 2	15 × 2	15 × 2	15 × 2	15 × 2	20 × 2	20 × 2		
			Gas	A	50	50	50	50	50	50	80	80	80	
Flue connection		mm	280 × 210	280 × 210	280 × 210	280 × 210	310 × 310	310 × 310	310 × 310	310 × 310	360 × 310			
Clearance		mm	2,400	2,400	3,400	3,400	3,400	3,400	4,500	4,500	4,500			

Note: (1) 1 USRT=3,024kcal/h=3.52kW

- Max. working pressure for chilled/hot water and cooling water system: 8kg/cm<sup>2</sup> · G. High pressure model is available, dimension and foundation may be changed, so please enquire with the manufacturer.
- Range of chilled/hot/cooling water flow: 50 ~ 120%.
- The burner parameter listed in the table vary with the burner model. For the detail parameter, please see the ex-works file.
- The burner will affect the overall dimension of the chiller/heater. For the actual overall dimension, please refer to the ex-works file.
- The heat values in the table are low heat values: light oil 43,53MJ/kg, city gas 46,05MJ/Nm<sup>3</sup>

The consumption of fuel of heat values not specified in the table =  $\frac{\text{low heat value specified in the table}}{\text{low heat value of the fuel}} \times \text{consumption in the table.}$

# Specification

DG-E32H	DG-E41H	DG-E42H	DG-E51H	DG-E52H	DG-E53H	DG-E61H	DG-E62H	DG-E63H	DG-E71H	DG-E72H	DG-E73H	DG-E81H	DG-E82H
400	450	500	560	630	700	800	900	1,000	1,100	1,200	1,300	1,400	1,500
1,407	1,582	1,758	1,969	2,215	2,461	2,813	3,165	3,516	3,868	4,220	4,571	4,923	5,274
1,177	1,324	1,471	1,647	1,853	2,059	2,353	2,648	2,942	3,236	3,530	3,824	4,119	4,413
12→7													
242	272	302	339	381	423	484	544	605	665	726	786	847	907
8.8	8.1	7.1	6.2	8.4	11.0	7.7	10.3	13.5	9.1	11.5	14.2	11.5	14.0
150	200	200	200	200	200	250	250	250	300	300	300	350	350
55.8→60													
242	272	302	339	381	423	484	544	605	665	726	786	847	907
8.8	8.1	7.1	6.2	8.4	11.0	7.7	10.3	13.5	9.1	11.5	14.2	11.5	14.0
150	200	200	200	200	200	250	250	250	300	300	300	350	350
32→37.5 (Gas) 32→37.6 (Oil)													
374	421	468	524	589	655	748	842	935	1,029	1,122	1,216	1,309	1,403
10.1	10.7	11.1	8.3	11.1	14.5	10.0	13.3	17.3	10.9	13.8	17.0	14.3	17.2
200	250	250	300	300	300	350	350	350	400	400	400	400	400
29.2	30.6	32.3	43.9	43.9	43.9	50.3	54.3	60.6	71.2	84.6	84.6	97.1	97.1
21.5	22.9	25.7	31.8	31.8	35.3	36.3	43.8	43.8	61.6	61.6	61.6	69.5	69.5
5.5	8.0	6.0	14	14	14	14	14	22	22	38	38	38	38
5.5	5.5	5.5	8	8	8	8	14	14	22	22	22	22	22
23.6	24.7	26.1	35.6	35.6	35.6	40.9	44.1	49.3	58.0	69.0	69.0	79.3	79.3
17.2	18.4	20.7	25.6	25.6	28.5	29.3	35.5	35.5	50.1	50.1	50.1	56.6	56.6
3.4(9.1)	3.4(9.1)	3.4(9.1)	3.7(15.0)	3.7(15.0)	3.7(15.0)	5.5(15.0)	5.5(19.0)	5.5(19.0)	7.5(23.0)	7.5(23.0)	7.5(23.0)	7.5(23.0)	7.5(23.0)
1.3(4)	1.8(5.4)	1.8(5.4)	1.8(5.4)	1.8(5.4)	1.8(5.4)	1.8(6.4)	1.8(6.4)	1.8(6.4)	3.7(12.0)	3.7(12.0)	3.7(12.0)	3.7(12.0)	3.7(12.0)
0.4(1.8)	0.4(1.8)	0.4(1.8)	0.4(1.8)	0.4(1.8)	0.4(1.8)	0.4(1.8)	0.4(1.8)	0.4(1.8)	0.4(1.8)	0.4(1.8)	0.4(1.8)	0.4(1.8)	0.4(1.8)
0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)	0.4(1.1)
3.7(7.6)	3.7(7.6)	3.7(7.6)	5.5(11.6)	5.5(11.6)	5.5(11.6)	7.5(15.3)	7.5(15.3)	11.0(21.6)	11.0(21.6)	15.0(29.0)	15.0(29.0)	22.0(40.0)	22.0(40.0)
2.2(4.5)	2.2(4.5)	3.7(7.3)	3.7(7.3)	3.7(7.3)	5.5(10.8)	5.5(10.8)	7.5(14.3)	7.5(14.3)	11.0(21.5)	11.0(21.5)	11.0(21.5)	15.0(29.4)	15.0(29.4)
*****	*****	0.75(1.7)	0.75(1.7)	0.75(1.7)	0.75(1.7)	0.75(1.9)	0.75(1.9)	0.75(1.9)	1.5(3.3)	1.5(3.3)	1.5(3.3)	1.5(3.3)	1.5(3.3)
3.0(4.6)	3.0(4.6)	3.0(4.6)	4.0(6.1)	4.0(6.1)	4.0(6.1)	5.0(7.6)	5.0(7.6)	5.0(7.6)	8.0(12.2)	8.0(12.2)	9.0(13.7)	9.0(13.7)	9.0(13.7)
4.830	4.850	4.850	5,040	5,590	6,080	5,690	6,190	6,710	6,430	6,960	7,460	6,960	7,460
2,280	2,490	2,490	2,990	2,990	2,990	3,240	3,240	3,240	4,100	4,100	4,100	4,450	4,450
2,390	2,600	2,600	2,900	2,900	2,900	3,330	3,330	3,330	3,450	3,450	3,450	3,650	3,650
13.8	16.3	17.1	22.5	24.3	26.0	32.6	35.1	37.8	45.4	48.8	51.8	56.5	59.5
12.5	14.7	15.4	19.8	21.4	23.0	15.8	16.8	18.0	21.5	23.0	24.3	26.0	27.5
12.5	14.7	15.4	19.8	21.4	23.0	28.8	31.1	33.5	40.3	43.3	46.1	50.1	52.7
One-section													
Moving separately													
93.1	104.7	116.3	130.3	146.6	162.9	186.2	209.4	232.7	256.0	279.2	302.5	325.8	349.0
241.1	271.2	301.3	337.5	379.8	422.1	482.3	542.5	603.6	663.2	723.4	783.9	844.1	904.3
83.3	93.7	104.1	116.6	131.2	145.8	166.6	187.4	208.3	229.1	249.9	270.8	291.6	312.4
103.9	116.8	129.8	145.4	163.6	181.7	207.7	233.7	259.6	285.6	311.6	337.5	363.5	389.4
284.2	319.9	355.2	398.0	447.5	497.3	568.5	639.4	710.7	781.6	852.8	923.7	994.6	1,065.8
98.2	110.5	122.7	137.5	154.6	171.8	196.4	220.9	245.5	270.0	294.6	319.1	343.6	368.2
20 × 2	20 × 2	20 × 2	25 × 2	25 × 2	25 × 2	25 × 2	25 × 2	25 × 2	25 × 2	25 × 2	32 × 2	32 × 2	32 × 2
80	80	80</											

## Order scope

Item		Standard specification	Option
Chilled water System	Flow rate	0,805m <sup>3</sup> /h · RT (Δt=5°C constant quantity)	Range of variable flow: 50 ~ 120%
	Temperature	12 / 7°C	Special inlet/outlet temperature of chilled water
	Water quality	Tap water (according to JRA9001)	Industrial water, well water
	Max. working pressure	8kg/cm <sup>2</sup> · G	Pressure1--10kg/cm <sup>2</sup> · G Pressure2--14kg/cm <sup>2</sup> · G Pressure3--16kg/cm <sup>2</sup> · G Pressure4--18kg/cm <sup>2</sup> · G Pressure5--20kg/cm <sup>2</sup> · G
Cooling water system	Flow rate	For the detail information, please see the specification table.	Range of variable flow: 50 ~ 120%
	Temperature	32/37,5°C(Lower temperature limit: 15°C)	Inlet temperature:15~34°C
	Water quality	Tap water (according to JRA9001)	Industrial water, well water
	Max. working pressure	8kg/cm <sup>2</sup> · G	Pressure1--10kg/cm <sup>2</sup> · G Pressure2--14kg/cm <sup>2</sup> · G Pressure3--16kg/cm <sup>2</sup> · G Pressure4--18kg/cm <sup>2</sup> · G Pressure5--20kg/cm <sup>2</sup> · G
Hot water system	Flow rate	0,805m <sup>3</sup> /h · RT (Δt=42°C constant quantity)	Range of variable flow: 50 ~ 120%
	Temperature	55,8/60°C (40~65°C)	Outlet temperature above 60°C, please enquire with the manufacturer.
	Water quality	Tap water (according to JRA9001)	
	Max. working pressure	8kg/cm <sup>2</sup> · G	Pressure1--10kg/cm <sup>2</sup> · G Pressure2--14kg/cm <sup>2</sup> · G Pressure3--16kg/cm <sup>2</sup> · G Pressure4--18kg/cm <sup>2</sup> · G Pressure5--20kg/cm <sup>2</sup> · G
Installation place	Place	In machine room	
	Installation	Body anti-rusting paint (exclusive of heat or cooling insulation,final paint),	Storage of equipment shall be in accordance with the standard,details refer to factory documents.
	Ambient Temperature	5 ~ 40°C	
	Ambient Humidity	Relative humidity: below 90%	
Package	DG-E11H-E53H	One-section	
	DG-E61H-E82H	Moving separately	
Power	Frequency, Voltage	3ø / 380V / 50Hz	Special voltage
	Voltage regulation	Within ± 10%	
Electric wiring	Electric allocation	Control: cable	
		Power: cable	
Main body safety device	Type	· Refrigerant supervision function · Chilled water freezing protection function · H.T. generator temperature supervision function · H.T. generator pressure supervision function · Exhaust temperature supervision function · H.T. generator solution level supervision function · Motor protection function · Extreme low temperature of cooling water · Chilled/hot water flow switch · Crystal protection function	Cooling water flow switch
		Mode	Digital PID control by chilled/hot water inlet temperature Inverter control of No.1 absorbent pump
Capacity control device	Paint color	Munsell SY-7/1 (half smooth)	
	Display	LCD Chinese display	
Control panel	Outside wiring terminals	Operation indication ..... point a, Stop indication ..... point a, Alarm indication ..... point a, Auxiliary equipment operation ..... point a, Start confirmation ..... point a, Burn confirmation ..... point a, Cooling operation indication ..... point a, Heating operation indication ..... point a,	
		Mode	Liquid injector make non-condensable gas be stored in the slot and palladium pipe exhaust continuously hydrogen
Purge device	Mode	Liquid injector make non-condensable gas be stored in the slot and palladium pipe exhaust continuously hydrogen	Fully automatic purge
Burning device	Safety stop valve	Full automatically double stop	
	Fuel scope	Gas: 25%~100% Oil: 90%~100%	
Fuel	Oil	Light oil	
		City gas	Low pressure: 100~200mmH <sub>2</sub> O DG-E11GH-E22GH Intermediate pressure: 500~2000mmH <sub>2</sub> O DG-E11GH-E42GH Middle pressure: 1~3kg/cm <sup>2</sup> · G DG-E11GH-E82GH
		Natural gas	Low pressure: 200mmH <sub>2</sub> O DG-E11GH-E42GH Intermediate pressure: 500~2000mmH <sub>2</sub> O DG-E11GH-E82GH Middle pressure: 1~3kg/cm <sup>2</sup> · G DG-E11GH-E82GH
	Customer support	Please provide heat value, pressure, specific gravity, component, ect. of gas when placing order,	
Water system	Frequency conversion		Frequency controller

## Supply scope

Item		Deliver construction	Customer construction	Note
Body	Absorption Chiller/Heater	○		Reference to the caption below the chart
	From the factory to the building		○	
Transportation and Installation	From the building to the foundation site		○	
	Installation of chiller/heater		○	
	Testing and adjusting at site	●	○	
	Operating direction	○		
Electric Construction	External electric allocation		○	Please wire to the terminal inside the control panel
	Cooling water temperature control device		○	Please install and wire for the thermostat used by start-stop fan of cooling tower or for the thermostat of cooling water control valve.
Other Construction	Foundation construction		○	Exclusive of foundation bolts, weld the frame and washer when fixing foundation bolts.
	External pipe construction		○	Exclusive of coordinate flanges
	Pipe anti-freezing	○		Take anti-freezing of pipe and water into consideration at rest in winter
	Water quality management of cooling water		○	Install water drainage device in order to have a proper water quality management
	Heat or cooling insulation construction		○	
Painting	Main body primary coat	○		Anti-rusting primary coat
	Control panel painting	○		Munsell No.5Y-7/1(half-smooth)
Others	Assembly power,water, etc. at site		○	
	Power, water and fuel, etc. used during trial run		○	
	Lithium-Bromide solution,refrigerant	○		


### Absorption chiller/heater main body includes

- Absorption chiller/heater:
    - Machine of refrigeration and heating cycle including evaporator, absorber, high temperature generator, low temperature generator, condenser, refrigerant condensate heat reclaim device, heat exchanger, and pump, etc.
    - Purge device
    - Capacity control device
    - Combustion equipment including burner, air blower and safety-burning device, etc.
    - Safety device
    - Control panel
    - Absorbent and refrigerant
    - Internal piping and electric wiring
  - Accessory
    - Foundation bolts and washers.....1 set
    - Instruction manual.....1 set
- Extra charge should be calculated separately if required.



# Overall dimension diagram Base diagram


- Overall dimension diagram
- Note: 1. Overall dimension value (L),(W),(H) is example.
- 2. Mark  $\odot$  denotes the position of foundation bolts of chiller/heater.
- 3. Clearance space must be saved for either side of the chiller/heater.
- 4. Mark  $\uparrow$  is the power wire hole.
- 5. Maintenance space must be saved around the chiller/heater.  
Length direction -----1m  
Above -----0.2m  
Control panel direction -----1.2m  
Others -----0.5m
- 6. "A" stands for nominal diameter, unit is mm.




- Base diagram
- Note: 1. There are 450 holes under the chiller/heater for foundation bolts.
- 2. When fastening foundation bolts, please weld base and washer together with reference to left diagram.
- 3. Please make a drainage ditch around the chiller/heater.
- 4. Please make the ground water proof in order to maintain the chiller/heater.
- 5. The base must be smooth and horizontal(The levelness should be below 2mm for 1,000mm).

DG-E11-E31H	80	260
DG-E32-E52H	80	340
DG-E53-E82H	90	440

## DG-E31H/E32H \*In ( ) is Model E32H

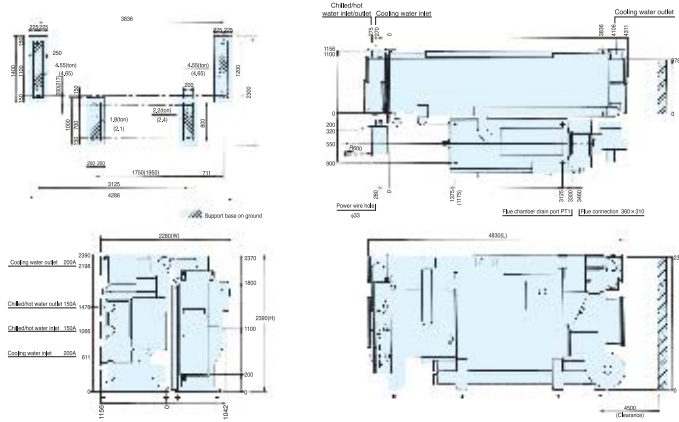


## DG-E41H/E42H \*In ( ) is Model E42H

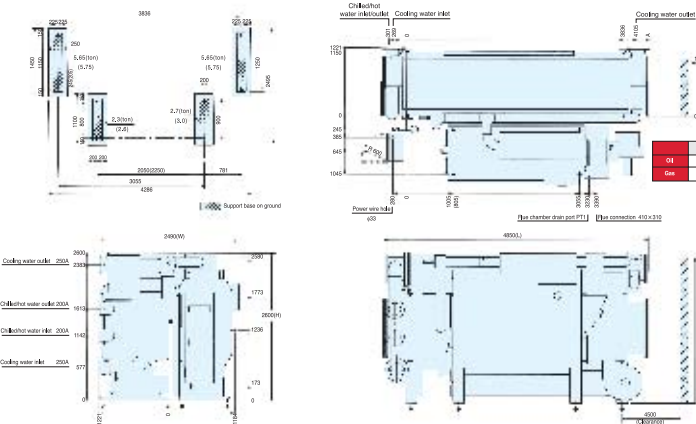


## DG-E51H/E52H/E53H


	A	B	C	D	E	F	G	L
DG-E51H	3130	3305	3511	3836	3966	4206	6600	5040
DG-E52H	3330	3605	3711	4378	4508	4748	8200	5590
DG-E53H	3530	3785	3911	4876	5006	5246	8700	6080

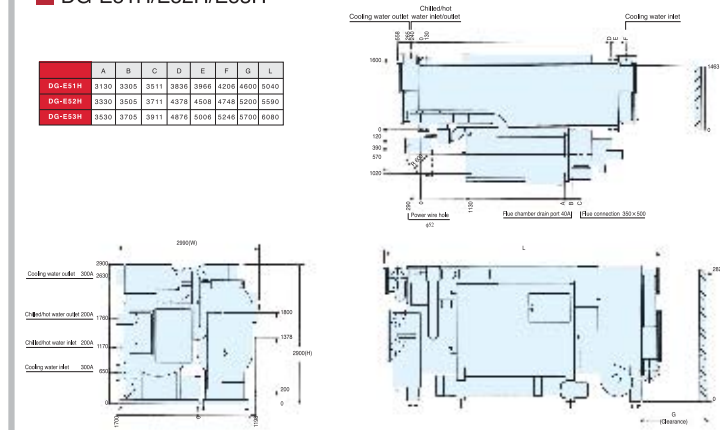


## DG-E51GH/E52GH/E53GH



## DG-E51KH/E52KH

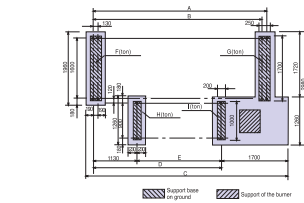

## DG-E53KH

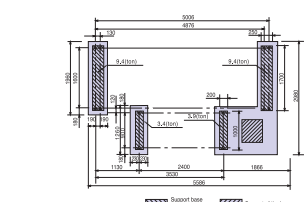


	A	B	C	D	E	F	G	H	I
DG-E51GH	3966	3836	4346	3130	2000	8.2	8.2	3.9	3.3
DG-E52GH	4508	4378	4888	3330	2200	8.8	8.8	3.2	3.6
DG-E53GH	5006	4876	5386	3530	2400	9.4	9.4	3.4	3.9

	A	B	C	D	E	F	G	H	I
DG-E51KH	3966	3836	5020	3130	2000	8.2	8.2	2.9	3.3
DG-E52KH	4508	4378	5220	3330	2200	8.8	8.8	3.2	3.6



# Overall dimension diagram Base diagram

- Overall dimension diagram
- Note: 1. Overall dimension value (L),(W),(H) is example value.
- 2. Mark  $\odot$  denotes the position of foundation bolts of chiller/heater.
- 3. Clearance space must be saved for either side of the chiller/heater.
- 4. Mark  $\uparrow$  is the power wire hole.
- 5. Maintenance space must be saved around the chiller/heater.
- Length direction -----1m Above-----0.2m  
Control panel direction-----1.2m Outside-----0.5m
- 6. "A" stands for nominal diameter, unit is mm.





- Base diagram
- Note: 1. There are 450 holes under the chiller/heater for foundation bolts.
- 2. When fastening foundation bolts, please weld base and washer together with reference to left diagram
- 3. Please make a drainage ditch around the chiller/heater.
- 4. Please make the ground water proof in order to maintain the chiller/heater.
- 5. The base must be smooth and horizontal(The levelness should be below 2mm for 1,000mm).

	Y <sub>0</sub>	Z <sub>0</sub>
DG-E11~E31H	80	260
DG-E32~E52H	80	340
DG-E53~E82H	90	440



## DG-E61H/E62H/E63H

	A	B	C	D	E	F	G	L
DG-E61H	3788	4023	4252	4328	4468	4758	5200	5690
DG-E62H	4088	4323	4552	4826	4968	5256	5700	6190
DG-E63H	4388	4623	4852	5351	5491	5781	6200	6710

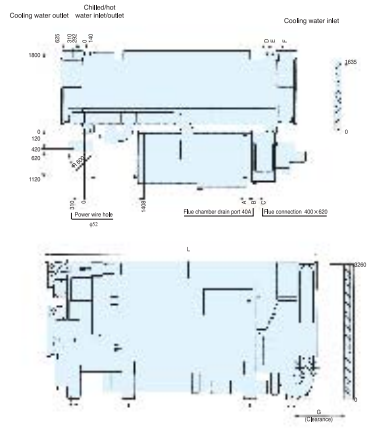


## DG-E61GH

## DG-E61KH




## DG-E62H/E63H \*In ( ) is Model E63H

	A	B	C	D	E	F	G	H	I
DG-E62H	3966	4826	5958(6258)	4088	2680	12.5	12.5	4.8	4.0
DG-E63H	5491	5351	6258(6508)	4388	2980	13.4	13.4	5.3	5.3




## DG-E71H/E72H/E73H

	A	B	C	D	E	F	J	K	L	M	N	G	H	I
DG-E71H	5160	3395	3620	4420	4566	5096	5440	5700	6430	6230	16.1	6.4	6.4	0.5
DG-E72H	5460	3695	3920	4951	5091	5621	5970	6200	6960	6540	17.2	6.9	7.0	0.6
DG-E73H	5760	3995	4220	5451	5591	6121	6470	6700	7460	6840	18.2	7.4	7.5	0.6

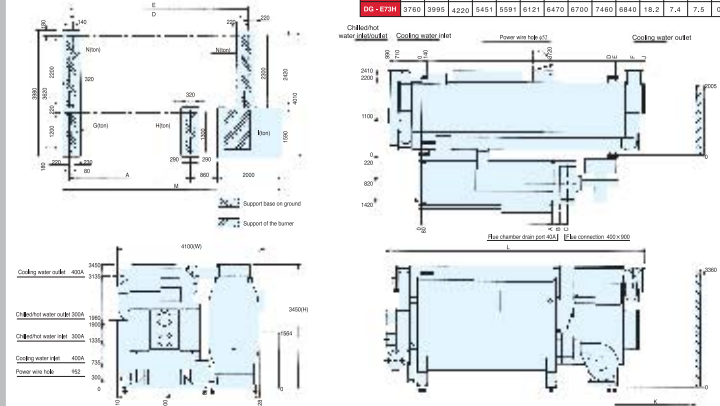


## DG-E81H/E82H \*In ( ) is Model E82H

	A	B	C	D	E	F	J	K	L
DG-E81H	3760	3995	4220	4951	5091	5621	5970	6200	6960
DG-E82H	3960	4195	4420	5451	5591	6121	6470	6700	7460

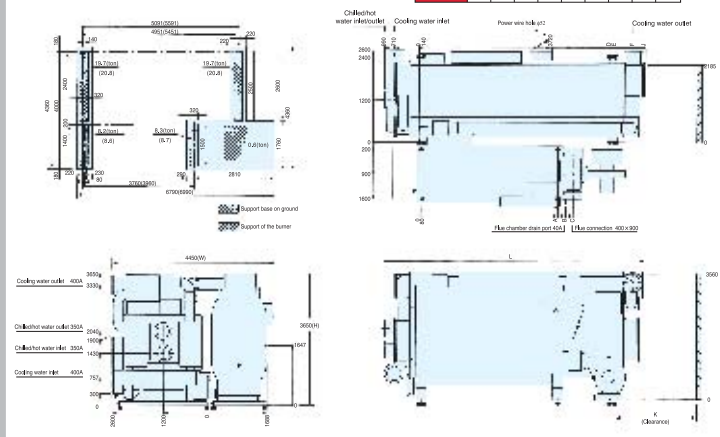


# Flue connection overall dimension diagram

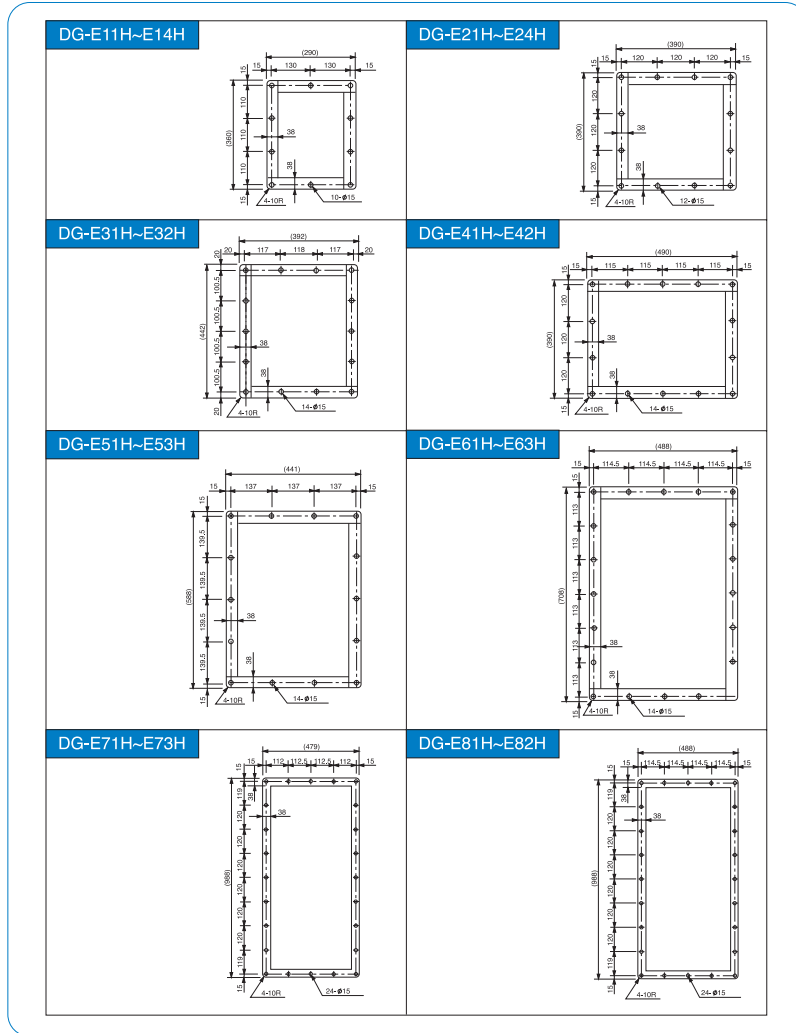

# Heat/cooling insulation area

## Heat/cooling insulation area

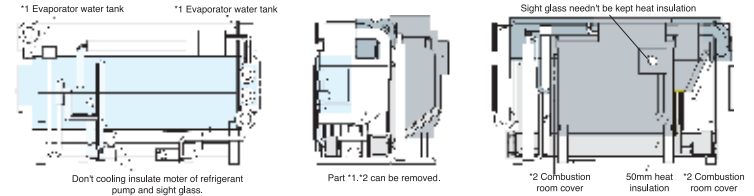

- Part #1, #2 can be removed
- 100mm heat insulation: high temperature generator.
- 75mm heat insulation: low temperature generator, steam pipe, etc.
- 30mm heat insulation: heat exchanger, connecting pipes, etc.
- 50mm cooling insulation: evaporator, evaporator water tank, etc.
- 30mm cooling insulation: upper part of refrigerant pump, connecting pipes, etc.


- ◆ Heat insulation material: glass fibre, asbestos and the like.
- ◆ Cooling insulation material: polythene foam and the like.
- ◆ Heat/cooling insulation total area includes machine pipe area .
- ◆ Please use non-combustible as heat/cooling material.
- ◆ In above drawing, DG-E11H ~ E63H is indicated. For others detail, see ex-works file.

Partition Insulation thickness Model	Heat insulation area(m <sup>2</sup> )			Cooling insulation area(m <sup>2</sup> )	
	100mm	75mm	30mm	50mm	30mm
DG-E11H	5.8	2.2	3.1	4.0	0.4
DG-E12H	6.2	2.2	3.5	4.0	0.4
DG-E13H	7.8	3.2	4.5	5.5	0.4
DG-E14H	8.0	3.2	4.6	5.5	0.4
DG-E21H	10.1	3.8	4.8	6.1	0.5
DG-E22H	10.4	3.8	4.9	6.1	0.5
DG-E23H	11.8	4.8	5.4	7.6	0.5
DG-E24H	12.5	4.8	5.6	7.6	0.5
DG-E31H	14.5	5.5	6.0	8.5	0.7
DG-E32H	15.2	5.5	6.4	8.5	0.7
DG-E41H	17.5	5.7	7.3	9.9	0.7
DG-E42H	18.1	5.7	7.7	9.9	0.7

Partition Insulation thickness Model	Heat insulation area(m <sup>2</sup> )			Cooling insulation area(m <sup>2</sup> )	
	100mm	75mm	30mm	50mm	30mm
DG-E51H	19.6	5.4	7.6	13.8	1.1
DG-E52H	20.7	5.9	8.1	15.0	1.1
DG-E53H	21.7	6.2	8.8	16.1	1.1
DG-E61H	25.4	7.2	11.8	17.5	1.2
DG-E62H	27.2	7.7	12.1	18.7	1.2
DG-E63H	28.9	8.2	12.9	20.0	1.2
DG-E71H	35.4	10.4	13.6	10.9	1.4
DG-E72H	37.4	10.7	13.9	11.4	1.4
DG-E73H	39.4	11.0	14.4	11.8	1.4
DG-E81H	42.5	11.0	15.4	13.1	1.5
DG-E82H	44.0	11.3	15.5	13.6	1.5

# Moving dimension


## Moving wholly

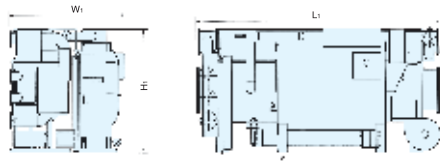


### Note:

1. When moving the machine separately, remove the control panel and discharge the solution before ex-works.
2. When calculating inlet height, add height of support and rolling log to the H.
3. When hoisting, keep as horizontal as possible.

## Moving separately (Low temperature part)

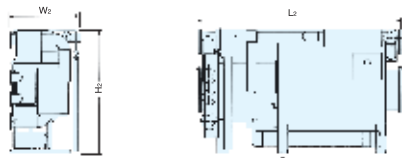

## Moving separately (High temperature part)



## Moving dimension


Model	Moving wholly				Moving separately								
	Low temperature part			High temperature part									
	Length L1(mm)	Width W1(mm)	Height H1(mm)	Weight Ton	Length L2(mm)	Width W2(mm)	Height H2(mm)	Weight Ton	Length L3(mm)	Oil Gas	Width W3(mm)	Height H3(mm)	Weight Ton
DG-E 1 1 H	2720	1860	2010	4.5	2720	1220	2010	2.4	2030	2080	1000	2010	1.2
DG-E 1 2 H	2720	1860	2010	4.8	2720	1220	2010	2.5	2120	2190	1000	2010	1.3
DG-E 1 3 H	3740	1960	2010	5.8	3740	1250	2010	3.1	2320	2340	1000	2010	1.5
DG-E 1 4 H	3740	1960	2010	6.2	3740	1250	2010	3.2	2460	2680	1000	2010	1.6
DG-E 2 1 H	3760	2130	2210	7.3	3760	1430	2220	3.9	2660	2990	1030	2190	1.9
DG-E 2 2 H	3760	2130	2210	7.7	3760	1430	2220	4.0	2870	3190	1030	2190	2.0
DG-E 2 3 H	4820	2140	2210	8.9	4820	1450	2220	4.7	3410	2530	1030	2190	2.2
DG-E 2 4 H	4820	2140	2210	9.4	4820	1450	2220	4.9	3410	3850	1030	2190	2.4
DG-E 3 1 H	4880	2330	2440	11.6	4880	1480	2440	6.2	3460	3710	1100	2420	3.0
DG-E 3 2 H	4880	2330	2440	12.2	4880	1480	2440	6.4	3510	3770	1100	2420	3.2
DG-E 4 1 H	4900	2540	2650	14.2	4900	1620	2650	7.5	3720	3910	1190	2630	3.7
DG-E 4 2 H	4900	2540	2650	14.9	4900	1620	2650	7.8	4000	4060	1190	2630	3.9
DG-E 5 1 H	5090	3040	2950	19.5	5090	2200	2950	11.1	2990	4180	1460	2950	4.7
DG-E 5 2 H	5640	3040	2950	21.1	5640	2200	2950	12.0	3190	4380	1460	2950	5.1
DG-E 5 3 H	6130	3040	2950	22.7	6130	2200	2950	12.8	3390	4580	1460	2950	5.5
DG-E 6 1 H	-	-	-	-	5740	2450	3380	15.5	3500	3800	1380	3380	5.9
DG-E 6 2 H	-	-	-	-	6240	2450	3380	16.4	3800	4100	1380	3380	6.4
DG-E 6 3 H	-	-	-	-	6760	2450	3380	17.7	4100	4400	1380	3380	7.0
DG-E 7 1 H	-	-	-	-	6480	2800	3500	21.5	4220	5790	1650	3500	9.8
DG-E 7 2 H	-	-	-	-	7010	2800	3500	23.0	4520	6090	1650	3500	10.5
DG-E 7 3 H	-	-	-	-	7510	2800	3500	24.3	4820	6640	1650	3500	11.2
DG-E 8 1 H	-	-	-	-	7010	3000	3700	26.0	4840	6640	1820	3700	12.3
DG-E 8 2 H	-	-	-	-	7510	3000	3700	27.5	4840	6640	1820	3700	12.8

Note: Above values are for reference, contact Dalian Sanyo for specific requirement.


# Combustion system scheme

## Gas-fired


### Suitable gas pressure: low

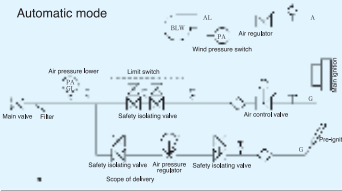

## Oil-fired

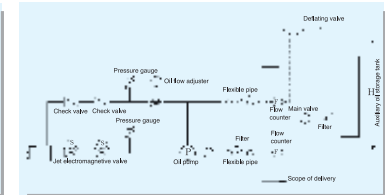


### Suitable gas pressure: intermediate

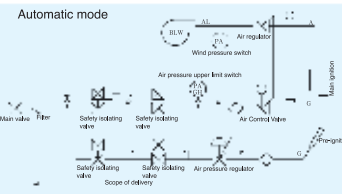


### Note:

1. Exit filter of auxiliary oil storage tank should be set above 80 grids-holes.
2. Deflating valve should be installed in the pipe where air is stored.
3. Backflow pipe of auxiliary oil storage tank must be installed.
4. Valves must not be set in backflow pipe.
5. Oil level of auxiliary storage tank should be set not lower than 4 meters below pump site.  
\* Pump pressure on absorbing side should be set  $0 \sim 0.35 \text{ kg/cm}^2 \cdot \text{G}$ .  
\* Height of backflow pipe (H) should be set below 5 meters.
6. Flow counter must be installed both in the feed side pipe and the backflow pipe.
7. Linkage pipe from auxiliary oil tank to oil joint should be heat , corrosion resistant and suitable for climate.

### Suitable gas pressure: medium

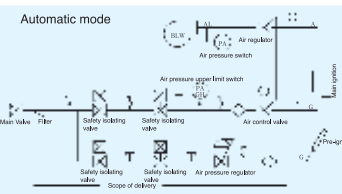


# Control panel

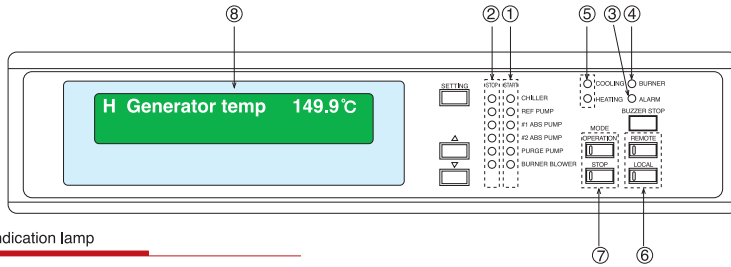

## Indication lamp


symbol	Name	Lamp color
①	Running(Operation) indication lamp	Red
②	Stop indication lamp	Green
③	Alarm indication lamp	Orange
④	Burner combustion indication lamp	Red
⑤	Cooling / Heating indication lamp	Orange
⑥	Remote / Local select button with lamp	Red
⑦	Mode select button with lamp	Red
⑧	Data display	LCD

## Control panel dimension diagram

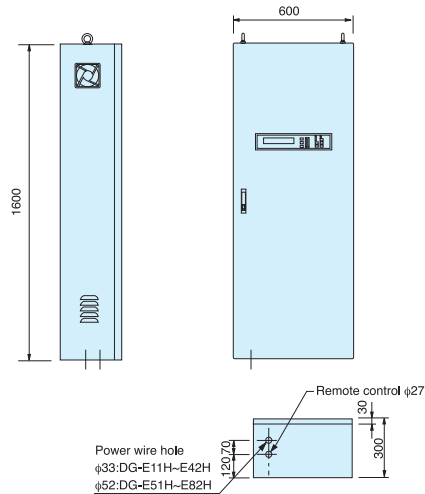


# Accessory equipment electric circuit essential

## Accessory equipment electric circuit reference example

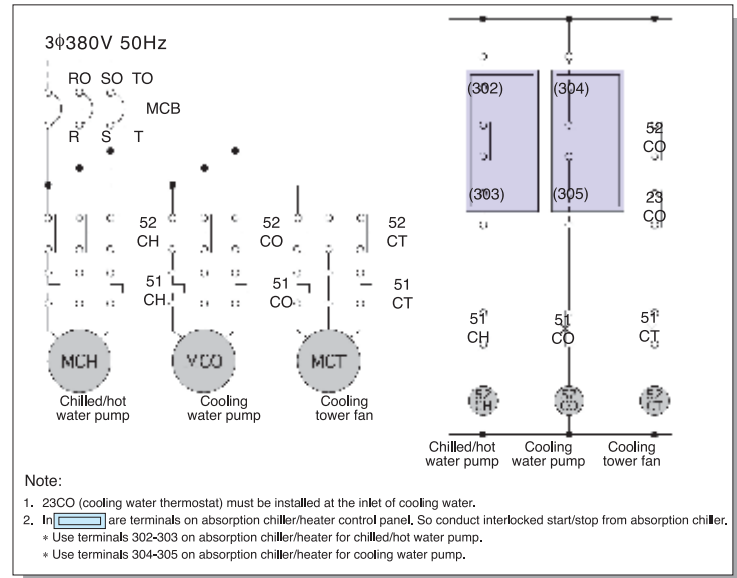


## Accessory equipment start/stop sequence


### Interlocked start sequence



### Interlocked stop sequence



### Chiller/heater dilution operation time chart

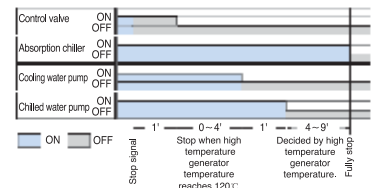


## Note:

1. Mark ★ means they don't start in heating operation
2. Please stop @ Air-conditioner after absorption chiller/heater fully stopped.

1. In cooling operation shortest dilution operation time is 6 minutes, longest 15 minutes.
2. In heating operation dilution operation time is 5 minutes.

# Electric wiring diagram

## Electric wiring diagram

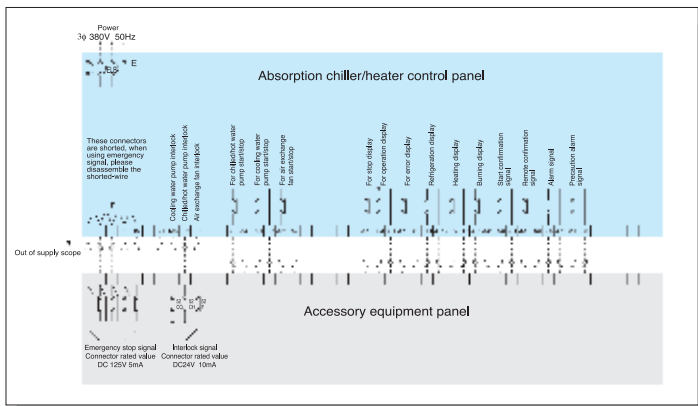

Note: \* Start confirmation signal: the display after receiving the control signal from "Start" button  
 \* Operation display signal: the display when the machine or the pump is running

## Outside wiring

Accessory equipment wiring  
 Please connect user's power wire to the electric leakage breaker in the control panel, power wire earth line to earth terminals in the control panel

Accessory equipment wiring	Kinds	Terminal No.	Note
Chilled/hot water pump interlock	171-136	DC24V 10mA	
Cooling water pump interlock	171-135	DC24V 10mA	
Chilled water pump operation	302-303	Connector specification AC250V 0.1A	
Cooling water pump operation	304-305	Connector specification AC250V 0.1A	
Air exchange fan	306-307	Connector specification AC250V 0.1A	

## Wiring of remote start/stop signal.


For remote start/stop, there are signals as follows, select when designing. When using non-voltage connector, please first connect terminals 171 and 332.

Kinds	Input signal	Terminal No.	Note
1 Non-voltage connector continuous signal	ON/OFF	330-333	
2 Non-voltage connector pulse signal	ON	330-333	Use connector A
3 Non-voltage connector pulse signal	ON	331-333	Use connector A
4 DC24V continuous signal	ON/OFF	331-333	Use connector B
5 DC24V pulse signal	OFF	331-333	Use connector B
6 AC24V continuous signal	ON/OFF	330-332	No polarity (No=)
7 AC24V pulse signal	ON	330-332	No polarity (No=)

State display connector wiring.  
 Please prepare the following six state display connector.

Kinds	Terminal No.	Note
1 Stop display connector	323-324	Connector specification AC250V 0.1A
2 Operation display connector	322-324	Connector specification AC250V 0.1A
3 Error display connector	320-321	Connector specification AC250V 0.1A
4 Start confirmation connector	300-301	Connector specification AC250V 0.1A
5 Alarm signal	326-327	Connector specification AC250V 0.1A
6 Precaution alarm signal	84-85	Connector specification AC250V 0.1A


## Remote start/stop signal connection example

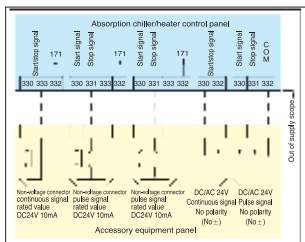

Note: 1. when using non-voltage connector, please first connect terminals 171 and 332.  
 2. Connector rated value of non-voltage connector is DC24V 10mA.

# Piping system diagram

## Piping system diagram (Reference example)

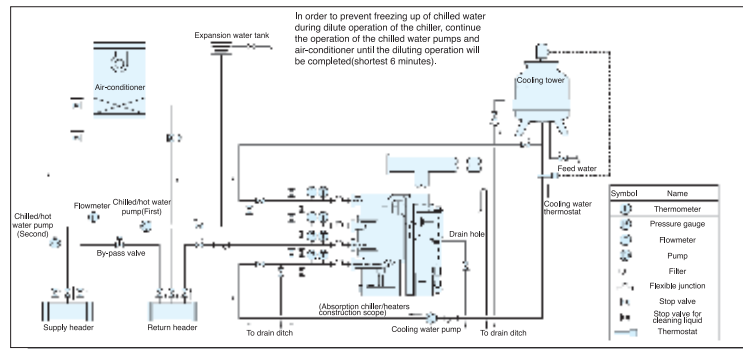

## Attentions to pipe construction


- Prepare external pipes connecting to the absorption chiller/heaters (dashed line) on your own.
- Refer to the overall dimensions diagram and specifications table for pipe connections and diameters.
- Try to make sure the chilled/hot/cooling water flowrate in conformity with standard value. Please keep the range of chilled/hot/cooling water flow between 50% ~ 120% of specified value to prevent freezing, corrosion and leakage.
- Please properly positioned the chilled/hot water pump, cooling water pump, expansion water tank in order to make the pressure on the body not exceed the set value.
- Set special chilled/hot water pump and cooling water pump for each refrigerator with their capacity meeting the specifications.
- Please make sure to install the flexible junction between the machine and the inlet/outlet of the chilled/hot water pump and cooling water pump, and make sure to have a straight tube on the chilled/hot water inlet/outlet pipe, which length is at least decuple pipe diameter.
- Clean and descale the pipes through by-pass pipeline after installing the whole pipe system, then connect with the machine. Please make sure that the cleaning water cannot pass the machine.
- The bad water quality could cause corrosion and fouling phenomenon, so please make sure to treat and manage strictly the water quality of chilled/hot water and cooling water system.
- Install a cooling water flow regulate valve at the cooling tower inlet in order to manage the water quality.
- Install filter in the chilled/hot, cooling water pipes(No. 10 filter screen).
- Following devices should be equipped around the chilled/hot, cooling water inlet and outlet. exclusive of all kinds of stop valves in order to maintain and supervise chilled/hot water.
  - Install thermometer and pressure gauge around the inlet and outlet of chilled/hot water and cooling water.
  - Install deflating valve above water tank.
  - Install drain valves at the lowest positions between the absorption chiller/heaters and the stop valves of chilled/hot water and cooling water, then pipe to the drain ditch.
  - Install stop valves between the absorption chiller/heaters and stop valves of all inlets and outlets to clean the water circuit system with clean liquid.
- Install the gas leakage detection alarm device for gas-fired type chiller/heater in the machine room. Make sure that the gas shut-off valve can close immediately when alarming and the exhaust fan of the machine room can automatically run when alarming.
  - When air flue and funnel is connected:
    - Make insulate construction and drain holes.
    - Avoid exhaust gas leak into the room and causing poisoning. Please confirm that the exhaust drain from the machine and the condensate pipe from the indoor units are not commonly connected.
    - Avoid using the same chimney with garbage burning furnace.
    - Avoid backflowing to the machine at rest when common chimney is connected by two more machine.
    - Install vent regulator when static pressure in the flue is easy to change.
    - Make the outlet of chimney far from the cooling tower.
  - Please be sure to keep the foundation level (levelness within 2/1000mm) during installation of chiller.

Note: For the design and construction of the system and the machine room. Please follow the national relative air-conditioner design code, gas/oil-fired design and safety code, building fire-protection design code and fire requirements, etc.

# Cooling water management essentials

## Cooling water temperature control essential (Reference example)

Cooling water temperature can't drop 13°C lower than design temperature.  
For example, when cooling water inlet temperature is 32°C, cooling water temperature can't drop below 19°C.  
However, it is no matter even the temperature below above value between start and normal run.

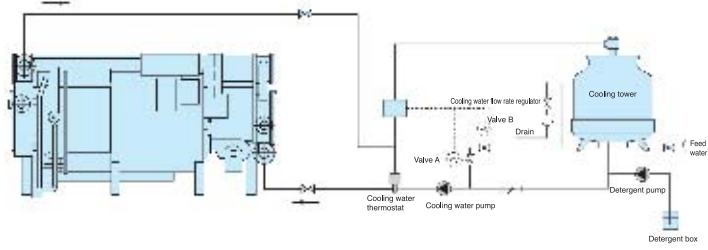

### Prevention of cooling water temperature from dropping too low:

1. Be sure to start and stop the fan by means of the cooling water thermostat.
2. Only in the cooling operation in summer, valve A can be used as hand-operated butterfly valve.
3. In the cooling operation in the middle region and in winter, valve A and valve B should be used as automatic valve(three-throw valve also can be used).The setting value of cooling water thermostat such as: below 22°C shut down the valve, above 25°C open the valve.

Manufacturer	Model	Temperature scope	Temperature difference	Switch
Yamatake Honeywell	T675A	-15°C ~ 35°C	1.7°C ~ 5.6°C	SPDT x 1
SAGINOMIYA	TNS-C1034CW	-20 ~ +35°C	4 ~ 20°C	SPDT x 1

### Cooling water quality supervise essential

- Moisture in the cooling water is vaporized and dispersed into the atmosphere when flowing through the cooling tower, therefore cooling water is continuously concentrated and deteriorated.
- If the cooling water quality deteriorated corrosion and dirt accumulation will arise, therefore the unit will be troubled with capacity declination and heat-transfer pipe corrosion. Please install cooling water overflow device to supervise the water quality properly. In addition, proper water quality treatment will have better effect.
- Water quality standard for water used in common air-conditioner and refrigerator, has been formulated by Japanese Industry Association of Refrigerator and air-conditioner, for detail reference following table.

### Cooling water quality standard

Item	Circulation		Direct-used mode	Trend	
	Circulation water	Feed water	Direct-used water	Corrosion	Dirt
PH(25°C)	6.5 ~ 8.2	6.0 ~ 8.0	6.8 ~ 8.0	○	○
Electrical conductivity(25°C)(mS/m)	80 below	30 below	40 below	○	○
Electrical conductivity(25°C)(μS/cm)	800 below	300 below	400 below	○	○
Cl <sup>-</sup> (mgCl <sup>-</sup> / )	200 below	50 below	50 below	○	
SO <sub>4</sub> <sup>2-</sup> (mgSO <sub>4</sub> <sup>2-</sup> / )	200 below	50 below	50 below	○	
Acid consumption (PH4.8)(mgCaCO <sub>3</sub> / )(Malkalinity)	100 below	50 below	50 below		○
Total hardness (mgCaCO <sub>3</sub> / )	200 below	70 below	70 below		○
SiO <sub>2</sub> (mgSiO <sub>2</sub> / )	50 below	30 below	30 below		○
Fe(mgFe/ )	1.0 below	0.3 below	1.0 below	○	○
S <sup>2-</sup> (mgS <sup>2-</sup> / )	Beyond measure	Beyond measure	Beyond measure	○	
NH <sub>4</sub> <sup>+</sup> (mgNH <sub>4</sub> <sup>+</sup> / )	1.0 below	0.1 below	1.0 below	○	

# Note before order

## Note before order

If the following contents are supplied, we can offer proper plan to satisfy your requirement.

1 Refrigeration capacity	USRT or	kW
2 Heating capacity		kW
3 Quantity	Unit	
4 Application (Air-conditioning, process, etc.)		
5 Special application(Simultaneous chilled and hot water, etc.)		
6 Chilled water inlet temperature	°C Working pressure	MPa kg/cm <sup>2</sup> · G
7 Chilled water outlet temperature or flow rate	°C or	m <sup>3</sup> /h
8 Cooling water inlet temperature	°C Working pressure	MPa kg/cm <sup>2</sup> · G
9 Cooling water outlet temperature or flow rate	°C or	m <sup>3</sup> /h
10 Hot water inlet temperature	°C Working pressure	MPa kg/cm <sup>2</sup> · G
11 Hot water outlet temperature or flow rate	°C or	m <sup>3</sup> /h
12 Fuel kinds		
13 Fuel high heat value or low heat value		
14 If fuel is gas		
	Gas supply pressure	mmH <sub>2</sub> O or kg/cm <sup>2</sup> · G
	Gas specific gravity	(Air's specific gravity 1)
	Gas component and others	
15 Power voltage		
16 Installation place ( roof, ground, under ground, etc.)		